



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**APPLICATION FOR OSHPD SPECIAL SEISMIC  
CERTIFICATION PREAPPROVAL (OSP)**

OFFICE USE ONLY

APPLICATION #: **OSP – 0413 – 10**

**OSHPD Special Seismic Certification Preapproval (OSP)**

Type:  New  Renewal

**Manufacturer Information**

Manufacturer: Tuttle & Bailey HVAC (Air System Components)

Manufacturer's Technical Representative: Chris Griffin

Mailing Address: 1401 North Plano Road, Richardson TX 75081

Telephone: 972-497-0483 Email: cgriffin@tuttleandbailey.com

**Product Information**

Product Name: Single Duct

Product Type: Air Terminal Units

Product Model Number: Single Duct (SDV)

(List all unique product identification numbers and/or part numbers)

General Description: Suspended cataloged terminal units. Seismic enhancements made to the test units and modifications required to address anomalies observed during the tests shall be incorporated into the production units.

Mounting Description: Rigidly suspended units & vibration isolated suspended units, restrained with seismic cable kits.

**Applicant Information**


Applicant Company Name: The VMC Group

Contact Person: John Giuliano

Mailing Address: 113 Main Street, Bloomingdale, NJ 07403

Telephone: 973-838-1780 Email: john.giuliano@thevmcgroup.com


I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2013.

Signature of Applicant:  Date: 10/17/14

Title: President Company Name: The VMC Group

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY  
OSH-FD-759 (REV 1/24/13)

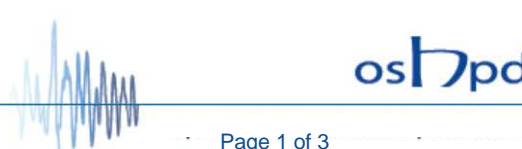



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)**

Company Name: The VMC Group

Name: Kenneth Tarlow California License Number: SE2851

Mailing Address: 113 Main Street, Bloomingdale, NJ 07403

Telephone: 973-838-1780 Email: ken.tarlow@thevmcgroup.com

**Supports and Attachments Preapproval**

- Supports and attachments are preapproved under OPM- \_\_\_\_\_  
(Separate application for OSHPD Preapproval of Manufacturer's Certification (OPM) of Supports and attachments is required)
- Supports and attachments are not preapproved

**Certification Method**

- Testing in accordance with:  ICC-ES AC156
- Other (Please Specify): \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**Testing Laboratory**

Company Name: UC Berkeley

Contact Name: Wesley Neighbour

Mailing Address: 1301 South 46<sup>th</sup> Street, Building 420, Richmond, CA 94804

Telephone: 510-665-3409 Email: wdn@berkeley.com

**Testing Laboratory**

Company Name: \_\_\_\_\_

Contact Name: \_\_\_\_\_

Mailing Address: \_\_\_\_\_

Telephone: \_\_\_\_\_ Email: \_\_\_\_\_

\*Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs\*





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**Seismic Parameters**

Design in accordance with ASCE 7-10 Chapter 13:  Yes  No

Design Basis of Equipment or Components ( $F_p/W_p$ ) = 3.60

$S_{DS}$  (Design spectral response acceleration at short period, g) = 2.00

$a_p$  (In-structure equipment or component amplification factor) = 2.5

$R_p$  (Equipment or component response modification factor) = 2.5

$\Omega_0$  (System overstrength factor) = 2.5

$I_p$  (Importance factor) = 1.5

$z/h$  (Height factor ratio) = 1.0

Equipment or Component Natural Frequencies (Hz) = See Attached Matrix

Overall dimensions and weight (or range thereof) = See Attached Matrix

Equipment or Components @ grade designed in accordance with ASCE 7-10 Chapter 15:  Yes  No

Design Basis of Equipment or Components ( $V/W$ ) = \_\_\_\_\_

$S_{DS}$  (Design spectral response acceleration at short period, g) = \_\_\_\_\_

$S_{D1}$  (Design spectral response acceleration at 1 second period, g) = \_\_\_\_\_

R (Response modification coefficient) = \_\_\_\_\_

$\Omega_0$  (System overstrength factor) = \_\_\_\_\_

$C_d$  (Deflection amplification factor) = \_\_\_\_\_

$I_p$  (Importance factor) = 1.5

Height to Center of Gravity above base = \_\_\_\_\_

Equipment or Component Natural Frequencies (Hz) = \_\_\_\_\_

Overall dimensions and weight (or range thereof) = \_\_\_\_\_

Tank(s) designed in accordance with ASME BPVC, 2010:  Yes  No

**List of Attachments Supporting Special Seismic Certification**

Test Report(s)  Drawings  Calculations  Manufacturer's Catalog

Other(s) (Please Specify): \_\_\_\_\_

**OSHDP Approval (For Office Use Only) – Approval Expires on December 31, 2019**

Signature:  Date: August 14, 2015

Print Name: Timothy J. Piland Title: SSE

Special Seismic Certification Valid Up to :  $S_{DS}$  (g) = 2.00  $z/h$  = 1

Condition of Approval (if applicable): \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_



# Tuttle & Bailey Air Terminal Units Certified Product Table

Table 1 - Certified Cabinet Sizes

Product Family	Model	Manufacturer	Inlet Size (in)	Height (in)	Width (in)	Max Length (in)	Max Weight (lbs)	Mounting Configuration		SDS	z/h	UUT
								Suspended w/ Isolators	Suspended Rigidly			
Single Duct	SDV (Clone of Titus ESV)	Tuttle & Bailey	4	8	15.5	39.5	68	X	X	2.00	1.00	extrapolated
			5	8	15.5	39.5	68	X	X	2.00	1.00	extrapolated
			6	8	15.5	39.5	68	X	X	2.00	1.00	extrapolated
			7	10	15.5	39.5	70	X	X	2.00	1.00	extrapolated
			8	10	15.5	39.5	70	X	X	2.00	1.00	6
			9	12.5	15.5	39.5	80	X	X	2.00	1.00	interpolated
			10	12.5	15.5	39.5	80	X	X	2.00	1.00	interpolated
			12	15	16	39.5	90	X	X	2.00	1.00	interpolated
			14	17.5	20	39.5	110	X	X	2.00	1.00	interpolated
			16	18	24	39.5	130	X	X	2.00	1.00	interpolated
24x16	18	38	39.5	245	X	X	2.00	1.00	7			



# Tuttle & Bailey Air Terminal Units Certified Product Subcomponent Tables

Table 2 - Certified External Sheeting

EXTERIOR Wall/Roof/Floor Panel Material	Thickness	Manufacturer	UUT
Galvanized Carbon Steel	20 ga	Tuttle & Bailey	1,2,3,4,5,6,7

Table 3 - Certified Liners

Material	Manufacturer	UUT
No Liner	n/a	extrapolated
Standard 1/2"	Johns-Manville	1, 6
1"	Johns-Manville	2
Insulgard	Johns-Manville	3
Galvanized Sheet Metal Liner	Johns-Manville	7
Enviroseal	Johns-Manville	interpolated

Table 4a - Certified Hydronic Coils

Dimensions	Height (in)	Width (in)	MFR	Model Number	UUT
	10"	12"	Great American Coil	W4-1087	6
	10"	18-1/2"		interpolated	interpolated
	12 1/2"	20-1/2"		W4-7165	2
	12 1/2"	20-1/2"		interpolated	interpolated
	17-1/2"	25"		W4-1372	4
	17-1/2"	25"		interpolated	interpolated
	18"	38"		W4-1080	7

Table 4b - Certified Hydronic Coil Options

		UUT
Casing Material	Galvanized Carbon Steel	2,4,6,7
Tube Material	Copper	2,4,6,7
Tube Outer Diameter	0.5"	2,4,6,7
Tube Wall Thickness	0.032"	2,4,6,7
Fin Material	Aluminum	2,4,6,7
Fin Thickness	0.0045"	2,4,6,7
Fin Pitch	10	2,4,6,7
Fin Pitch	12	extrapolated
Pipe Qty	2	2,4,6,7
Tube Rows	1	2, 6
	2	4, 7
	3	extrapolated
	4	extrapolated
Header Material	Copper	2,4,6,7



# Tuttle & Bailey Air Terminal Units Certified Product Subcomponent Tables

Table 5 - Certified Electric Heat

Code	Model Availability	Electric Coil				MFR	UUT
		Voltage	Phase	Stage	kW Range		
E11	SDV	120	1	1	0.5 - 13.0	Tuttle & Bailey	Extrapolated
E12	SDV	120	1	2	0.5 - 13.0	Tuttle & Bailey	Extrapolated
E13	SDV	120	1	3	0.5 - 13.0	Tuttle & Bailey	Extrapolated
E21	SDV	208	1	1	0.5 - 13.0	Tuttle & Bailey	Extrapolated
E22	SDV	208	1	2	0.5 - 13.0	Tuttle & Bailey	Extrapolated
E23	SDV (Clone of Titus TFS)	208	1	3	0.5 - 13.0	Tuttle & Bailey	1
E31	SDV (Clone of Titus ESV)	240	1	1	0.5 - 13.0	Tuttle & Bailey	6
E32	SDV	240	1	2	0.5 - 13.0	Tuttle & Bailey	Interpolated
E33	SDV	240	1	3	0.5 - 13.0	Tuttle & Bailey	Interpolated
E41	SDV (Clone of Titus TFS)	277	1	1	0.5 - 13.0	Tuttle & Bailey	5
E42	SDV	277	1	2	0.5 - 13.0	Tuttle & Bailey	Interpolated
E43	SDV (Clone of Titus TFS)	277	1	3	0.5 - 13.0	Tuttle & Bailey	3
E61	SDV	208	3	1	0.5 - 18.0	Tuttle & Bailey	Interpolated
E62	SDV	208	3	2	0.5 - 18.0	Tuttle & Bailey	Interpolated
E63	SDV	208	3	3	0.5 - 18.0	Tuttle & Bailey	Interpolated
E71	SDV	240	3	1	0.5 - 18.0	Tuttle & Bailey	Interpolated
E72	SDV	240	3	2	0.5 - 18.0	Tuttle & Bailey	Interpolated
E73	SDV	240	3	3	0.5 - 18.0	Tuttle & Bailey	Interpolated
E91	SDV	480	3	1	0.5 - 36.0	Tuttle & Bailey	Interpolated
E92	SDV	480	3	2	0.5 - 36.0	Tuttle & Bailey	Interpolated
E93	SDV (Clone of Titus ESV)	480	3	3	0.5 - 36.0	Tuttle & Bailey	7

**Notes**

- 1) All heaters are sized in increments of 0.5 kW
- 2) SCR heat option also certified
- 2) UUT-01 was 4 kW
- 3) UUT-03 was 4 kW
- 4) UUT-05 was 11 kW SCR
- 5) UUT-06 was 7 kW
- 6) UUT-07 was 35 kW



# Tuttle & Bailey Air Terminal Units

## Certified Product Subcomponent Tables

Table 6 - Certified Controls

Type	Model Number	Height [in]	Width [in]	Depth [in]	Voltage	MFR	UUT
Pneumatic (actuator)	MCP-8031	4.25 dia	4.25 dia	5.5	N/A	Tuttle & Bailey	3, 6
Pneumatic (controller)	CSC-3004	3.5 dia	3.5 dia	4	N/A	Tuttle & Bailey	3
Pneumatic (controller)	CSC-3017	3.5	4.25	2	N/A	Tuttle & Bailey	6
Digital (controller / actuator)	BAC-8005-03	6.5	4.25	2.25	24	Tuttle & Bailey	1,2,4,5,7

Table 7 - Certified Disconnect

Type	Model Number	Height [in]	Width [in]	Depth [in]	Amperes	Voltage	MFR	UUT
Non-fusible, 3 poles	ABBOTPN63EP	2.89	2.07	3.25	30 - 60	600	ABB	1, 2, 3, 4, 5

Table 8 - Certified Fusing

Type	Height [in]	Width [in]	Depth [in]	Amperes	Voltage	MFR	UUT
KLK, Fast Acting, Line Fuse	0.41	0.41	1.5	8	600	Little fuse	1
KLK, Fast Acting, Line Fuse	0.41	0.41	1.5	16	600	Little fuse	2
KLK, Fast Acting, Line Fuse	0.41	0.41	1.5	24	600	Little fuse	3
KLK, Fast Acting, Line Fuse	0.41	0.41	1.5	32	600	Little fuse	4
KLK, Fast Acting, Line Fuse	0.41	0.41	1.5	40	600	Little fuse	5

Table 9 - Certified Contactors

Type	Model Number	Height [in]	Width [in]	Depth [in]	HP	Voltage	MFR	UUT
Magnetic	3100-20Q334	2.44	1.63	3.25	11/16	277/480V	Hartland Cntrls	1
Magnetic	3100-20T334	2.44	1.63	3.25	11	120V	Hartland Cntrls	2,4,5
Magnetic	3100-20U334	2.44	1.63	3.25	11/16	277/480V	Hartland Cntrls	3

Table 10 - Certified Transformers

Type	Model Number	Height [in]	Width [in]	Depth [in]	VA	Voltage	MFR	UUT
AirCore Class 2	HCT-01D0BB06132	3.125	2.125	3.5	.07 or 50VA	120/24V	Hartland Cntrls	extrapolated
AirCore Class 2	HCT-03D0BB06132	3.125	2.125	3.5	.07 or 50VA	277/24V	Hartland Cntrls	3,5
AirCore Class 2	HCT-04D0BB06132	3.125	2.125	3.5	.07 or 50VA	480/24V	Hartland Cntrls	7
AirCore Class 2	HCT-09D0BB06132	3.125	2.125	3.5	.07 or 50VA	208/240/24V	Hartland Cntrls	1,6
AirCore Class 2	HCT-60D0BB06132	3.125	2.125	3.5	.07 or 50VA	24V/24V	Hartland Cntrls	1,6
AirCore Class 2	HCT-01J2BB07132	3.125	2.125	3.5	75VA	120/24V	Hartland Cntrls	1,6
AirCore Class 2	HCT-03J2BB07132	3.125	2.125	3.5	75VA	277/24V	Hartland Cntrls	1,6
AirCore Class 2	HCT-04J2BB07132	3.125	2.125	3.5	75VA	480/24V	Hartland Cntrls	1,6
AirCore Class 2	HCT-09J2BB07132	3.125	2.125	3.5	75VA	208/240/24V	Hartland Cntrls	1,6



THE VMC GROUP

The Power of Together™

Page 7 of 22

# Tuttle & Bailey Air Terminal Units Certified Product Subcomponent Tables

Table 11 - Certified Relays

Type	Height [in]	Width [in]	Depth [in]	HP	Voltage	MFR	UUT
SPST	2.37	2.1	2.1	0.75	277V	Hartland Cntris	1, 2, 3, 4, 5

Table 12 - Certified Airflow Switches

Type	Height [in]	Width [in]	Depth [in]	HP	Voltage	MFR	UUT
ElectroPneumatic	2.94	3.25	6.12	5.6	277V	Cleveland Controls	1,2,3,4,5,6,7

Table 13 - Certified Dampers

Unit Size	Height	Width	Qty	MFG	UUT
6	5.875 dia	5.875 dia	1	Tuttle & Bailey	1
10	9.875	9.875	1		interpolated
12	11.875 dia	11.875 dia	1		3
14	13.875	13.875	1		interpolated
16	15.875 dia	15.875 dia	1		5
8	7.875 dia	7.875 dia	1		6
24 X 16 (40)	16	24	1	Ruskin	7

Damper Material		UUT
Frame	Blades	
N/A	Galvanized Carbon Steel	1,2,3,4,5,6
Aluminum	Aluminum	7

Actuator MFR	UUT
ref table 9	1,2,3,4,5,6,7



**UUT #1a**

**Manufacturer:** Tuttle & Bailey

**Model Series:** TFS-A Unit A Size 6"

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Standard 1/2" Liner)	48"	21"	10.5"	100 lbs	na	na	na
Electric Heat (4kw, 3 stage)							
Control (Digital)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Transformer (AirCore Class 2)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (5.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Aflx-H(g)	Arig-H(g)	Aflx-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

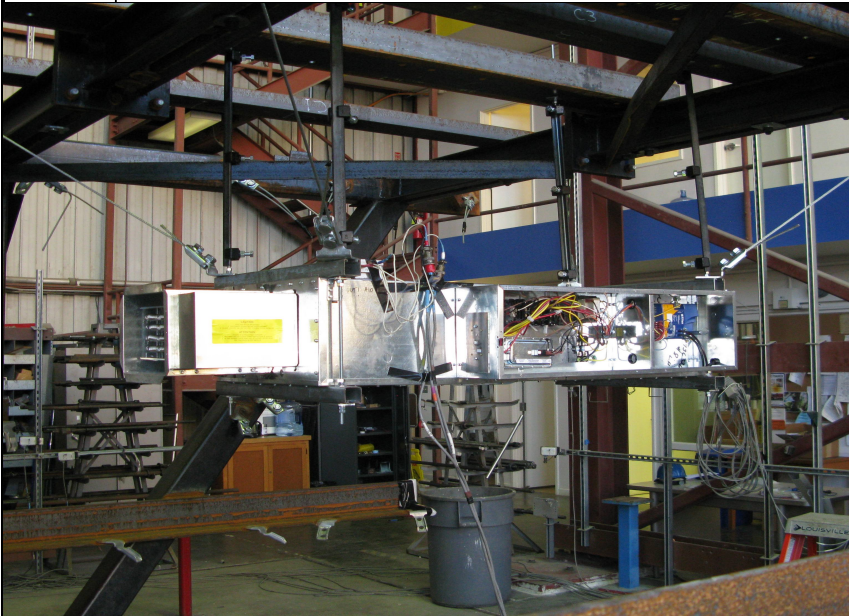

**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-50 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #1b**

**Manufacturer: Tuttle & Bailey**

**Model Series: TFS-A Unit A Size 6"**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**

Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Standard 1/2" Liner)	48"	21"	10.5"	100 lbs	na	na	na
Electric Heat (4kw, 3 stage)							
Control (Digital)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Transformer (AirCore Class 2)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (5.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Aflx-H(g)	Arig-H(g)	Aflx-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.



**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #2a**

**Manufacturer: Tuttle & Bailey**

**Model Series: TFS Unit B Size 6"**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (1" Liner)	43"	37"	16"	215 lbs	na	na	na
Coil (Hydronic)					/	/	/
Control (Digital)					/	/	/
Disconnect (Non Fusible, 3 Pole)					/	/	/
Fuses (KLK, Fast Acting, Line Fuse)					/	/	/
Contactors (Magnetic)					/	/	/
Relays (SPST)					/	/	/
Airflow Switch (Electro Pneumatic)					/	/	/
Damper (5.875" dia, Galv Carbon Steel)					/	/	/
Fan Speed Control (Adjustable SCR)					/	/	/
Inlet Sensor					/	/	/
Control Enclosure (NEMA 1)					/	/	/

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

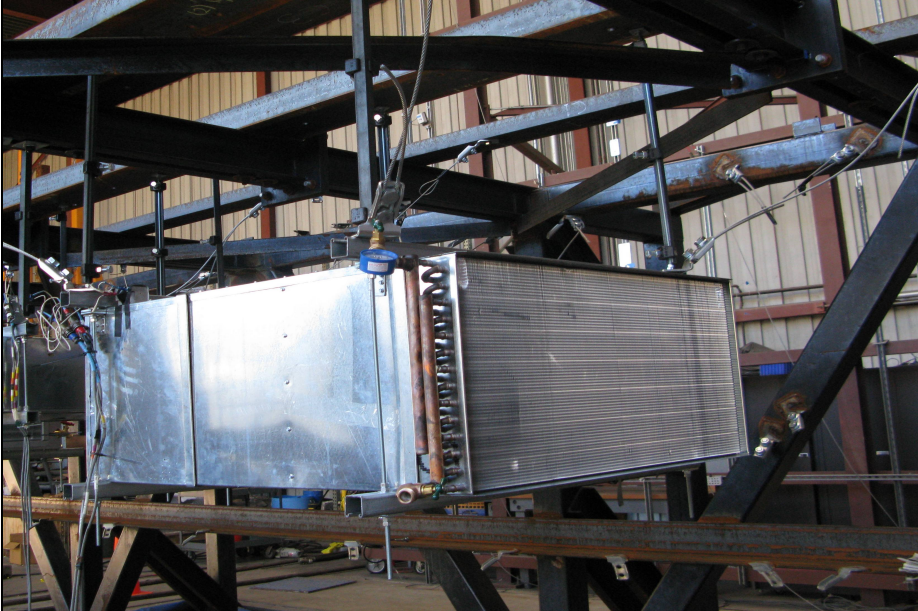

**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-50 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #2b**

**Manufacturer:** Tuttle & Bailey

**Model Series:** TFS Unit B Size 6"

**Cabinet Construction Summary:**

Base: 20 Gauge galvanized carbon steel  
 Walls: 20 Gauge galvanized carbon steel  
 Roof: 20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (1" Liner)	43"	37"	16"	215 lbs	na	na	na
Coil (Hydronic)							
Control (Digital)							
Disconnect (Non Fusible, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (5.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre: PASSED  
 Post: PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

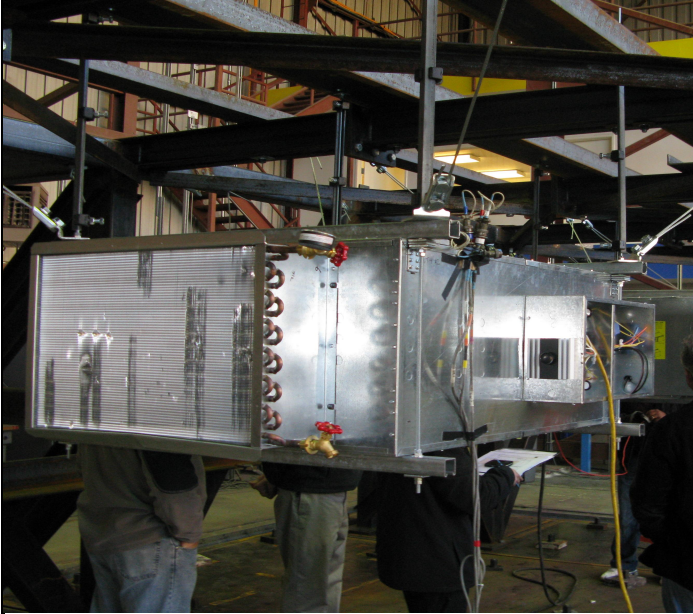

**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
 The Power of Together™

**UUT #3a**

**Manufacturer: Tuttle & Bailey**

**Model Series: TFS Unit B Size 12"**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**

Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Steriliner Liner)	43"	37"	16"	200 lbs	na	na	na
Electric Heat (4kw, 3 stage)							
Control (Pneumatic)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Transformer (AirCore Class 2)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (11.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Aflx-H(g)	Arig-H(g)	Aflx-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.



**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-70 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #3b**

**Manufacturer: Tuttle & Bailey**

**Model Series: TFS Unit B Size 12"**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Steriliner Liner)	43"	37"	16"	200 lbs	na	na	na
Electric Heat (4kw, 3 stage)							
Control (Pneumatic)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Transformer (AirCore Class 2)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (11.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Aflx-H(g)	Arig-H(g)	Aflx-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

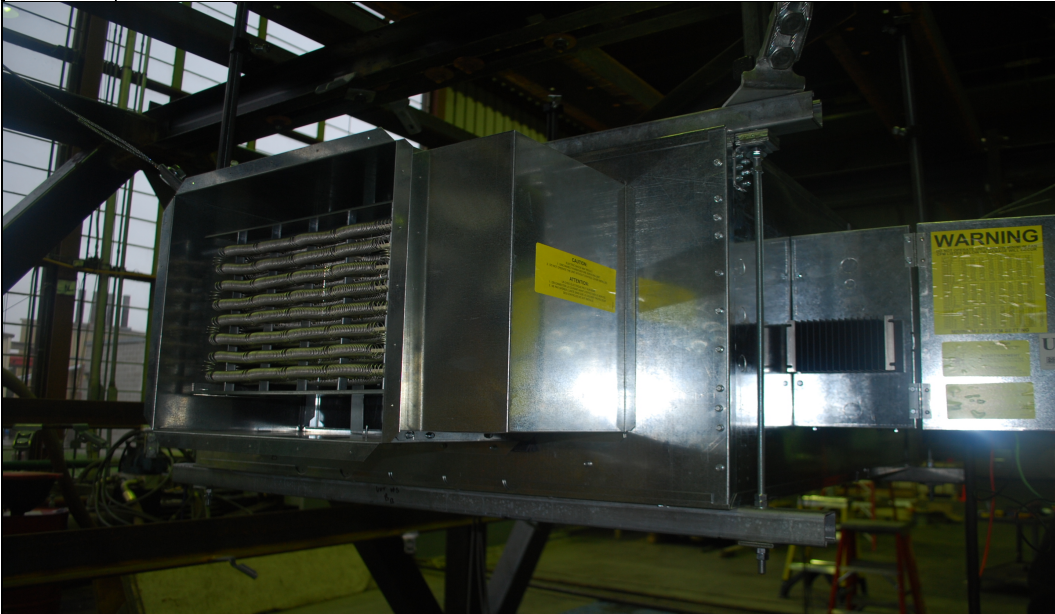

**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #4a**

**Manufacturer: Tuttle & Bailey**

**Model Series: TFS Unit E Size 12"**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (EcoShield 1/2" Liner)	47.5"	39"	20"	205 lbs	na	na	na
Coil (Hydronic)							
Control (Digital)							
Disconnect (Non Fusible, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (11.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

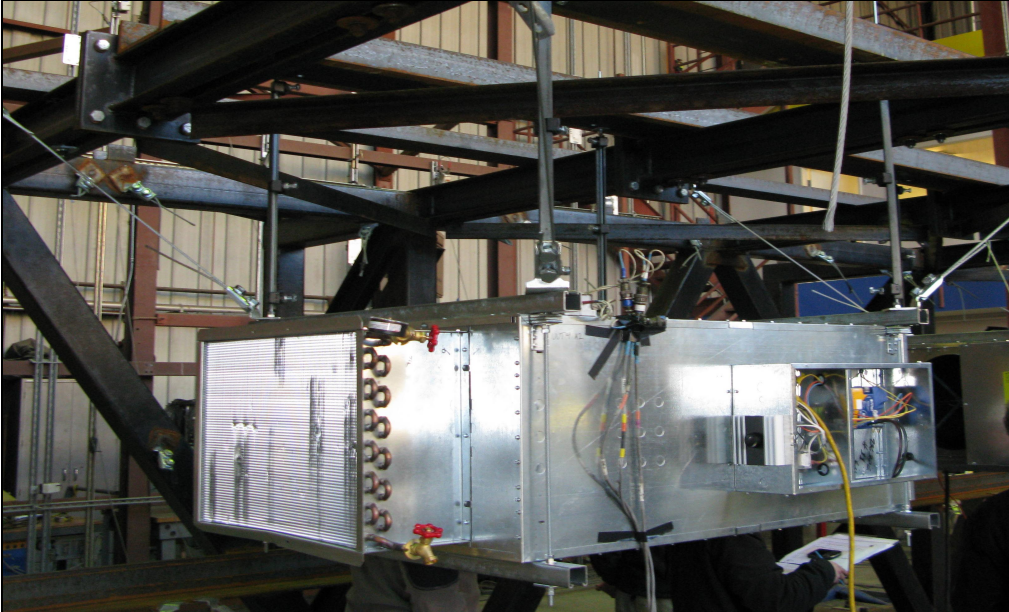

**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-85 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #4b**

**Manufacturer:** Tuttle & Bailey

**Model Series:** TFS Unit E Size 12"

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (EcoShield 1/2" Liner)	47.5"	39"	20"	205 lbs	na	na	na
Coil (Hydronic)							
Control (Digital)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (11.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

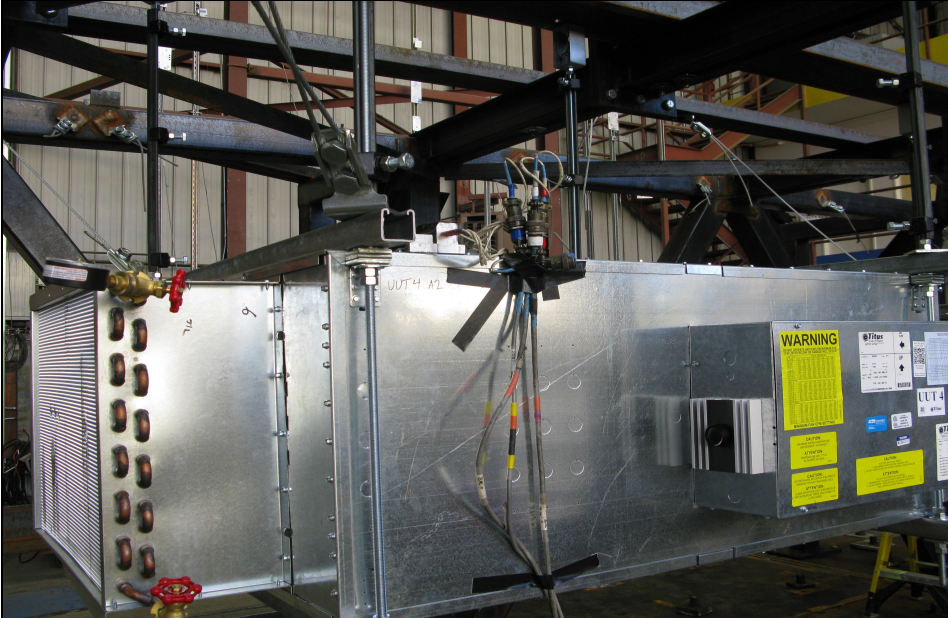

**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™



**UUT #5a**

**Manufacturer: Tuttle & Bailey**

**Model Series: TFS Unit E Size 16"**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (EcoShield 1/2" Liner)	46.75"	39"	20"	235 lbs	na	na	na
Electric Heat (11kw, 1 stage)							
Control (Digital)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Transformer (AirCore Class 2)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (11.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

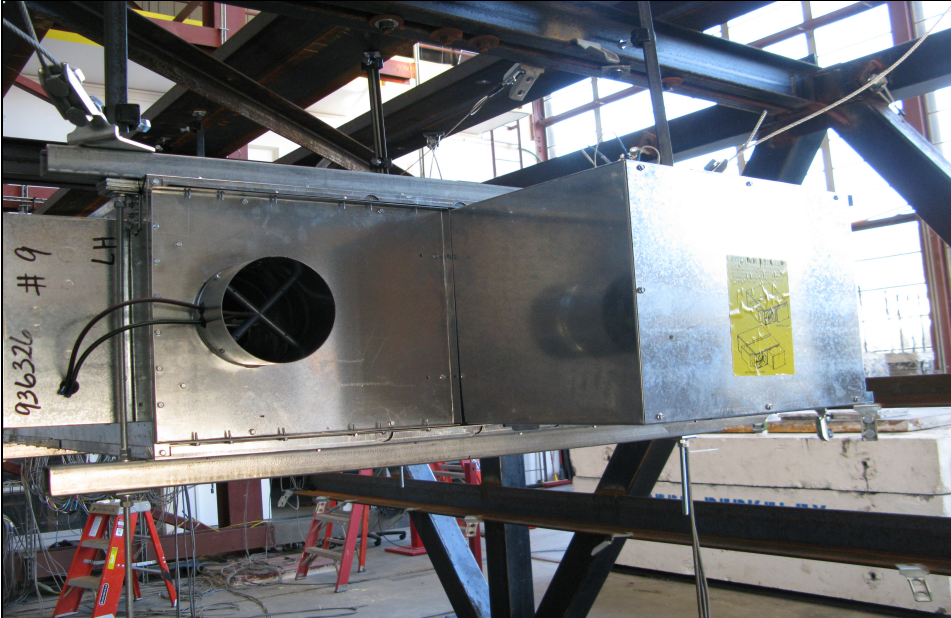

**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-85 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #5b**

**Manufacturer:** Tuttle & Bailey

**Model Series:** TFS Unit E Size 16"

**Cabinet Construction Summary:**

Base: 20 Gauge galvanized carbon steel  
 Walls: 20 Gauge galvanized carbon steel  
 Roof: 20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (EcoShield 1/2" Liner)	46.75"	39"	20"	235 lbs	na	na	na
Electric Heat (11kw, 1 stage)							
Control (Digital)							
Disconnect (Non Fusable, 3 Pole)							
Fuses (KLK, Fast Acting, Line Fuse)							
Contactors (Magnetic)							
Transformer (AirCore Class 2)							
Relays (SPST)							
Airflow Switch (Electro Pneumatic)							
Damper (11.875" dia, Galv Carbon Steel)							
Fan Speed Control (Adjustable SCR)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre: PASSED  
 Post: PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

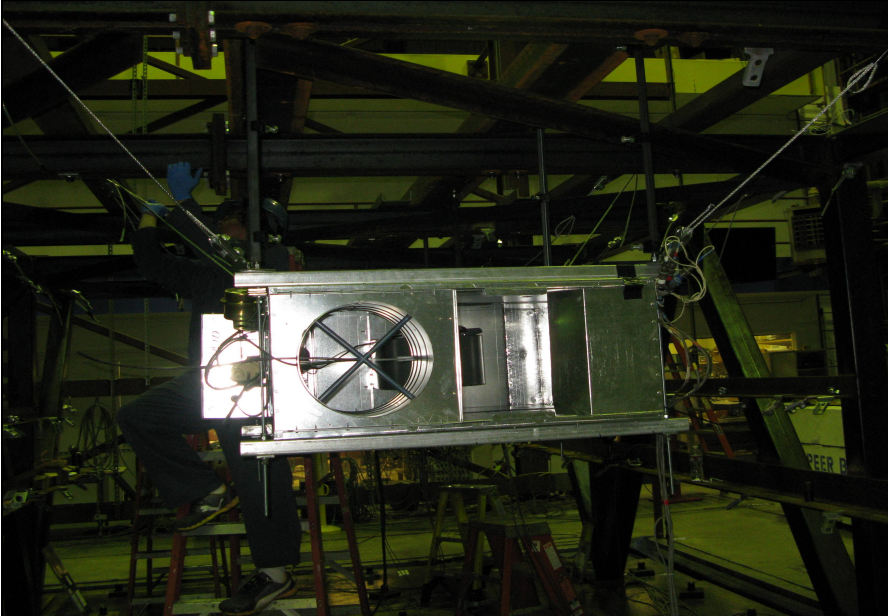

**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
 The Power of Together™

**UUT #6a**

**Manufacturer: Tuttle & Bailey**

**Model Series: SDV Size 8" (Clone of Titus ESV)**

**Cabinet Construction Summary:**

Base: 20 Gauge galvanized carbon steel  
 Walls: 20 Gauge galvanized carbon steel  
 Roof: 20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Standard 1/2" Liner)	39.5"	12"	10"	70 lbs	na	na	na
Coil (Hydronic)							
Electric Heat (7kw, 1 stage)							
Control (Pneumatic)							
Transformer (Air Core Class 2)							
Airflow Switch (Electro Pneumatic)							
Damper (7.875" dia Galv Carbon Steel)							
Inlet Sensor							
Sound Attenuator (Integral)							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Aflx-H(g)	Arig-H(g)	Aflx-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre: PASSED  
 Post: PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

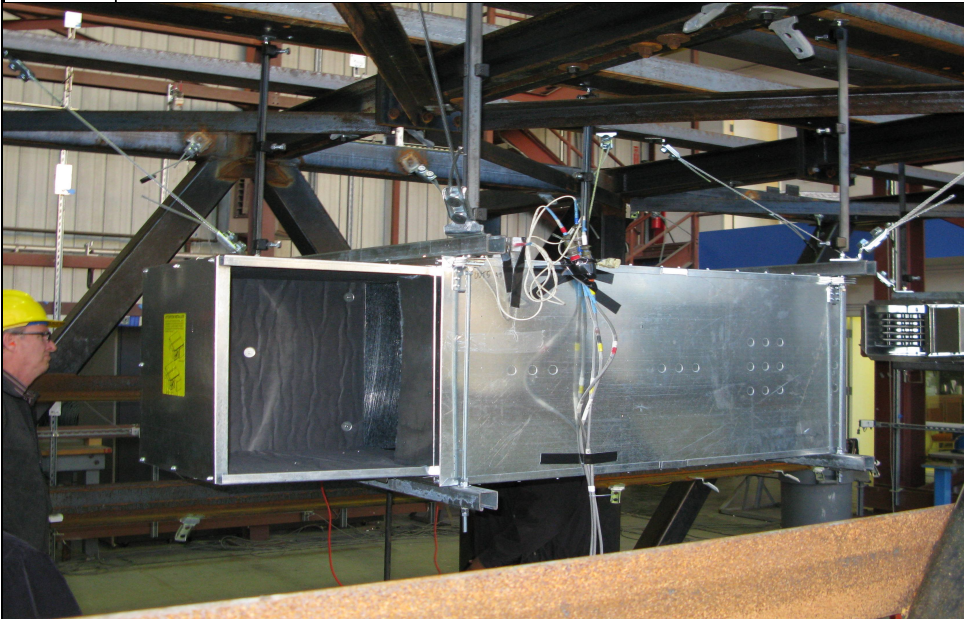

**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-20 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
 The Power of Together™

**UUT #6b**

**Manufacturer: Tuttle & Bailey**

**Model Series: SDV Size 8" (Clone of Titus ESV)**

**Cabinet Construction Summary:**

Base:	20 Gauge galvanized carbon steel
Walls:	20 Gauge galvanized carbon steel
Roof:	20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Standard 1/2" Liner)	39.5"	12"	10"	70 lbs	na	na	na
Coil (Hydronic)							
Electric Heat (7kw, 1 stage)							
Control (Pneumatic)							
Transformer (Air Core Class 2)							
Airflow Switch (Electro Pneumatic)							
Damper (7.875" dia Galv Carbon Steel)							
Inlet Sensor							
Sound Attenuator (Integral)							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre:	PASSED
Post:	PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

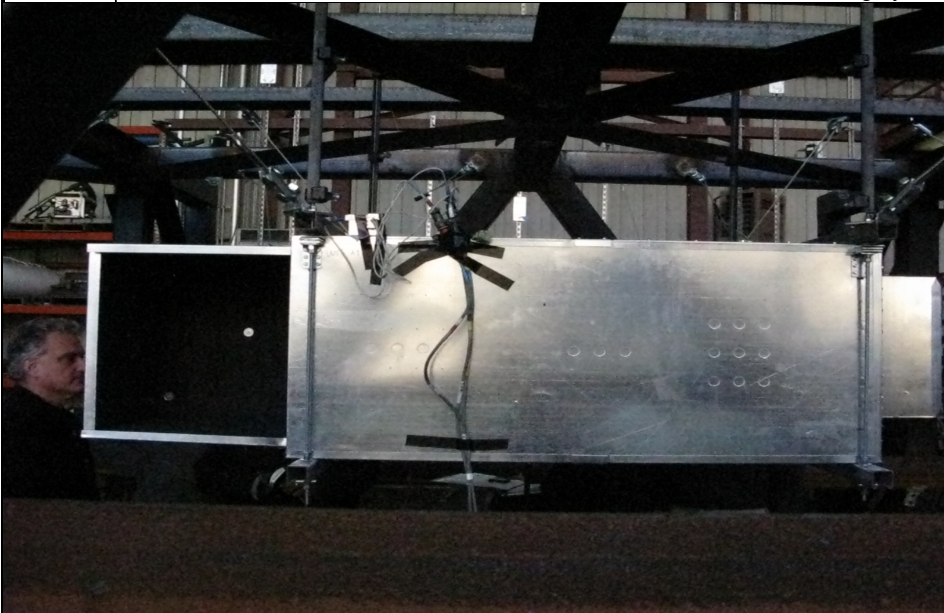

**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
The Power of Together™

**UUT #7a**

**Manufacturer: Tuttle & Bailey**

**Model Series: SDV Size 24"x16" (Clone of Titus ESV)**

**Cabinet Construction Summary:**

Base: 20 Gauge galvanized carbon steel  
 Walls: 20 Gauge galvanized carbon steel  
 Roof: 20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Sterilwall Liner)	39.5"	38"	18"	245 lbs	na	na	na
Coil (Hydronic)							
Electric Heat (35kw, 3 stage)							
Control (Digital)							
Transformer (Air Core Class 2)							
Airflow Switch (Electro Pneumatic)							
Damper (16"H x 24"W, Aluminum)							
Sound Attenuator (Integral)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Aflx-H(g)	Arig-H(g)	Aflx-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre: PASSED  
 Post: PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

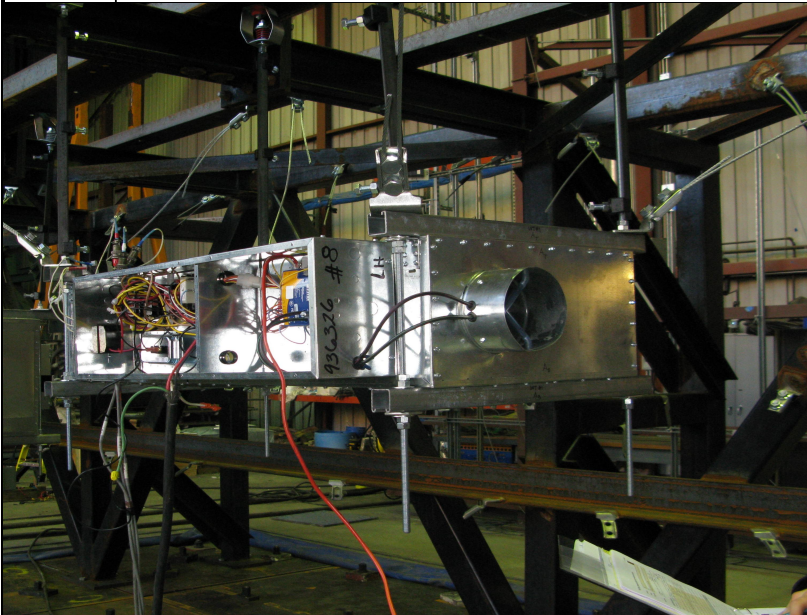

**UUT Mounting Description:**

Vibration Isolated Suspended unit on (4) 1/2" ASTM-A307 rods [30" Long], with VMC HRSA-1B-35 Vibration Isolator Hangers, (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**UUT #7b**

**Manufacturer: Tuttle & Bailey**

**Model Series: SDV Size 24"x16" (Clone of Titus ESV)**

**Cabinet Construction Summary:**

Base: 20 Gauge galvanized carbon steel  
 Walls: 20 Gauge galvanized carbon steel  
 Roof: 20 Gauge galvanized carbon steel

**Component Summary:**


Item	Dimensions				Lowest Natural Frequency		
	Length	Width	Height	Weight	F-B	S-S	V
Cabinet (Sterilwall Liner)	39.5"	38"	18"	245 lbs	na	na	na
Coil (Hydronic)							
Electric Heat (35kw, 3 stage)							
Control (Digital)							
Transformer (Air Core Class 2)							
Airflow Switch (Electro Pneumatic)							
Damper (16"H x 24"W, Aluminum)							
Sound Attenuator (Integral)							
Inlet Sensor							
Control Enclosure (NEMA 1)							

**Seismic Test Parameters:**

Qualification Method	Sds(g)	z/h	Ip	Afix-H(g)	Arig-H(g)	Afix-V(g)	Arig-V(g)
ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	1.33	0.53

**Pre/Post Shake Functionality Test Results:**

Pre: PASSED  
 Post: PASSED - All units were filled with contents and maintained structural integrity and maintained functionality.

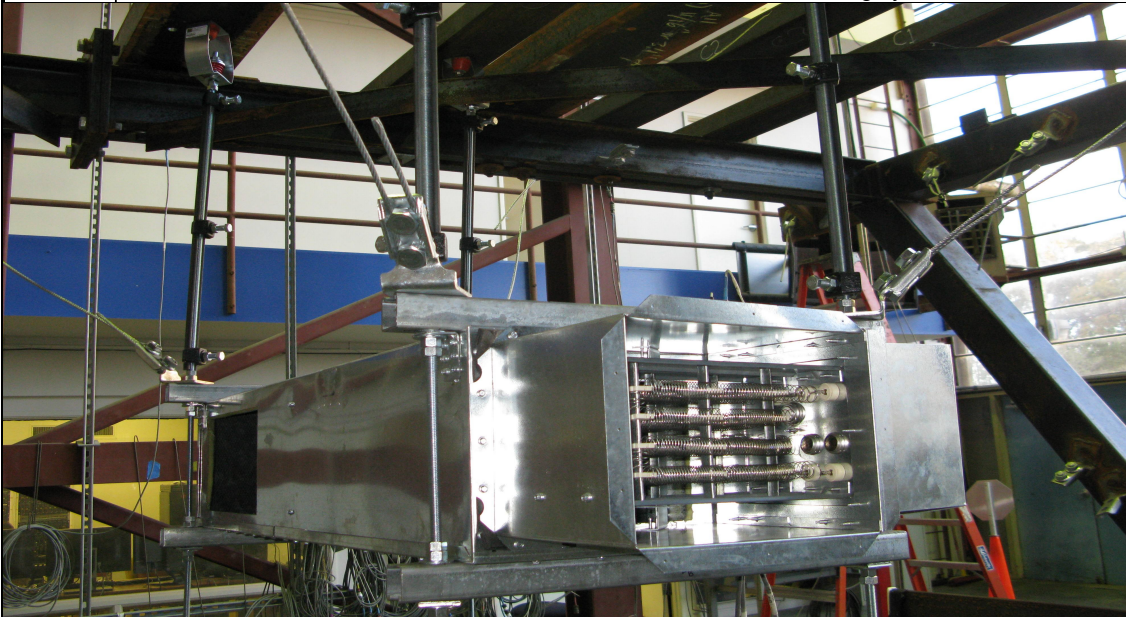

**UUT Mounting Description:**

Rigidly Suspended unit on (4) 3/8" ASTM-A307 rods [30" Long], with (4) SB-250 (1/4") Seismic Cable Kits [at 45 Degrees] and (3 per rod) SRBC-1 Rod Stiffening Clamps. SB-250's are attached to structure using 5/8" hardware. SRBC-1s are fastened to L1x1x1/4 ASTM-A36 angle [30" Long].



**THE VMC GROUP**  
 The Power of Together™