
ELECTRICAL REQUIREMENTS FOR HEALTH CARE FACILITIES

Review Guide for:
Hospitals
Nursing Facilities
Clinics

Office of Statewide Health Planning and Development
Facilities Development Division
www.oshpd.ca.gov

400 R Street, Room 200
Sacramento, CA 95811
(916) 440-8300
FAX (916) 324-9188

700 North Alameda Street, Suite 2-500
Los Angeles, CA 90012
(213) 897-0166
FAX (213) 897-0168

Forward

The Office of Statewide Health Planning and Development (OSHPD) is responsible for enforcing all building standards, codes, and regulations pertaining to health care facilities in the State.

The following document was compiled by the OSHPD electrical engineering staff as a guide for plan review to verify compliance and is intended for OSHPD use. It highlights and summarizes the most common requirements encountered in the review of health care facilities. All others who use this information for any other purpose do so with the full knowledge that it may not contain every requirement or change in policy and that the requirements are as interpreted by OSHPD.

All projects submitted on or after January 1, 2011 are subject to the 2010 California Electrical Code (CEC) which is the 2008 National Electrical Code (NEC) with the 2010 California Amendments.

Table of Contents

Plan Review Check List..... 1
Acute Care Hospital 2
Acute Psychiatric Hospital..... 31
Nursing Facility..... 32
Clinics..... 44
Appendix A..... 45
Appendix B..... 46
Index..... 51

Plan Review Check List The following may be used as a guide for triage to check that submitted plans are complete and reviewable by OSHPD.	
Item	Description
1	All electrical plans and specifications signed by the electrical engineer of record.
2	List of symbols and abbreviations used on plans and their meaning.
3	Correct electrical code version cited.
4	Room names and numbers on all plan sheets.
5	Single line diagram of the electrical system showing normal source and segregation of the essential electrical system. Clearly identify components as normal, critical, life safety, or equipment.
6	Site plan showing service entrance, distribution system, service transformer, and generator location.
7	Drawings showing details of all switchboards, panels, and equipment.
8	Load calculations or other approved methods showing verification of load capacity for all equipment and conductors. Show effect on both normal and emergency system.
9	Panel schedules with totalized, tabulated loads. Panel schedules shall indicate rating of panel, feeder conductor, feeder overcurrent protective device, branch/system (critical, life safety, equipment) and loads served.
10	Schedules of ratings of equipment requiring electrical connection.
11	Schedule showing all feeders phase and ground conductors, conduit sizes, estimated lengths, and overcurrent protective devices.
12	Location and power source for all wiring devices, including receptacles, lights, switches, junction boxes, power outlets, and telephone outlets.
13	Fire alarm system. Provide specifications for equipment, show location of all devices, and show connection to life safety power source. Indicate if power limited.
14	Nurse call system. Provide specifications for equipment, show location of all devices, and show connection to power source. Indicate if power limited.
15	All equipment must be listed, labeled, or certified by a Nationally Recognized Testing Laboratory including X-ray and diagnostic equipment.

Acute Care Hospital			
ELECTRICAL SYSTEM		System Segregation Service Equipment Electrical and Mechanical Rooms	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety Critical Equipment	Essential electrical system shall comprise of the equipment system which contains the equipment branches and the emergency system which contains the life safety branches and critical branches.	CEC 517.30(B)
2	Life Safety Critical Equipment	Minimum of three (3) transfer switches are required, at least one (1) for each branch. [One (1) transfer switch allowed for maximum demand on essential electrical system of #150kVA]	CEC 517.30(B)(4) Refer to pages 49 and 50
3	Life Safety Critical	Branch wiring shall be independent of all other wiring and equipment except in transfer switches, exit signs, two source emergency lighting.	CEC 517.30(C)(1) CEC 700.9(B)
4		Essential services may originate or pass through existing facilities provided they are seismically conforming facilities.	CEC 517.4 CBC 1224.4.1
5		Load capacity verification required for all modifications to existing systems. [See PIN 38]	CEC 220.87
6	Critical	At least one receptacle and minimal lighting in electrical and mechanical rooms.	CEC 517.33(A)(8)n
7	Normal	Ground fault protection required on service main 1000 ampere or greater for LG voltage > 150V. Ground fault protection required on feeders if supplied on main. This includes upgrades of existing facilities.	CEC 230.95 and 517.17
8	Life Safety	No other function other than those listed in this Code section are allowed to be connected to the life safety branch of the emergency system.	CEC 517.32

Acute Care Hospital			
EMERGENCY POWER		Generator Fuel Supply Alarms Transfer Switches	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Alternate source of power shall be a generator	CEC 517.35(B)
2	Life Safety	Task illumination battery charger at generator set	CEC 517.32(E)
3	Life Safety	Selected receptacles at generator set and transfer switch locations	CEC 517.32(E)
4	Life Safety Critical	Automatic restoration of power within 10 seconds	CEC 517.31 and 700.12
5		Battery and charger for automatic starting	CEC 700.12(B)(4)
6		On site fuel supply for at least 24 hours of operation at full demand. For NPC-5 at least 72 hours.	CEC 700.12(B)(2) Ex.1
7	Equipment	Means for automatically transferring from one fuel supply to another when using dual supply. Fuel transfer pump shall be on emergency.	CEC 700.12(B)(2) and (3)
8		Audible and visual alarms to indicate generator running, water temperature, oil pressure, 3-hour fuel, charger status.	CEC 700.7 NFPA 99, 4.4.1.1.17
9		Automatic transfer switches require bypass and isolation capability.	CEC 517.30(B)(7)
10		Separately derived grounding systems require four (4) pole transfer switches.	CEC 250.20(D) and 250.30
11		Overcurrent protection	CEC 445.12
12		Separate generator room	CBC 432.2.3

- Continued on next page -

Acute Care Hospital			
EMERGENCY POWER		Generator Fuel Supply Alarms Transfer Switches	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
13		Remote engine shut-off for 7.5kW (10HP) or more.	NFPA 37, 9.2.1 NFPA 110, 5.6.5.6
14	Life Safety	Generator set accessories	CEC 517.32(F)

Acute Care Hospital			
CONDUIT & WIRING		Materials Installation	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Non-metallic rigid and non-metallic tubing are not permitted for use in patient care areas of health care facilities.	CEC 352.12 and CEC 517.13(A)
2		<p>Listed flexible metal conduit (FMC) is permitted for use in patient care areas with all of the following conditions:</p> <ul style="list-style-type: none"> • installed with a green insulated copper ground conductor required by CEC 517.13 • the total length in any ground return path is less than six feet • the conduit is terminated in fittings approved for grounding • the circuit overcurrent protective device is 20A or less • the conduit is not installed for flexibility 	CEC 517.13(A)
3		Non-metallic sheathed cable (i.e. NM, NMC, Romex) is not permitted for use in patient areas, emergency system wiring or structures of Types I and II construction.	CEC 517.13 CEC 334.10 CEC 517.30(C)(3)
4		Flat conductor cable (FCC) is not permitted for use in health care facilities.	CEC 324.12(4)

— Continued on next page —

Acute Care Hospital			
CONDUIT & WIRING [Continued]		Materials Installation	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
5		Low voltage cables for fire alarm, nurse call, communications systems, etc. installed without the use of conduit is permitted if power supplies are "power limited" type and conductor is listed for such use.	CEC 725, 760 and 800
6		All emergency system wiring shall be installed in non-flexible metallic raceway. [Schedule 40 PVC conduit is allowed for underground emergency system wiring inside or outside the building envelope, provided it is concrete encased. Schedule 80 PVC conduit is allowed without concrete encasement. Neither are allowed for branch circuits serving patient care areas.]	CEC 517.30(C)(3)
7		Separation of 24 inches (horizontal distance) for outlet boxes in fire rated wall and partitions.	CBC 712.3.2
8		Listed flexible metal raceways and listed metal sheathed cable assemblies are permitted in any of the following: <ul style="list-style-type: none"> a. Where used in listed prefabricated medical headwalls b. In listed office furnishings c. Where fished into existing walls or ceilings, not otherwise accessible and not subject to physical damage d. Where necessary for flexible connection to equipment 	CEC 517.30(C)(3)(3)

Acute Care Hospital			
MISCELLANEOUS		Identification Wiring Devices Lighting	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety Critical	All receptacles connected to the emergency system and all light switches controlling emergency lighting shall be identified in a conspicuous and permanent manner such as with red colored plates and/or red colored devices.	CEC 517.30(E)
2	Critical	All receptacles in critical care patient areas shall be marked with panel and circuit number supplying them.	CEC 517.19(A)
3		Identify all boxes and enclosures for emergency	CEC 700.9(A)
4		All rooms and passage ways shall have artificial lighting with levels per the Illuminating Engineers Society of North America (IESNA) Lighting Handbook. [See PIN 13]	CEC 517.22(A) and (B)
5		Lamps shall be considered protected against accidental breakage if provided as follows: <ul style="list-style-type: none"> • with an enclosing lens or diffuser • with louvers having a maximum cell size of 64 square inches • open bottom luminaires limited to 64 square inch opening • wire guards or plastic tube guards in service areas such as electrical, equipment, & janitor 	CEC 517.22(C)

Acute Care Hospital			
MISCELLANEOUS		Fire Pumps Mobile Medical Facilities	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Separate System	Fire pumps shall comply with all of the requirements of NFPA 20 and CEC 695. [Key points are separate service to the pump or power supply tapped ahead of the main building over current device; integrated controller, motor, and pump; separate transfer switch; short circuit calculations required; overload protection sized for locked rotor amps.]	NFPA 20 CEC 230.82(5) CEC 230.90(A) Ex. 4 CEC 695
2		Feeder and disconnect for mobile medical facilities	CEC 517.24

Acute Care Hospital			
GROUNDING BONDING		Receptacles Panelboard Patient Areas Anesthetizing Areas Wet Locations	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Receptacles in patient areas shall be provided with a green insulated copper grounding conductor	CEC 517.13(B)
2		Fixed equipment in patient area	CEC 517.13(B)
3		Branch circuits, provide redundant ground path	CEC 517.13(B)
4		Panelboard bonding and grounding	CEC 517.14 and 19(D)
5		General care patient area receptacles Critical care patient area receptacles	CEC 517.18(B) and (C) CEC 517.19(B)
6		Anesthetizing area grounding	CEC 517.62
7		Generator grounding	CEC 250.20(D) and 30
8		GFCI for receptacles and fixed equipment in wet locations	CEC 517.20(A)
9		GFCI for receptacles in bathrooms, kitchens and on roofs, and outdoors in public spaces, and where required for servicing HVAC equipment.	CEC 210.8(B)
10		Therapeutic pools and tubs	CEC 680 Part VI
11		Light switches in vicinity of shower stalls and bathtubs	CEC 404.4 Switches
12		Receptacles in vicinity of shower stalls and bathtubs	CEC 406.8(C) Receptacles
13		Isolated power systems	CEC 517.19(F) and CEC 517.20(B)

- Continued on next page -

Acute Care Hospital			
EMERGENCY POWER		<p style="text-align: center;">Receptacles Panelboard Patient Areas Anesthetizing Areas Wet Locations</p>	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
14		Special purpose receptacles in critical care areas	CEC 517.19(G)
15		X-Ray equipment grounding	CEC 517.78
16		For multi-wire branch circuits: provide handle-tie to disconnect all circuit breakers serving the multi-wire branch circuit or provide dedicated neutrals for each circuit	CEC 210.4(B)

Acute Care Hospital			
MECHANICAL EQUIPMENT		HVAC Sump Pumps Central Suction (medical) Chiller Rooms Mechanical Rooms	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Equipment	HVAC - heating and cooling required by the California Mechanical Code (CMC)	CEC 517.34(B)(1.1) CMC Section 316.0
2	Equipment	HVAC - supply and exhaust fans required for positive or negative pressure	CMC 316.4 CEC 517.34(A)(6)
3	Equipment or Critical	Delayed automatic connection for medical and surgical central suction including controls	CEC 517.34(A)(1)
4	Equipment	Delayed automatic connection for sump pumps and other equipment required to operate for the safety of major apparatus including associated controls and alarms	CEC 517.34(A)(2)
5	Equipment	Delayed automatic connection for medical and surgical compressed air systems including controls	CEC 517.34(A)(3)
6	Critical	At least one receptacle and minimal lighting in mechanical rooms	CEC 517.33(A)(8)n
7		Single switch for chiller rooms to shutdown system located immediately outside room. [If equipment is on emergency power the shutdown controls should be on the same system]	CMC 1109.4 CFC 606.9
8		Lighting fixture and switch at or near equipment requiring servicing installed under floor or attic spaces.	CEC 210.70(C)
9		Service receptacle located within 25 feet of all HVAC equipment	CMC 309.0 CEC 210.63
10	Life Safety	Refrigerant leak detection for chiller rooms.	CFC 606.8

Acute Care Hospital			
ELEVATORS		Elevators	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety	Cab lighting, control, communications, and signal systems	CEC 517.32(G)
2	Life Safety	Separate branch circuit for car (cab) lights, receptacles, auxiliary power, lighting source, and ventilation for each elevator car. Overcurrent device located in elevator machinery room.	CEC 620.22(A)
3		Dedicated branch circuit for HVAC equipment. Overcurrent device located elevator machinery room.	CEC 620.22(B)
4	Normal or Equipment	Pit Lighting	CEC 620.24
5	Critical	Machinery Room Lighting	CEC 517.33(A)(8)n CEC 620.23
6	Equipment	Automatic or manual connection for at least one elevator	CEC 517.34(B)(2)
7		Overcurrent protection of control wiring: #18 not over 7 amps, #16 not over 10amps Motor duty classified as intermittent	CEC 620 Part VII CEC 725.23 CEC 430.33
8		Receptacle required in pits	CEC 620.24(C)
9	Critical	Receptacle required in machinery rooms	CEC 620.23(C) CEC 517.33(A)(8)n
10		Disconnecting devices for all power sources	CEC 620 Part VI

Acute Care Hospital			
COMMUNICATIONS AND SIGNAL SYSTEMS		Nurse Call Fire Alarm Medical Gas Cable TV Emergency Communications	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	On branch as required	Low voltage cables for fire alarm, nurse call, communications systems, etc. installed without the use of conduit is permitted if power supplies are "power limited" type and conductor is listed for such use.	CEC 725, 760, and 800
2	Critical	Nurse call power on emergency	CEC 517.33(A)(5)
3	Life Safety	Fire alarm power on emergency [This includes control panel, automatic fire and smoke detection devices, electric water flow devices.]	CEC 517.32(C)(1)
4	Life Safety	Medical Gas alarm power	CEC 517.32(C)(2)
5	Life Safety	Communication systems used for issuing instruction during emergency conditions	CEC 517.32(D)

Acute Care Hospital			
NON-PATIENT AREA		Corridors Exits Entrances	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety	Emergency power for egress illumination Minimum of 1 foot candle	CEC 517.32(A) CBC 1006.2
2	Life Safety	Switch control for emergency egress illumination	CEC 700.20 CEC 517.32(A)
3	Life Safety	Exit signs [Batteries are not an acceptable source of alternate power]	CEC 517.32(B) CBC 1011.2 and 1011.4
4	Equipment	Automatically operated doors	CEC 517.34(B)(5)
5	Life Safety	Automatically operated doors used for building egress	CEC 517.32(H)

Acute Care Hospital			
NON-PATIENT AREA		Food Preparation Area Kitchen Nourishment	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)(8)m
2	Critical	At least one receptacle on emergency	CEC 517.33(A)(8)m
3		Appliances shall comply with Article 422	CEC 422

Acute Care Hospital			
NON-PATIENT AREA		Clean Utility Room Soiled Utility Room Central Supply Blood, Bone, and Tissue Banks Human Physiology Laboratory Telephone Equipment Room Information Technology Equipment Rooms	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)
2	Critical	At least one receptacle on emergency	CEC 517.33(A)
3	Equipment	Laboratory fume hoods on emergency	CEC 517.34(A)(6)

Acute Care Hospital			
NON-PATIENT AREA		Nurses Station Medication Preparation Area Pharmacy	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)
2	Critical	At least one receptacle on emergency	CEC 517.33(A)
3	Critical	Nurse call system annunciation or master station	CEC 517.33(A)(5) and 123

Acute Care Hospital			
GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Patient Bedroom Isolation Room Pediatric Locations	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Normal & Critical or two Critical	Two (2) separate branch circuits per bed. Two (2) duplex hospital grade receptacles per bed.	CEC 517.18(A) and (B)
2		Tamper resistant receptacles in pediatric locations	CEC 517.18(C)
3	Critical	Patient nurse call station at each bed location	CEC 517.123(A)(1) CEC 517.33(A)(5)
4	Critical	Patient nurse call station at each toilet, bath, and shower room. Cords shall be within 12" of the floor.	CEC 517.123(A)(2) CEC 517.33(A)(5)
5	Equipment	HVAC	CEC 517.34(B)(1.1)
6		Artificial lighting levels per the IESNA Lighting Handbook	CEC 517.22(A) and (B) CEC 517.33(A)(8)a.1
7	Critical	Task illumination on emergency	CEC 517.33(A)(8)

Acute Care Hospital			
SPECIAL PROCEDURE GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Lithotripsy	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)(8)j
2	Critical	Selected receptacles on emergency	CEC 517.33(A) (8)j
3	Critical	Staff emergency call required	CEC 517.123(B)(1)
4	Equipment	HVAC	CEC 517.34(B)(1.1)
5	Critical	Patient lift on emergency (lithotripsy)	CEC 517.33(A)(8)j
6		Provide GFI on the feeder serving wet procedure equipment. GFI on feeder not required if supplied with mobile unit. (lithotripsy)	CEC 680.62(A)
7		GFCI type receptacles (lithotripsy)	CEC 517.20(A)
8		Equipment to be listed, labeled, or certified by a Nationally Recognized Testing Laboratory	CEC 110.2

Acute Care Hospital			
RADIOLOGY GENERAL CARE PATIENT AREA NON-ANESTHETIZING		C.T. Scanner Mammography X-Ray	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Disconnecting means	CEC 517.72
2		Disconnecting means not required for portable equipment served by 120 volt receptacle rated 30A or less	CEC 517.72(C)
3		Rating of supply conductor and overcurrent protective device	CEC 517.73
4		Grounding and bonding	CEC 517.13 and 78
5		Equipment to be listed, labeled, or certified by a Nationally Recognized Testing Laboratory	CEC 110.2

Acute Care Hospital			
GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Magnetic Resonance Imaging (MRI)	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		<p>There are not any specialized electrical requirements for MRI rooms or systems. However, due to the strong magnetic fields associated with this equipment it is recommended that manufacturers' recommendations be followed.</p> <p>Below are some of the commonly encountered and OSHPD acceptable recommendations. They may differ between manufacturers.</p> <ul style="list-style-type: none"> • non-ferrous conduit and lighting fixture housings • no fluorescent fixtures in MRI room • dimmers should not be used 	

Acute Care Hospital			
GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Hemodialysis	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)(8)e
2	Critical	At least one receptacle on emergency	CEC 517.33(A)(8)e

Acute Care Hospital			
PERINATAL GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Labor Room Birth Room Alternate Birthing Center (ABC) Labor/Delivery/Recovery (LDR) Labor/Delivery/Recovery/Postpartum (LDRP)	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Normal & Critical or two Critical	Two (2) separate branch circuits per bed Two (2) duplex hospital grade receptacles per bed	CEC 517.18(A) CEC 517.18(B)
2	Critical	Patient nurse call at each bed location	CEC 517.123(A)(1)
3	Equipment	HVAC	CEC 517.34(B)(1.1)

LDR and LDRP are viewed electrically by OSHPD as patient bedrooms. The requirements for critical care recovery rooms and delivery rooms are not applicable.

Acute Care Hospital			
PERINATAL GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Nursery	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination	CEC 517.33(A)(3)a
2	Critical	At least one duplex receptacle on emergency	CEC 517.33(A)(3)a
3		One duplex receptacle shall be provided for every two bassinets	CEC 517.18(D)
4	Critical	Staff emergency call	CEC 517.123(B)(1)
5		Hospital grade receptacles	CEC 517.18(B)
6	Equipment	HVAC	CEC 517.34(B)(1.1)

Acute Care Hospital			
PERINATAL CRITICAL CARE PATIENT AREA ANESTHETIZING		Neonatal Intensive Care Unit (NICU)	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Illumination level at 100 foot candles	CEC 517.22(D)(2)
2		Dimmer or multi-level switching of lighting	CEC 517.22(D)(2)
3	Critical	Task illumination	CEC 517.33(A)(8)h
4		At least five (5) duplex hospital grade receptacles per bed	CEC 517.19(B) Ex. 1
5	Normal & Critical or two Critical	At least two (2) branch circuits per bed, one must be a dedicated emergency circuit serving only that bed location	CEC 517.19(A)
6	Critical	Staff emergency call required	CEC 517.123(B)(2)
7	Critical	Emergency Alarm System (Code Blue) at control desk in NICU	CEC 517.123(C)(2)
8	Equipment	HVAC	CEC 517.34(B)(1.1)

Acute Care Hospital			
PERINATAL CRITICAL CARE PATIENT AREA ANESTHETIZING AREA		Delivery Room [Delivery rooms must meet all of the requirements of operating rooms.]	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Battery-powered emergency lighting units.	CEC 517.63(A)
2	Critical	Task illumination	CEC 517.33(A)(1)
3	Critical	Surgical light	CEC 517.33(A)(1) CBC 1224.32.3.4
4	Critical	Selected receptacles on emergency	CEC 517.33(A)(1)
5	Critical	Hospital grade receptacles	CEC 517.61(C)(2)
6	Critical	Fixed electrical equipment on emergency	CEC 517.33(A)(1)
7	Critical	Staff emergency call required	CEC 517.123 (B)(1)
8	Critical or Battery	Standard clock with sweep second hand and elapsed timer which is direct wired or battery operated	CEC 517.33 (A)(8)I CBC 1224.32.3.3
9		Grounding and bonding	CEC 517.19 and 62
10		Wiring and equipment in non-hazardous area	CEC 517.61(C) and 63
11	Equipment	HVAC	CEC 517.34(B)(1.1)
12	Critical	Isolated power systems	CEC 517.160

Acute Care Hospital			
GENERAL CARE PATIENT AREA NON-ANESTHETIZING		Emergency Room	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)(8)f
2	Critical	At least one receptacle on emergency	CEC 517.33(A)(8)f
3	Equipment	HVAC	CEC 517.34(B)(1.1)

Acute Care Hospital			
CRITICAL CARE PATIENT AREA NON-ANESTHETIZING		Recovery Room	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)(8)i
2		At least three (3) duplex or six (6) single hospital grade receptacles per bed	CEC 517.19(B)
3	Normal & Critical or two Critical	At least two (2) branch circuits per bed, one must be a dedicated emergency circuit serving only that bed location	CEC 517.19(A)
4	Critical	Emergency Alarm System (Code Blue)	CEC 517.123(C)(1)
5	Critical	Patient nurse call station at each toilet, bath, and shower room	CEC 517.123(A)(2)
6	Critical	Staff emergency call required	CEC 517.123(B)(2)
7	Equipment	HVAC	CEC 517.34(B)(1.1)

Acute Care Hospital			
CRITICAL CARE PATIENT AREA NON-ANESTHETIZING		Intensive Care Unit (ICU) Coronary Care Unit (CCU)	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination on emergency	CEC 517.33(A)(8)d and h
2		Dimmer or multi-level switching of individual bed area lighting	CEC 517.22(D)(3)
3		At least five (5) duplex hospital grade receptacles per bed	CEC 517.19(B) Ex. 1
4	Normal & Critical or two Critical	At least two (2) branch circuits per bed, one must be a dedicated emergency circuit serving only that bed location	CEC 517.19(A)
5	Critical	Patient nurse call at each bed location	CEC 517.123(A)(1)
6	Critical	Patient nurse call station at each toilet, bath, and shower room	CEC 517.123(A)(2)
7	Critical	Emergency Alarm System (Code Blue)	CEC 517.123(C)(1)
8	Critical	Staff emergency call required from control desk	CEC 517.123(B)(2)
9	Equipment	HVAC	CEC 517.34(B)(1.1)

Acute Care Hospital			
SPECIAL PROCEDURES CRITICAL CARE PATIENT AREA ANESTHETIZING AREA		Angioplasty Angiography Cardiac Cath Lab Cytoscopy Laser Operating Operating	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Battery-powered emergency lighting units	CEC 517.63(A)
2	Critical	Task illumination	CEC 517.33(A)(1)
3	Critical	Surgical light	CEC 517.33(A)(1)
4	Critical	Selected receptacles on emergency	CEC 517.33(A)(1)
5	Critical	Hospital grade receptacles	CEC 517.61(C)(2)
6	Critical	Fixed electrical equipment on emergency	CEC 517.33(A)(1)
7	Critical	Staff emergency call required	CEC 517.123(B)(1)
8	Critical or Battery	Standard clock required at scrub-up sinks	CEC 517.33(A)(8) CBC 1224.15.3.6
9		Grounding and bonding	CEC 517.62
10		Wiring and equipment in non-hazardous area	CEC 517.61(C) and 63
11	Equipment	HVAC	CEC 517.34(B)(1.1)
12	Critical	Isolated power systems	CEC 517.160

Acute Psychiatric Hospital [Acute psychiatric care facilities must comply with the requirements for acute care hospitals except as modified below.]			
MODIFICATIONS AND ADDITIONAL REQUIREMENTS		Receptacles in Patient Care Areas Emergency Generator Fuel Supply Nurse Call System	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Receptacles are not required in psychiatric security rooms	CEC 517.18(B) Ex. 2
2		On site fuel supply shall be sufficient for six (6) hours of operation at full demand	CEC 700.12(B)(2) Ex. 2
3	Critical	Task illumination on emergency [The task is to provide night lighting, so that psychiatric patients are not in complete darkness upon loss of normal power.]	CEC 517.33(A)(3)e
4		Nurse Call: a. Where cords are supplied they shall be detachable cords b. Patient/nurse call system not required for facilities where patients are not confined to bed.	CEC 517.123(A)(3) CEC 517.123 Ex. 2

Nursing Facility			
ELECTRICAL SYSTEM		System Segregation Service Equipment Electrical and Mechanical Rooms	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety Critical	Essential electrical system shall be comprised of two (2) separate branches, critical and life safety.	CEC 517.41(A)
2	Life Safety Critical	Minimum of two (2) transfer switches are required, at least one (1) for each branch. [One (1) transfer switch allowed for maximum demand on essential electrical system #150kVA]	CEC 517.41(B) refer to pages 47 and 48
3	Life Safety	Independent of all other wiring and equipment except in transfer switches, exit signs, two source emergency lighting.	CEC 517.41(D) CEC 700.9(B)
4		Essential services may originate or pass through existing facilities provided they comply with minimum SPC and NPC requirements.	CEC 517.4 CBC 1224.4.1
5		Load capacity verification required for all modifications to existing systems. [See PIN 38]	CEC 220.87
6	Normal	Ground fault protection required on service main 1000 ampere or greater for LG voltage > 150V. Ground fault protection required on feeders if supplied on main.	CEC 230.95 and 517.17
7	Life Safety	No other function other than those listed in this Code section are allowed to be connected to the life safety branch of the emergency system.	CEC 517.42
8	Critical	Task lighting and at least one receptacle in electrical and mechanical rooms	CEC 517.43(A)(7)

Nursing Facility			
EMERGENCY POWER		Generator Fuel Supply Alarms Transfer Switches	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Alternate source of power shall be a generator	CEC 517.44(B.1)
2	Life Safety	Task illumination at generator set	CEC 517.42(F)
3	Life Safety	Selected receptacles at generator set	CEC 517.42(F)
4		Automatic restoration of power within 10 seconds	CEC 517.42 and 700.12
5		Battery and charger for automatic starting	CEC 700.12(B)(4)
6		Onsite fuel supply for at least six (6) hours of operation at full demand	CEC 700.12(B)(2) Ex. 2
7	Critical	Means for automatically transferring from one fuel supply to another when using dual supply. Fuel transfer pump shall be on emergency.	CEC 700.12(B)(2) and (3)
8		Audible and visual alarms to indicate generator running, water temperature, oil pressure, 3-hour fuel, charger status.	CEC 700.7 NFPA 99 4.4.1.1.17
9		Separately derived grounding systems require four (4) pole transfer switches.	CEC 250.30 and 250.20(D)
10		NOTE: Automatic transfer switches do not require by pass and isolation	
11		Overcurrent protection	CEC 445.12
12		Separate generator room	CBC 432.2.3
13		Skilled nursing facilities providing life support or sub-acute care services shall have an electrical system that complies with CEC 517.30 through CEC 517.35 [CAN 3-517.40(B) pending]	CEC 517.40(B)

Nursing Facility			
CONDUIT & WIRING		Material Installation	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Non-metallic rigid and non-metallic tubing are not permitted for use in patient care areas of health care facilities.	CEC 352.12 CEC 517.13(A)
2		Listed flexible metal conduit (FMC) is permitted for use in patient care areas with all of the following conditions: <ul style="list-style-type: none"> • installed with a green insulated copper ground conductor required by CEC 517.13 • the total length in any ground return path is less than six feet • the conduit is terminated in fittings approved for grounding • the circuit overcurrent protective device is 20A or less 	CEC 517.13(A)
3		Non-metallic sheathed cable (i.e. NM, NMC, Romex) is not permitted for use in patient care areas or in structures of Types I & II construction.	CEC 517.13 CEC 334.10
4		Flat conductor cable (FCC) is not permitted for use in health care facilities.	CEC 324.12(4)
5		Low voltage cables for fire alarm, nurse call, communications systems, etc. installed without the use of conduit is permitted if power supplies are "power limited" type and conductor is listed for such use.	CEC 725, 760, 800
6		Separation of 24 inches (horizontal distance) for outlet boxes in fire rated wall and partitions.	CBC 712.3.2

Nursing Facility			
MISCELLANEOUS		Identification Wiring Devices Lighting	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety Critical	All receptacles connected to the emergency system and all light switches controlling emergency lighting shall be identified in a conspicuous and permanent manner such as with red colored plates and/or red colored devices.	CEC 517.41(E)
2		Identify all boxes and enclosures for emergency	CEC 700.9(A)
3		All rooms and passage ways shall have artificial lighting with levels per the IESNA Lighting Handbook [See PIN 13]	CEC 517.22(A) and (B)
4		Lamps shall be considered protected against accidental breakage if provided as follows: <ul style="list-style-type: none"> • with an enclosing lens or diffuser • with louvers having a maximum cell size of 64 square inches • open bottom luminaires limited to 64 square inch opening • wire guards or plastic tube guards in service areas such as electrical, equipment, & janitor 	CEC 517.22(C)

Nursing Facility			
GROUNDING BONDING		Receptacles Panelboard Patient Areas Wet Locations	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Receptacles in patient areas shall be provided with an insulated copper grounding conductor	CEC 517.13(B)
2		Fixed equipment in patient area	CEC 517.13(B)
3		Branch circuits, provide redundant ground path	CEC 517.13(B)
4		Panelboard bonding and grounding	CEC 517.14 and 19(D)
5		Generator grounding	CEC 250.20(D) and 30
6		GFCI required in wet locations	CEC 517.20(A)
7		GFCI for receptacles in bathrooms, kitchens, on roofs, and outdoor in public spaces and where required for servicing HVAC equipment	CEC 210.8(B)
8		Therapeutic pools and tubs	CEC 680 Part VI
9		Light switches in vicinity of shower stalls & bathtubs	CEC 404.4
10		Receptacles in vicinity of shower stalls & bathtubs	CEC 406.8(C)
11	Critical	Patient areas providing life support shall comply with the requirements of CEC 517.18	CEC 517.18
12		For multi-wire branch circuits: provide handle-tie to disconnect all circuit breakers serving the multi-wire branch circuit or provide dedicated neutrals for each circuit	CEC 210.4(B)

Nursing Facility			
MECHANICAL EQUIPMENT		HVAC Sump Pumps Central Suction (medical) Chiller Rooms Mechanical Rooms Electrical Rooms	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Delayed automatic or manual connection for HVAC - heating and cooling required by the California Mechanical Code (CMC)	CEC 517.43(B)(1.1) CMC Section 316.0
2	Critical	HVAC - supply and exhaust fans required for positive or negative pressure	CMC 316.4 CEC 517.43(B)(1.1)
3	Critical	Delayed automatic connection for sump pumps and other equipment required to operate for the safety of major apparatus including associated controls and alarms	CEC 517.43(A)(2)
4		Single switch for chiller rooms to shutdown system located immediately outside room	CMC 1109.4
5		Service receptacles located within 25 feet of all HVAC equipment	CMC 309.0 CEC 210.63
6		Lighting fixtures and switch at or near equipment requiring servicing installed under floor or attic spaces.	CEC 210.70(C)
7	Critical	At least one receptacle and task lighting in mechanical and electrical rooms	CEC 517.43(A)(7)

Nursing Facility			
ELEVATORS		Elevators	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety	Cab lighting, control, communications and signal systems	CEC 517.42(G)
2	Life Safety	Separate branch circuit for car (cab) lights for each elevator. Overcurrent device in elevator machinery room	CEC 620.22(A)
3	Critical	Delayed automatic or manual connection to emergency power for all elevators to allow the release of passengers	CEC 517.43(B)(2)
4		Dedicated branch circuit for HVAC equipment. Overcurrent device located in elevator machinery room.	CEC 620.22(B)
5		Overcurrent protection of control wiring: #18 not over 7 amps, #16 not over 10 amps Motor duty classified as intermittent	CEC 620 Part VII CEC 725.23 CEC 430.33
6		Receptacle required in pits	CEC 620.24(C)
7	Critical	Task lighting and receptacles required in machinery rooms	CEC 620.23(C) CEC 517.43(A)(7)
8		Disconnecting devices for all power sources	CEC 620 Part VI

Nursing Facility			
COMMUNICATIONS AND SIGNAL SYSTEMS		Nurse Call Fire Alarm Medical Gas Cable TV Emergency Communications	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	On Branch as required	Low voltage cables for fire alarm, nurse call, communications systems, etc. installed without the use of conduit is permitted if power supplies are "power limited" type and conductor is listed for such use.	CEC 725, 760, and 800
2	Life Safety	Nurse call power on emergency	CEC 517.42(C)(3)
3	Life Safety	Fire alarm power on emergency [This includes control panel, automatic fire and smoke detection devices, automatic actuators under fire alarm control, electric water flow devices]	CEC 517.42(C)(1)
4	Life Safety	Medical gas alarm power	CEC 517.42(C)(2)
5	Life Safety	Communication systems used for issuing instruction during emergency conditions	CEC 517.42(D)
6	Life Safety	Nurse call system components	CEC 517.123
7		Battery powered components of wireless nurse call systems complying with the latest edition of ANSI/UL 1069, Standard for Hospital Signaling and Nurse Call Equipment	CEC 517.42(C)(3)

Nursing Facility			
PATIENT AREA		Corridors Exits Entrances Dining and Recreation Areas	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety	Emergency power for egress illumination Minimum at 1 foot candle	CEC 517.42(A) CBC 1006.2
2	Life Safety	Emergency power for egress illumination in dining and recreation areas	CEC 517.42(E)
3	Life Safety	Switch control for emergency egress illumination	CEC 700.20
4	Life Safety	Exit signs	CEC 517.42(B) CBC 1011.2 and 1011.4
5	Critical	Selected receptacles in patient room corridors so that any patient bed can be reached with a fifty foot extension cord [Not required if each bed location served by receptacles complying with CEC 517.18 (A) and (B)]	CEC 517.43(A)(6)

OSHPD

Electrical Requirements for Health Care Facilities

Nursing Facility			
NON-PATIENT AREA		Food Preparation Area Kitchen Nourishment	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		Appliances shall comply with Article 422	CEC 422

OSHPD

Electrical Requirements for Health Care Facilities

Nursing Facility			
NON-PATIENT AREA		Nurses Station Medication Preparation Area Pharmacy Dispensing Area	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Critical	Task illumination	CEC 517.43(A)(1)
2	Critical	At least one receptacle on emergency	CEC 517.43(A)(1)
3	Life Safety	Nurse call system annunciator or master station	CEC 517.42(C)(3) CEC 517.123(A)

Nursing Facility			
GENERAL CARE PATIENT AREA		Sub-Acute Care Bedroom Patient Bedroom	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1	Life Safety	Patient nurse call station at each bed location	CEC 517.123(A)(1) CEC 517.42(C)(3)
2	Life Safety	Patient nurse call station at each toilet, bath, and shower room. Cords shall be within 12" of the floor.	CEC 517.123(A)(2) CEC 517.42(C)(3)
3	Critical	HVAC	CEC 517.43(B)(1.1)
4		Artificial lighting levels per the IESNA Lighting Handbook	CEC 517.22
5	Critical Normal	Sub-acute care bed location to be supplied by both the normal and critical branches and be provided with a minimum of four receptacles.	CEC 517.18(A) CEC 517.18(B)
6	Critical	Task illumination on critical branch	CEC 517.33(A)(8)

Clinics			
		Ambulatory Surgical Clinic Hemodialysis Clinic	
NO.	BRANCH	REQUIREMENTS	APPLICABLE CODES
1		<p>Grounding in patient care areas:</p> <p>Provide a green insulated copper ground conductor to all receptacles.</p> <p>All branch circuits shall be installed in metal conduit suitable for redundant ground return path.</p>	CEC 517.13
2		Hemodialysis clinic shall have egress lighting and exit signs with at least 1½ hour battery backup.	CEC 517.45(G)
3		Surgical clinics shall have emergency power supplied by a generator with at least 4 hours of on site fuel.	CEC 517.45(D.1) CEC 700.12(B)(2) Ex. 3
4		Where electrical life support equipment is required or where critical care areas are present, surgical clinics shall comply with CEC 517.30 through 517.35.	CEC 517.45(B) CEC 517.45(C)
5		All receptacles connected to the emergency system and all light switches controlling emergency lighting shall be identified in a conspicuous and permanent manner such as with red colored plates and/or red colored devices.	CEC 517.45(E)

Appendix A


Policy Intent Notices (PINs)
Code Application Notices (CANs)
Available: www.oshpd.ca.gov

<u>File No.</u>	<u>Revision</u>	<u>Subject</u>
PIN 13	06/09/2011	Lighting System Retrofits
PIN 38	06/19/2008	Electrical Load Capacity Verification Guideline
CAN 3-517.40(B)	TBD	Electrical Life Support Equipment for Nursing Homes and Limited Care Facilities

Appendix B


Standard Details

<u>Drawing No.</u>	<u>Revision</u>	<u>Subject</u>
E-0002-01	08/22/96	Electrical System (Small Nursing Home)
E-0002-02	08/22/96	Electrical System (Large Nursing Home)
E-0003-01	08/21/96	Electrical System (Small Hospital)
E-0003-02	08/21/96	Electrical System (Large Hospital)

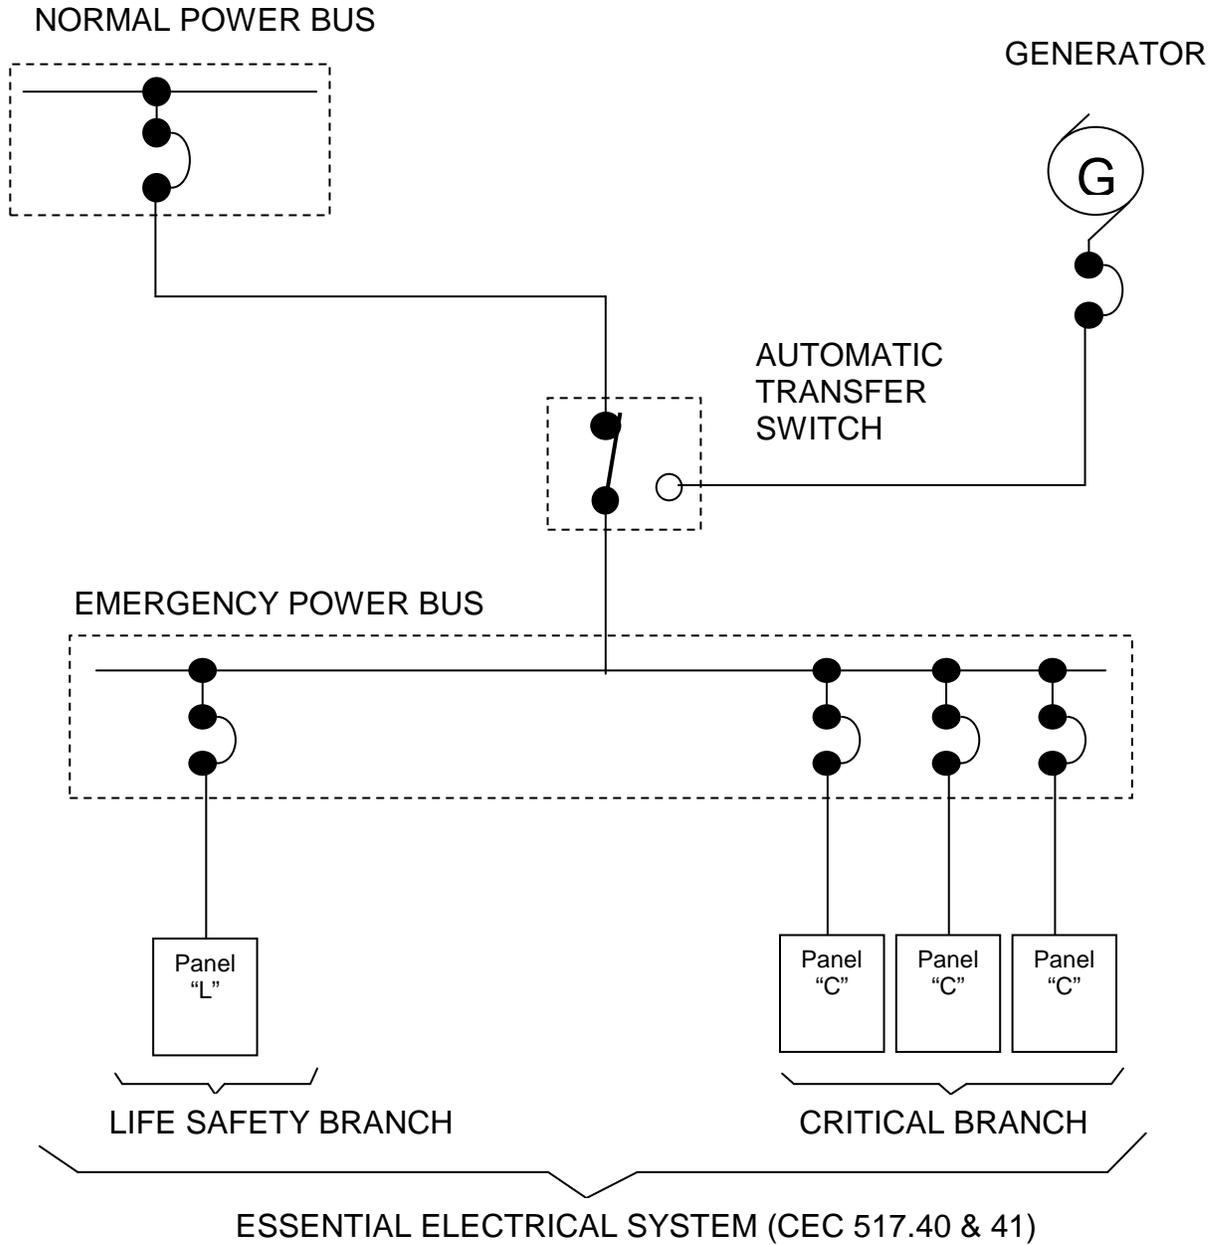


"L" LIFE SAFETY BRANCH CIRCUITS CEC 517.42
 "C" CRITICAL BRANCH CIRCUITS CEC 517.43

OSHPD STANDARD DETAILS	Description MINIMUM ELECTRICAL SYSTEM TYPICAL SMALL NURSING HOME 150 kVA MAXIMUM DEMAND ON ESSENTIAL ELECTRICAL SYSTEM	Scale NONE	Detail E0002-01
		Drawn JJG	Date 3/17/98

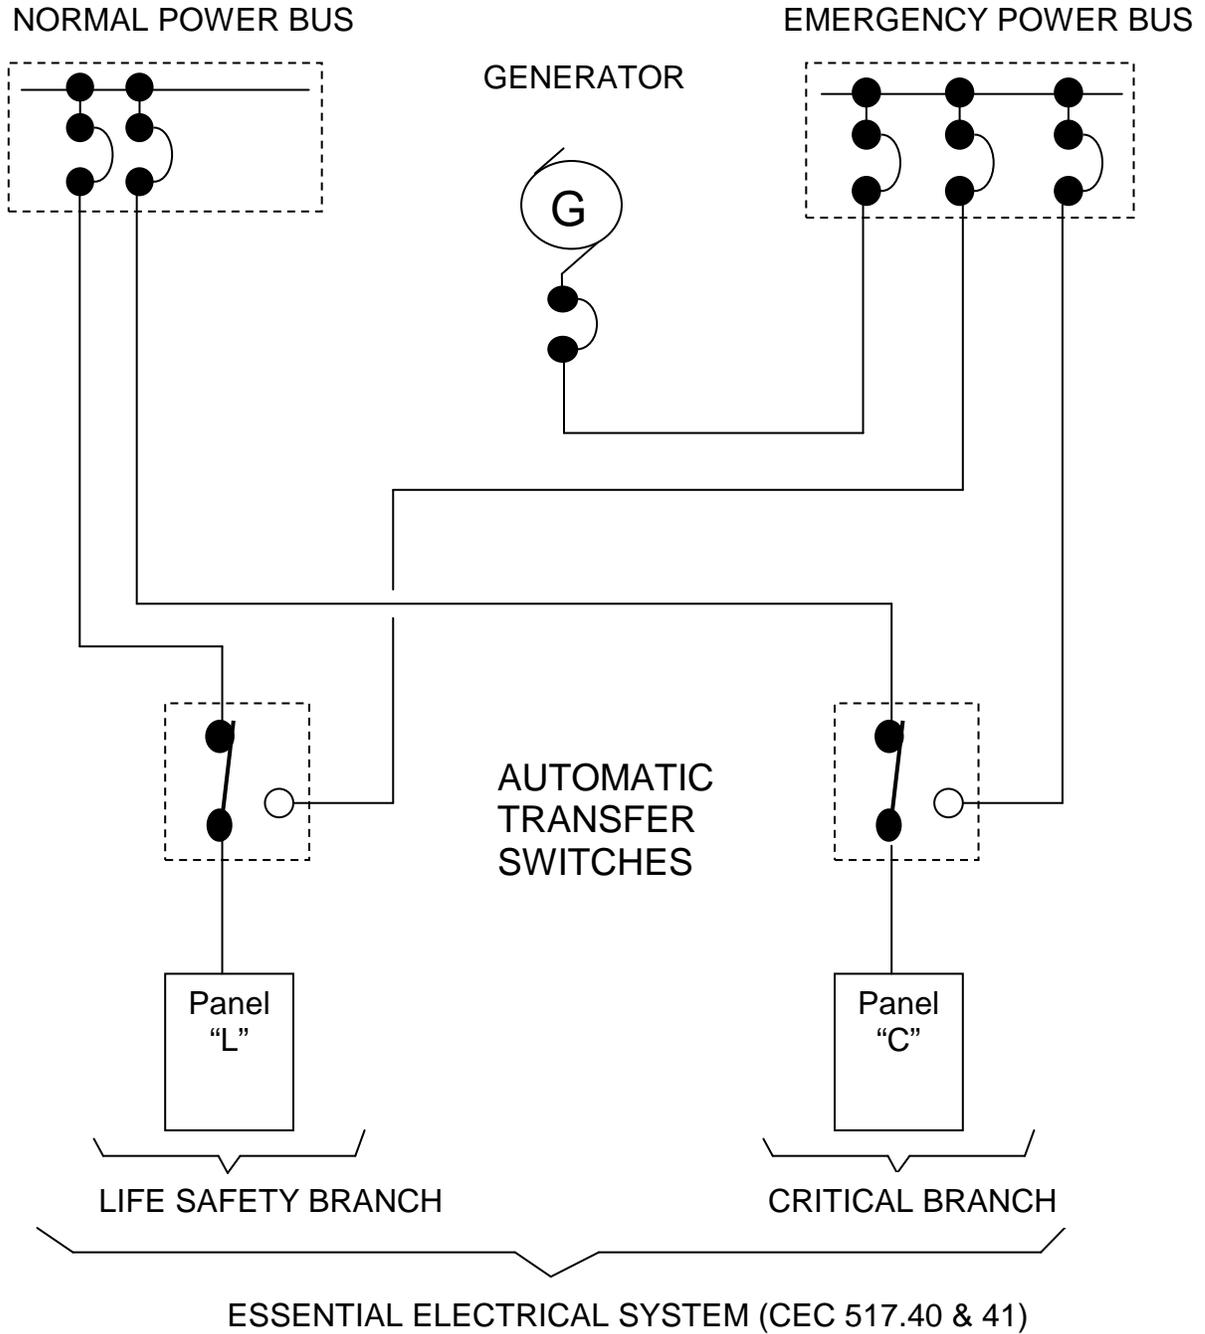


"L" LIFE SAFETY BRANCH CIRCUITS CEC 517.42
 "C" CRITICAL BRANCH CIRCUITS CEC 517.43

OSHPD STANDARD DETAILS	Description MINIMUM ELECTRICAL SYSTEM TYPICAL LARGE NURSING HOME GREATER THAN 150 kVA MAXIMUM DEMAND ON ESSENTIAL ELECTRICAL SYSTEM	Scale NONE	Detail E0002-02
		Drawn JJG	Date 8/22/96

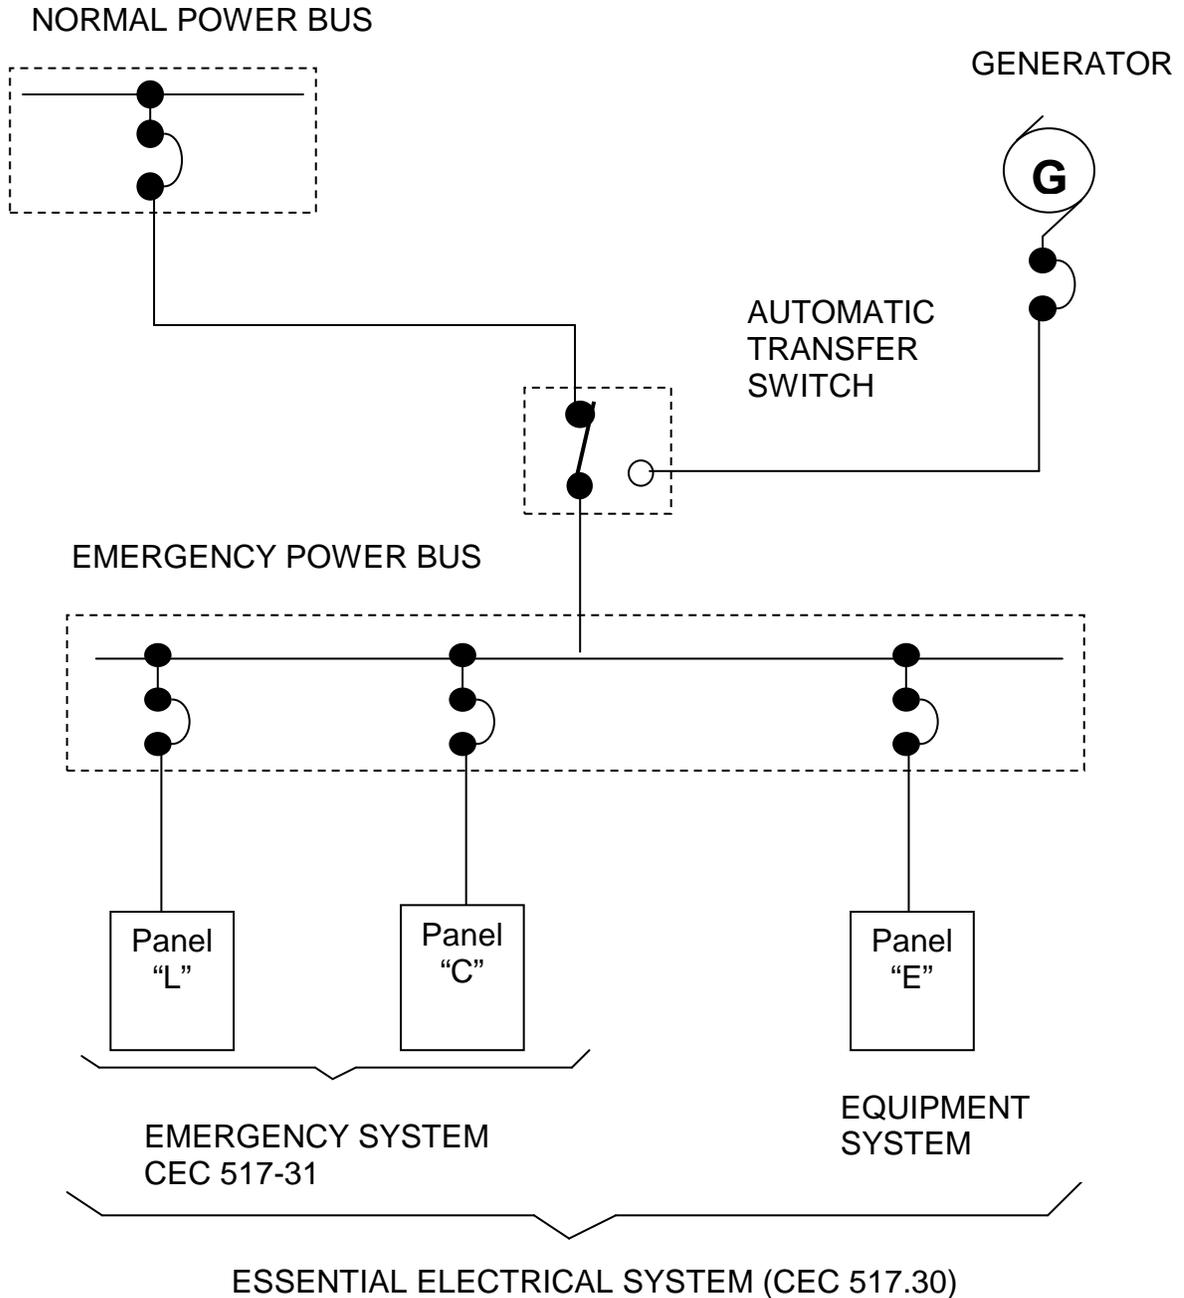

- "L" LIFE SAFETY BRANCH CIRCUITS CEC 517.32
- "C" CRITICAL BRANCH CIRCUITS CEC 517.33
- "E" EQUIPMENT BRANCH CIRCUITS CEC 517.34

OSHPD STANDARD DETAILS	Description MINIMUM ELECTRICAL SYSTEM TYPICAL SMALL HOSPITAL 150 kVA MAXIMUM DEMAND ON ESSENTIAL ELECTRICAL SYSTEM	Scale NONE	Detail E0003-01
		Drawn JJG	Date 8/21/96

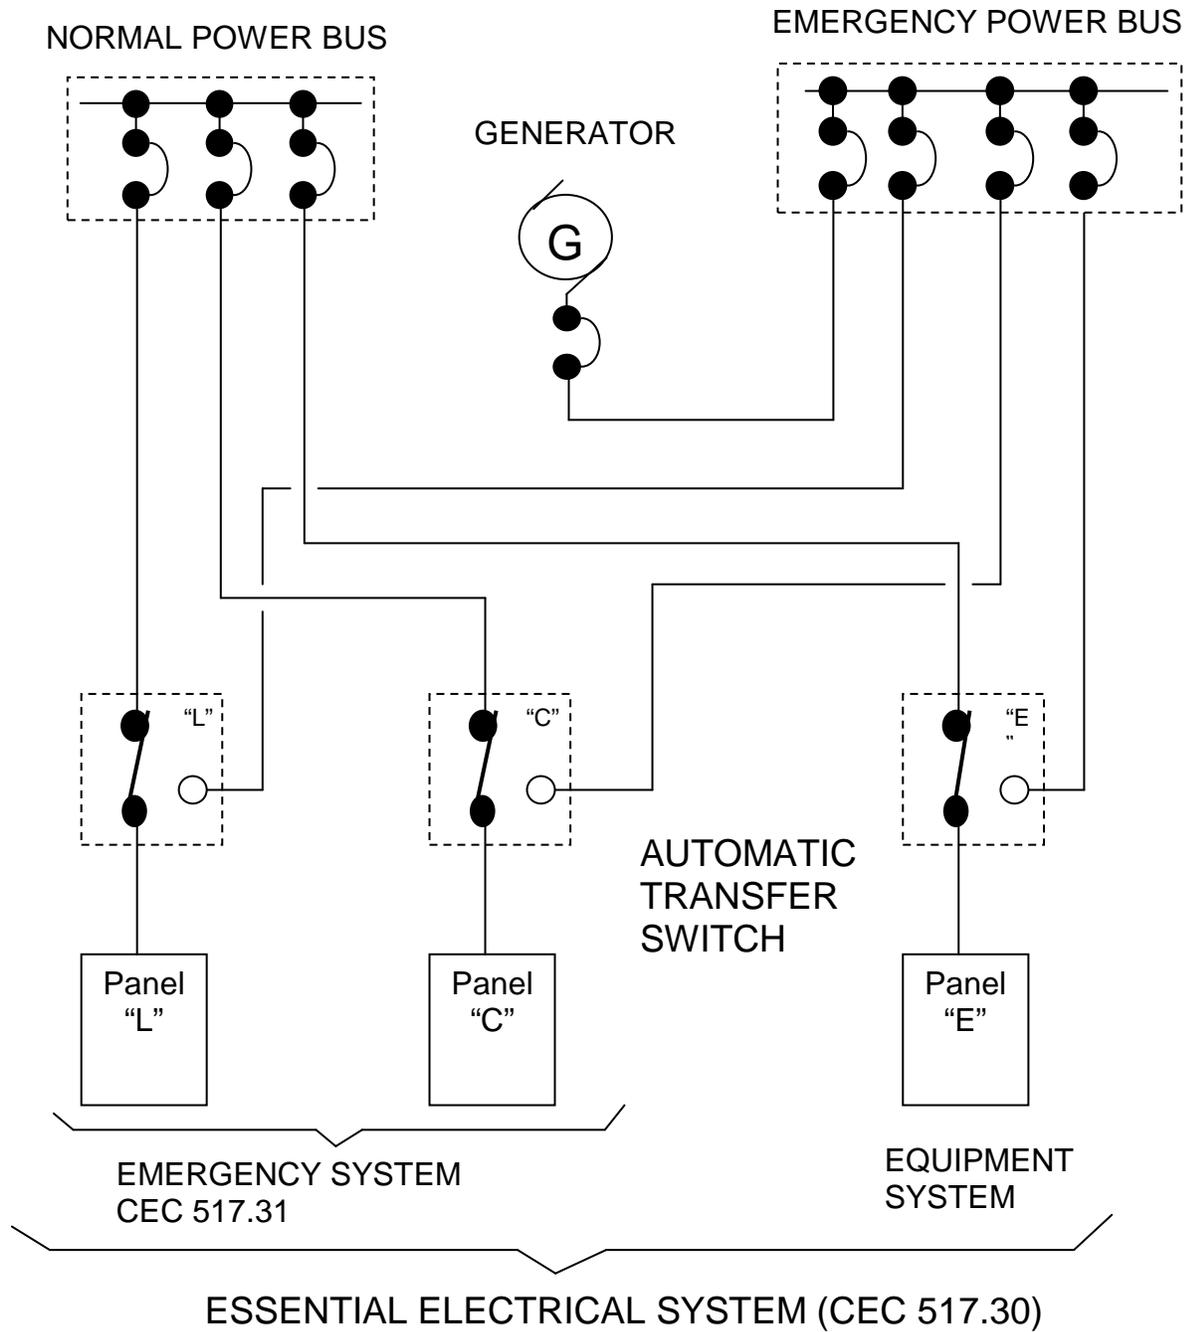

- "L" LIFE SAFETY BRANCH CIRCUITS CEC 517.32
- "C" CRITICAL BRANCH CIRCUITS CEC 517.33
- "E" EQUIPMENT BRANCH CIRCUITS CEC 517.34

OSHPD STANDARD DETAILS	Description MINIMUM ELECTRICAL SYSTEM TYPICAL LARGE HOSPITAL – GREATER THAN 150 kVA MAXIMUM DEMAND ON ESSENTIAL ELECTRICAL SYSTEM	Scale NONE	Detail E0003-02
		Drawn JJG	Date 8/21/96

Index

A

Acute Care Hospital	2–30
Acute Psychiatric Hospital	31
Alarms	3, 33, 39
Ambulatory Surgical Clinic	44
Anesthetizing Areas	9
Angiography	30
Angioplasty	30
Appendix A	45
Appendix B	46

B

Blood, Bone, and Tissue Banks	16
-------------------------------------	----

C

C.T. Scanner	20
Cable TV	13, 39
Cardiac Cath Lab	30
Central Suction	11, 37
Central Supply	16
Chiller Rooms	11, 37
Clean Utility	16
Clinics	44
Code Application Notices	45
Communications	13, 38, 39
Coronary Care Unit	29
Corridors	14, 40
Cytoscopy	30

D

Delivery Room	26
Dining	40

E

Egress Illumination	14, 40
Electrical Rooms	2, 32, 37
Elevators	12, 38

Emergency Communications	13, 39
Emergency Power	3, 11, 12, 14, 33, 38, 40, 44
Emergency Room	27
Entrances	14, 40
Exits	14, 40

F

Fire Alarm	13, 39
Fire Pumps	8
Flat Conductor Cable	5, 34
Flexible Metal Conduit	5, 34
Food Preparation Area	15, 41
Fuel Supply	3, 33

G

Generator	3, 31, 33
GFCI	9, 19, 36
GFI	19
Ground Conductor	1, 5, 34
Grounding	3, 5, 9, 20, 26, 30, 33, 34, 36, 44

H

Hemodialysis	22
Hemodialysis Clinic	44
Human Physiology Laboratory	16
HVAC ..	11, 18, 19, 23, 24, 25, 26, 27, 28, 29, 30, 37, 43

I

Identification	7, 35
IESNA	7, 18, 35, 43
Intensive Care Unit	29
Information Technology Equipment Room	16
Isolation Room	18
Isolated Power Systems	9

OSHPD

Electrical Requirements for Health Care Facilities

K

Kitchen 15, 41

L

Laser Operating 30
Life support, Nursing Facility 33, 36
Lighting 7, 12, 35
Lithotripsy 19

M

Magnetic Resonance Imaging 21
Mammography 20
Materials Installation 5, 34
Mechanical Rooms 11, 32, 37
Medical Gas 13, 39
Medication Preparation Area 17, 42
Mobile Medical Facilities 8
Multi-branch Circuits 10, 36

N

Neonatal Intensive Care Unit (NICU) 25
Non-metallic Sheathed Cable 5, 34
Nourishment 15, 41
Nurse Call . 1, 6, 13, 17, 18, 23, 28, 29, 31, 34,
39, 42, 43, 44
Nursery 24
Nurses Station 17, 42
Nursing Facility 32–43

O

Operating 26, 30
Outpatient Surgical Clinic 44
Overcurrent Protection 3, 12, 33, 38

P

Panelboard 9, 36
Patient Areas 9, 36
Patient Bedroom 18, 43

Pediatric Locations 18
Perinatal
 Alternate Birthing Center 23
 Birthing Room 23
 Labor Room 23
 Labor/Delivery/Recovery (LDR) 23
 Neonatal Intensive Care Unit 25
Pharmacy 17
Pharmacy Dispensing Area 42
Plan Review Check List 1
Policy Intent Notices 45
Postpartum 23
Power Limited 1, 6, 13, 34, 39

R

Radiology 20
Receptacles.... 1, 3, 7, 9, 11, 12, 15, 16, 17, 18,
19, 23, 24, 25, 26, 27, 28, 29, 30, 31, 33,
35, 36, 37, 38, 40, 42, 43, 44
Recovery 28
Recreation 40

S

Service Equipment 2, 32
Soiled Utility 16
Standard Details 46
Sub-acute, Nursing Facility 33, 43
Sump Pumps 11, 37
System Segregation 2, 32, 44

T

Task Illumination .. 3, 15, 16, 17, 19, 22, 24, 25,
26, 27, 28, 29, 30, 31, 33, 42, 44
Telephone Equipment Room 16
Transfer Switches 2, 3, 32, 33

W

Wet Locations 9, 36
Wiring 1, 2, 5, 6, 7, 12, 26, 30, 34, 35, 38
Wiring Devices 7, 35

OSHPD

Electrical Requirements for Health Care Facilities

X

X-Ray..... 10, 20