



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**APPLICATION FOR OSHPD PREAPPROVAL  
OF MANUFACTURER'S CERTIFICATION (OPM)**

<b>OFFICE USE ONLY</b>	
<b>APPLICATION #:</b>	<b>OPM-0089-13</b>

**OSHPD Preapproval of Manufacturer's Certification (OPM)**

**Type:**     New     Renewal     Update to Pre-CBC 2013 OPA Number: \_\_\_\_\_

**Manufacturer Information**

Manufacturer: Stryker Communication, Inc.

Manufacturer's Technical Representative: John Dascanio

Mailing Address: 1410 Lakeside Parkway, Suite 100, Flower Mound, TX 75028

Telephone: (972) 410-7189      Email: john.dascanio@stryker.com


**Product Information**

Product Name: Document Center

Product Type: Workstation

Product Model Number: N/A

General Description: Casework including base and overhead storage components

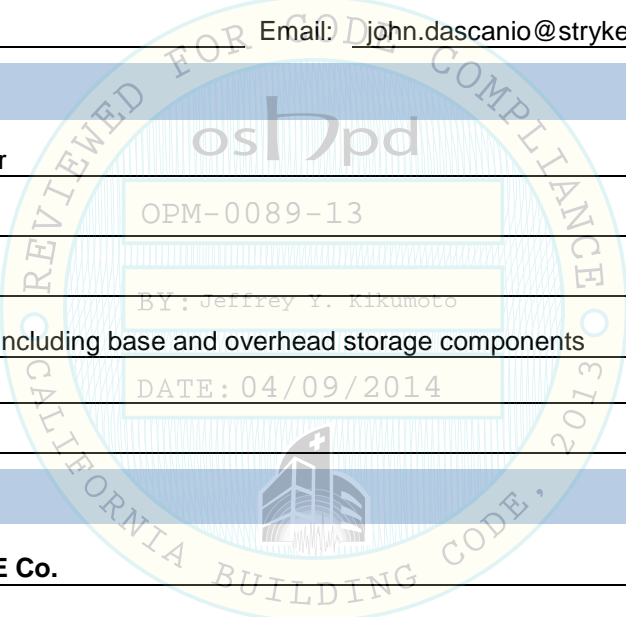

**Applicant Information**

Applicant Company Name: EASE Co.

Contact Person: Jonathan Roberson, S.E.

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709


Telephone: (909) 606-7622      Email: J.Roberson@EASECo.com

I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2013.

Signature of Applicant:       Date: 3/28/14

Title: Principal Engineer      Company Name: EASE Co.

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**Registered Design Professional Preparing Engineering Recommendations**

Company Name: EASE Co.

Name: Jonathan Roberson, S.E. California License Number: S4197

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709

Telephone: 909-606-7667 Email: J.Roberson@EASECo.com

**OSHPD Special Seismic Certification Preapproval (OSP)**

- Special Seismic Certification is preapproved under OSP- (Separate application for OSP is required)
- Special Seismic Certification is not preapproved

**Certification Method(s)**

- Testing in accordance with:  ICC-ES AC156  FM 1950-10
- Other\* (Please Specify): \_\_\_\_\_

\*Use of test criteria other than those adopted by the California Building Standards Code, 2013 (CBSC 2013) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2013 may be used when approved by OSHPD prior to testing.

- Analysis
- Experience Data
- Combination of Testing, Analysis, and/or Experience Data (Please Specify): \_\_\_\_\_

**List of Attachments Supporting the Manufacturer's Certification**

- Test Report  Drawings  Calculations  Manufacturer's Catalog
- Other(s) (Please Specify): \_\_\_\_\_

**OFFICE USE ONLY – OSHPD APPROVAL VALID FOR CBC 2013 ONLY**


Signature:  Date: April 09, 2014

Print Name: Jeffrey Y. Kikumoto

Title: Senior Structural Engineer

Condition of Approval (if applicable): \_\_\_\_\_

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**EQUIPMENT ANCHORAGE  
& SEISMIC ENGINEERING**

5877 Pine Ave, Ste. 210  
Chino Hills, CA. 91709  
Phn: (909) 606-7622

Office of Statewide Health Planning and Development  
**PREAPPROVAL OF MANUFACTURER'S CERTIFICATION**  
**OPM-0089-13**

**THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE**

MANUFACTURER: **STRYKER COMMUNICATIONS**  
EQUIPMENT NAME: **DOCUMENT STATION**

Sheet: 1 of 11  
Date: 4/7/14

GENERAL NOTES

1. THIS OSHPD PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2013 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2013 CBC
2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
3. THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE.
4. FORCES PER ASCE 7-10 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3, WHERE  $S_{ds} = 2.5$ ,  $a_p = 1.0$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h \leq 1$ .
5. THE DETAILS IN THIS PREAPPROVAL MAY BE USED AT ANY LOCATION IN THE STATE OF CALIFORNIA, WHERE  $S_{ds}$  IS NOT GREATER THAN 2.5.
6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
7. SHEET METAL SCREWS SHALL BE TEKS SCREWS BY ITW BUILDEX (ICC ESR-1976).
8. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
9. RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING
  - A. PROVIDE SUPPORTING STRUCTURE REQUIRED TO SUPPORT WEIGHTS AND FORCES SHOWN, IN ADDITION TO ALL OTHER LOADS.
  - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2013 CBC AND WITH THE DETAILS SHOWN IN THIS PREAPPROVAL. VERIFY THAT THE ACTUAL EQUIPMENT'S WEIGHT, CG LOCATION, ANCHOR LOCATIONS, ANCHOR DETAILS AND THE MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
  - C. VERIFY THAT THE COMBINATION OF  $S_{ds}$  &  $z/h$  RESULT IN SEISMIC FORCES ( $E_h$ ,  $E_v$ ) THAT ARE NOT GREATER THAN THE VALUES ON THE DETAILS.
  - D. DESIGN BACKING BARS, STUDS, ETC. WHICH THE UNITS ARE ATTACHED TO AS NOTED ON THE DRAWINGS.



## STRYKER COMMUNICATIONS

## DOCUMENT STATION

DES. **J. ROBERSON**

JOB NO. **11-1405**

DATE **4/7/14**

SHEET


**2**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BASE CABINET W/ SLIDE SHELF

CONCRETE SLAB / WALL MOUNTED

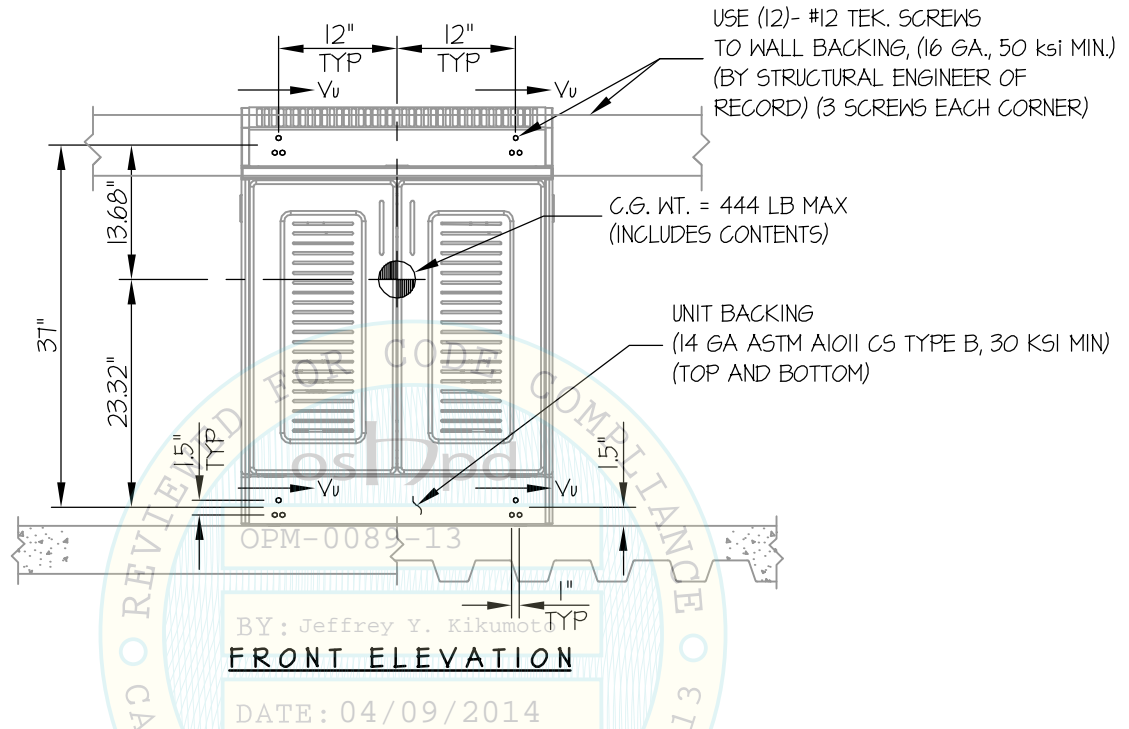

$T_u = 138 \text{ LB/BOLT (MAX)}$   
 $V_u = 84 \text{ LB/BOLT (MAX)}$

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE ( $E_h$ ) =  $1.80 W_p$  ( $S_{Ds} = 2.5, a_p = 1.0, I_p = 1.5, R_p = 2.5, z/h \leq 1$ )  
VERTICAL FORCE ( $E_v$ ) =  $0.50 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- CONTENT LOAD LIMIT:
  - 95 LB ON SLIDING SHELF
  - 87 LB ON COUNTERTOP
  - 182 LB MAX
- SEE GENERAL NOTES: SHEETS 1



### STRYKER COMMUNICATIONS

DES. J. ROBERSON

SHEET

# 3

JOB NO. 11-1405

### DOCUMENT STATION


DATE 4/7/14

OF 11 SHEETS

#### SEISMIC SUPPORTS & ATTACHMENTS

#### BASE CABINET W/ SLIDE SHELF

#### CONCRETE SLAB / WALL MOUNTED

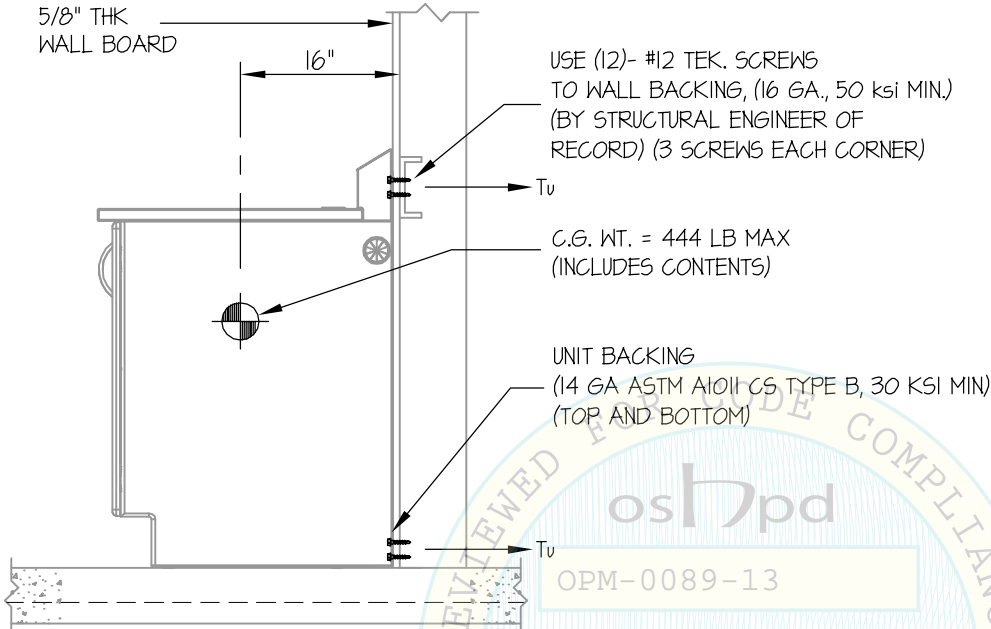


SIDE ELEVATION

USE (12)- #12 TEK. SCREWS TO WALL BACKING, (16 GA., 50 ksi MIN.) (BY STRUCTURAL ENGINEER OF RECORD) (3 SCREWS EACH CORNER)

C.G. WT. = 444 LB MAX (INCLUDES CONTENTS)


UNIT BACKING (14 GA ASTM A1011 CS TYPE B, 30 KSI MIN) (TOP AND BOTTOM)

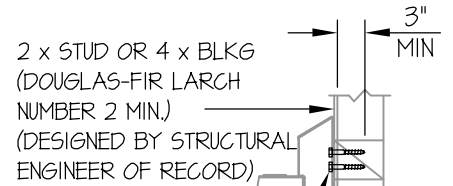

USE 3- #12 X 4" WOOD SCREWS TO WOOD STUD OR BLKG. (PRE-DRILL HOLES TO 0.70 X SHANK DIAMETER) (4 PLACES)

5/8" THK. WALL BOARD

SECTION AT WOOD STUD WALL

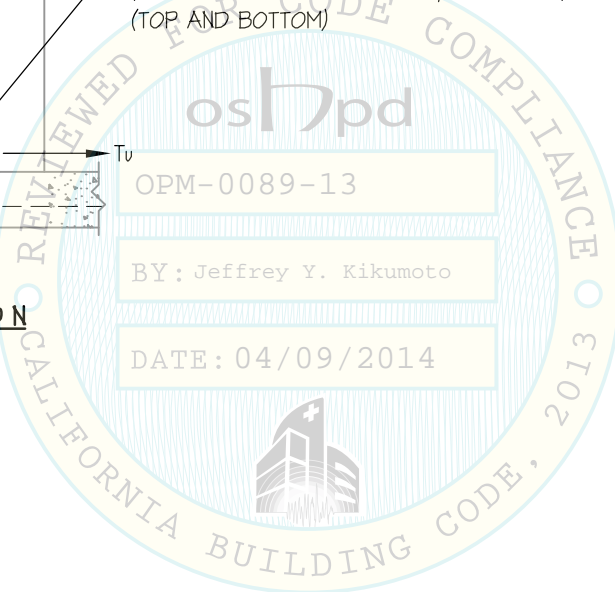



## STRYKER COMMUNICATIONS

## DOCUMENT STATION

DES. **J. ROBERSON**

JOB NO. **11-1405**

DATE **4/7/14**

SHEET


**4**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BASE CABINET W/ SHELF

CONCRETE SLAB / WALL MOUNTED

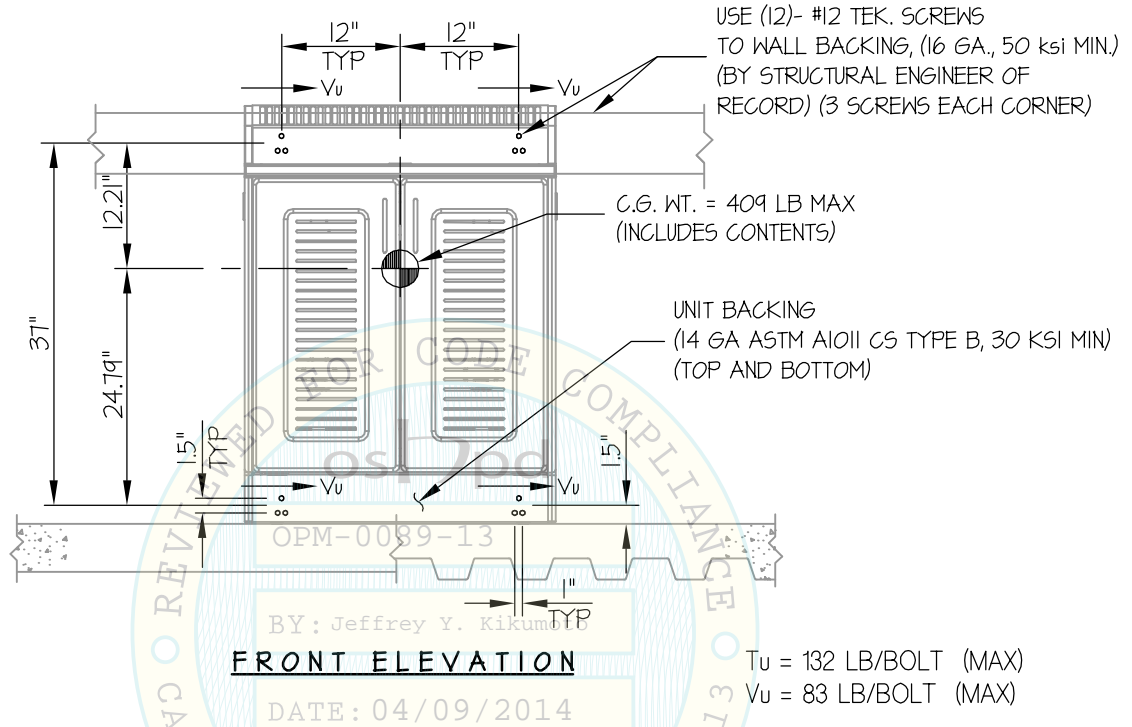


**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE (E<sub>h</sub>) = 180 W<sub>p</sub> (S<sub>ds</sub> = 2.5, α<sub>p</sub> = 1.0, ρ = 15, R<sub>p</sub> = 2.5, z/h ≤ 1)  
VERTICAL FORCE (E<sub>v</sub>) = 0.50 W<sub>p</sub>

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- CONTENT LOAD LIMIT:
  - 40 LB ON PER SHELF (2 SHELVES MAX)
  - 87 LB ON COUNTERTOP
  - 167 LB MAX
- SEE GENERAL NOTES: SHEETS 1

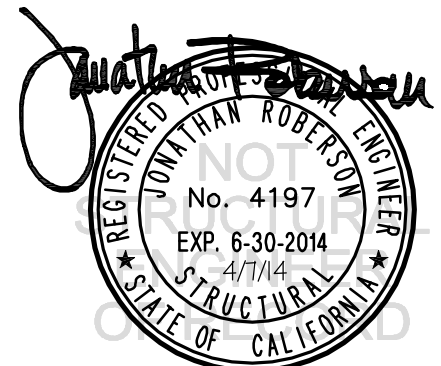

## STRYKER COMMUNICATIONS

## DOCUMENT STATION

DES. **J. ROBERSON**

JOB NO. **11-1405**

DATE **4/7/14**

SHEET


**5**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BASE CABINET W/ SHELF

CONCRETE SLAB / WALL MOUNTED

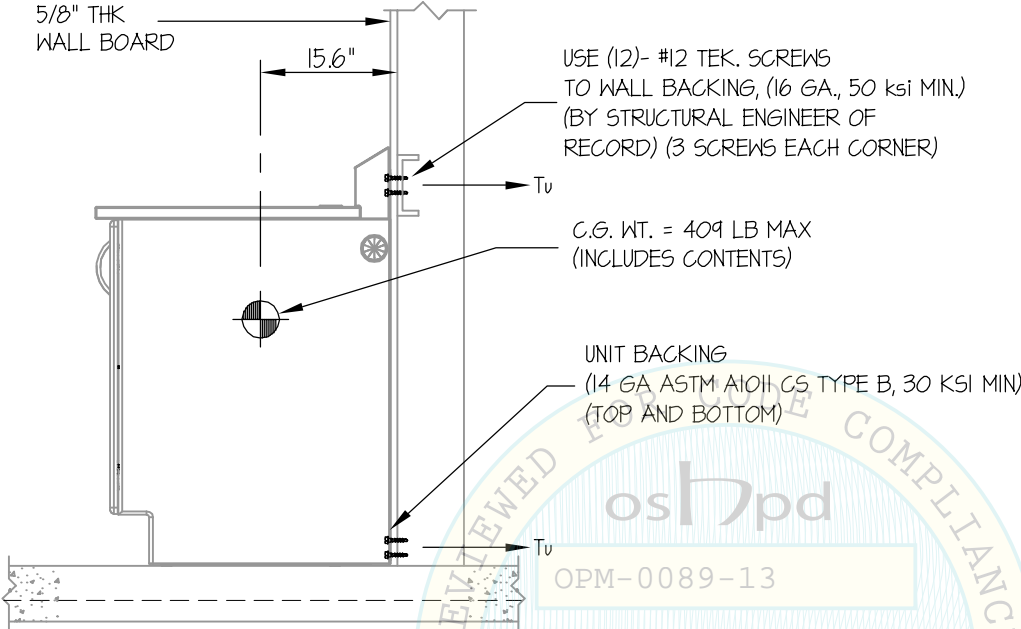


SIDE ELEVATION

USE (12)- #12 TEK. SCREWS  
TO WALL BACKING, (16 GA., 50 ksi MIN.)  
(BY STRUCTURAL ENGINEER OF  
RECORD) (3 SCREWS EACH CORNER)

C.G. WT. = 409 LB MAX  
(INCLUDES CONTENTS)


UNIT BACKING  
(14 GA. ASTM A1011 CS. TYPE B, 30 KSI MIN)  
(TOP AND BOTTOM)

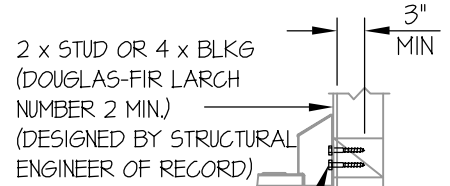

SECTION AT WOOD STUD WALL

USE 3- #12 X 4"  
WOOD SCREWS TO  
WOOD STUD OR BLK.  
(PRE-DRILL HOLES  
TO 0.70 X SHANK  
DIAMETER) (4 PLACES)

5/8" THK.  
WALL BOARD

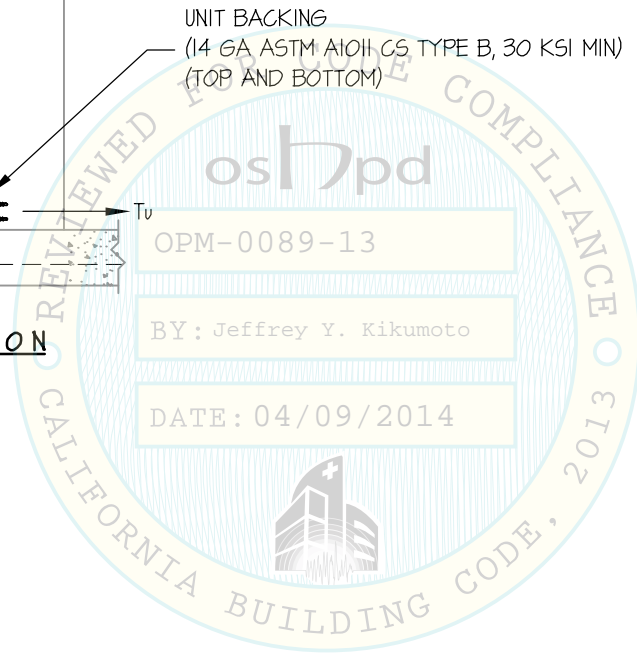

## STRYKER COMMUNICATIONS

## DOCUMENT STATION

DES. **J. ROBERSON**

JOB NO. **11-1405**

DATE **4/7/14**

SHEET


**6**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BASE CABINET W/ 3 DRAWERS

CONCRETE SLAB / WALL MOUNTED

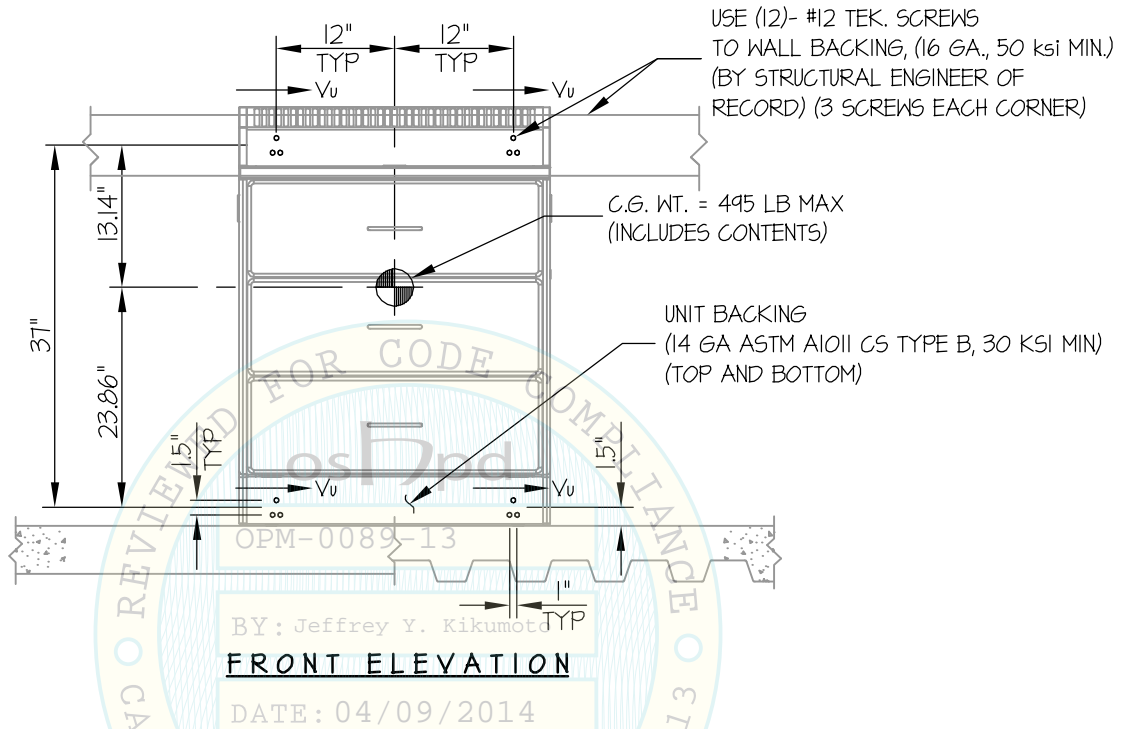

$T_u = 167 \text{ LB/BOLT (MAX)}$   
 $V_u = 96 \text{ LB/BOLT (MAX)}$

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE ( $E_h$ ) =  $1.80 W_p$  ( $S_{DS} = 2.5$ ,  $a_p = 10$ ,  $I_p = 15$ ,  $R_p = 2.5$ ,  $z/h \leq 1$ )  
VERTICAL FORCE ( $E_v$ ) =  $0.50 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- CONTENT LOAD LIMIT:
  - 47 LB/DRAWER (3 DRAWERS MAX)
  - 87 LB ON COUNTERTOP
  - 228 LB MAX
- SEE GENERAL NOTES: SHEETS 1





## STRYKER COMMUNICATIONS

DES. **J. ROBERSON**

SHEET

**7**

## DOCUMENT STATION

JOB NO. **11-1405**


DATE **4/7/14**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BASE CABINET W/ 3 DRAWERS

CONCRETE SLAB / WALL MOUNTED

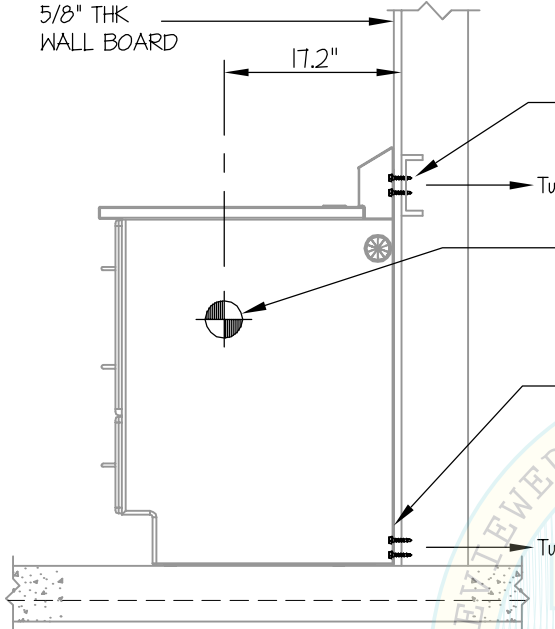


SIDE ELEVATION

USE (12)- #12 TEK. SCREWS  
TO WALL BACKING, (16 GA., 50 ksi MIN.)  
(BY STRUCTURAL ENGINEER OF  
RECORD) (3 SCREWS EACH CORNER)

C.G. WT. = 495 LB MAX  
(INCLUDES CONTENTS)


UNIT BACKING  
(14 GA ASTM A1011 GS TYPE B, 30 KSI MIN)  
(TOP AND BOTTOM)

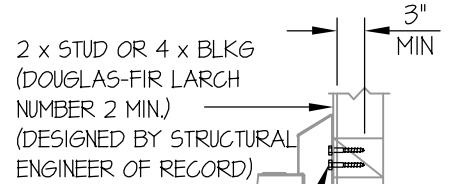

USE 3- #12 X 4"  
WOOD SCREWS TO  
WOOD STUD OR BLKG.  
(PRE-DRILL HOLES  
TO 0.70 X SHANK  
DIAMETER) (4 PLACES)

5/8" THK.  
WALL BOARD

SECTION AT WOOD STUD WALL

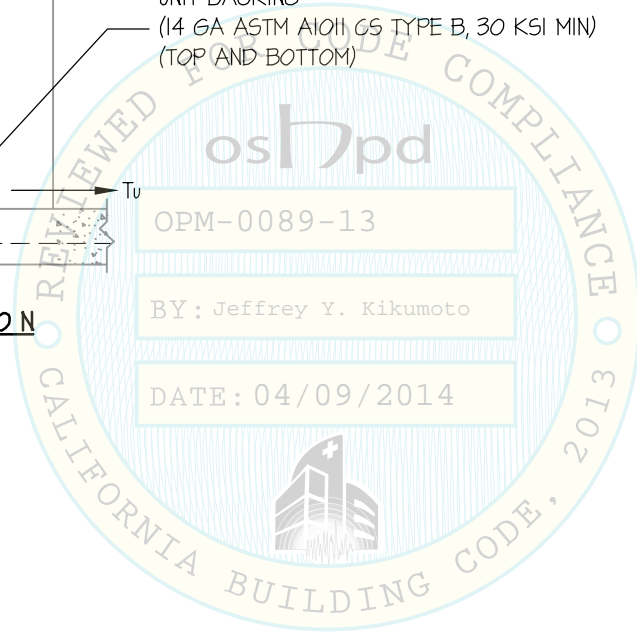

## STRYKER COMMUNICATIONS

DES. **J. ROBERSON**

SHEET

**8**

JOB NO. **11-1405**


## DOCUMENT STATION

DATE **4/7/14**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

TOP CABINET W/ 2 SHELVES

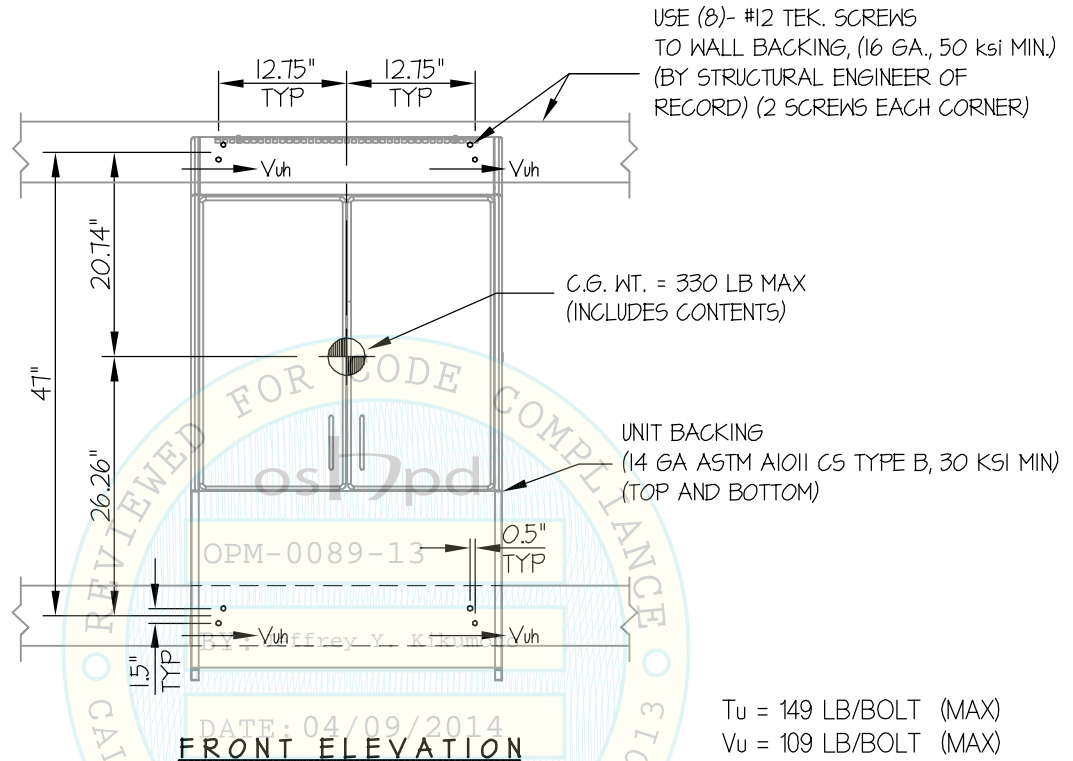

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE ( $E_h$ ) =  $180 W_p (S_{Ds} = 2.5, a_p = 1.0, I_p = 1.5, R_p = 2.5, z/h \leq 1)$

VERTICAL FORCE ( $E_v$ ) =  $0.50 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- CONTENT LOAD LIMIT:
  - 40 LB PER SHELF (2 SHELVES (MAX) PLUS BOTTOM)
  - 120 LB MAX
- SEE GENERAL NOTES: SHEETS 1



## STRYKER COMMUNICATIONS

## DOCUMENT STATION

DES. **J. ROBERSON**

JOB NO. **11-1405**

DATE **4/7/14**

SHEET


**9**

OF **11** SHEETS


SEISMIC SUPPORTS & ATTACHMENTS

TOP CABINET W/ 2 SHELVES

WALL MOUNTED

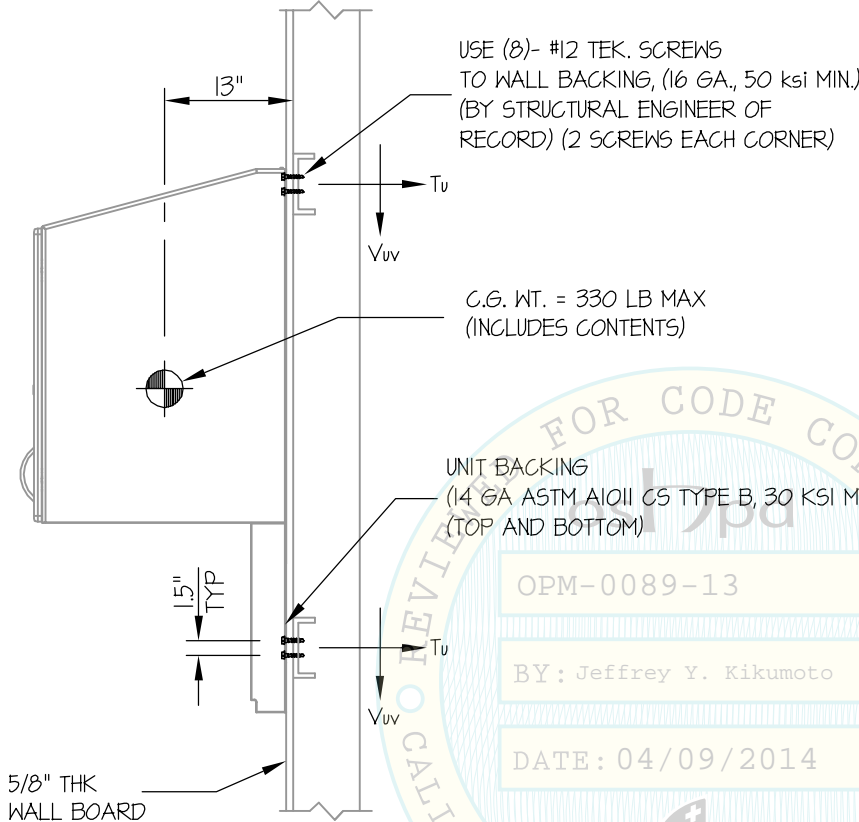


SIDE ELEVATION

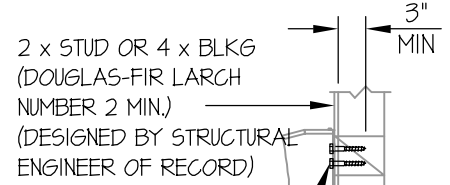

USE 2- #12 X 4"  
WOOD SCREWS TO  
WOOD STUD OR BLKG.  
(PRE-DRILL HOLES  
TO 0.70 X SHANK  
DIAMETER) (4 PLACES)

5/8" THK.  
WALL BOARD

SECTION AT WOOD STUD WALL

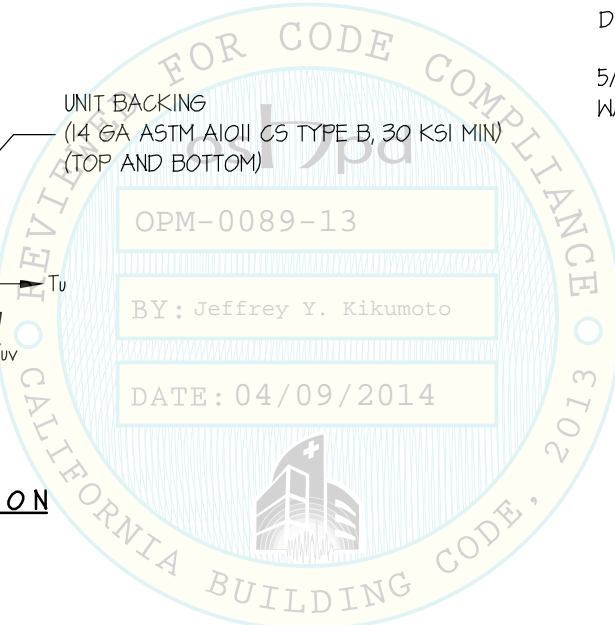

## STRYKER COMMUNICATIONS

DES. **J. ROBERSON**

SHEET

**10**

## DOCUMENT STATION

JOB NO. **11-1405**


DATE **4/7/14**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

TOP CABINET W/ 3 SHELVES

WALL MOUNTED

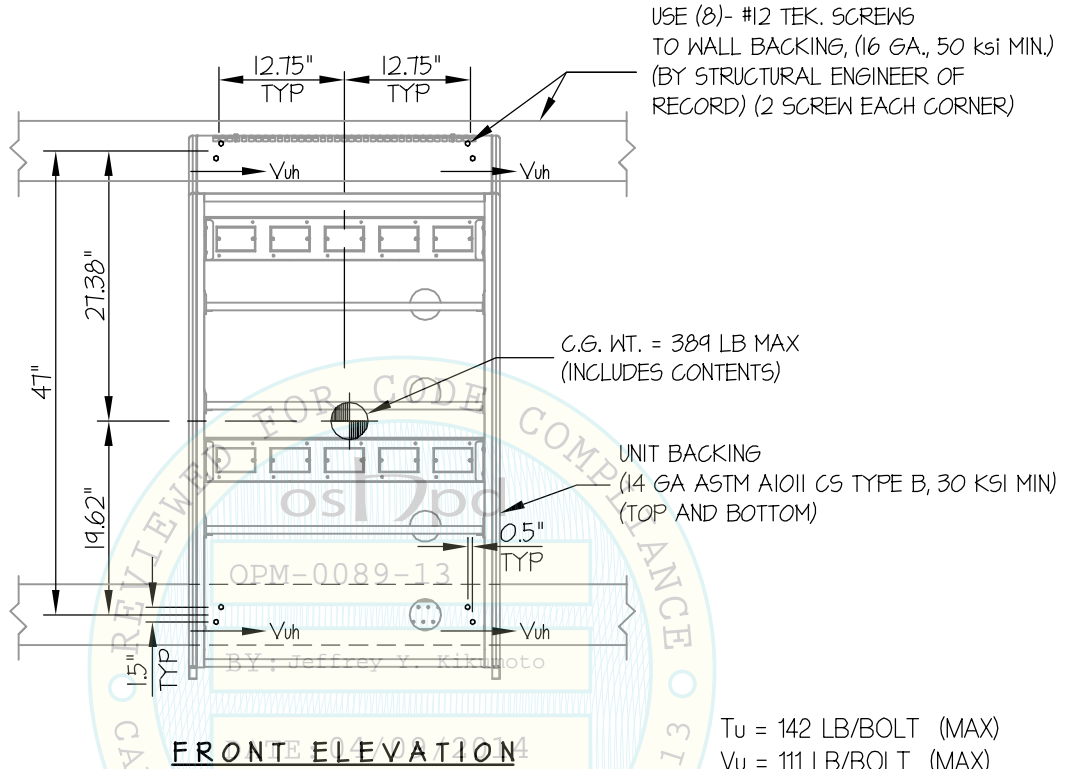


**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE (E<sub>h</sub>) = 1.80 W<sub>p</sub> (S<sub>ds</sub> = 2.5, a<sub>p</sub> = 1.0, I<sub>p</sub> = 1.5, R<sub>p</sub> = 2.5, z/h ≤ 1)  
VERTICAL FORCE (E<sub>v</sub>) = 0.50 W<sub>p</sub>

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- CONTENT LOAD LIMIT:
  - 40 LB PER SHELF (3 SHELVES (MAX) PLUS BOTTOM)
  - 160 LB MAX
- SEE GENERAL NOTES; SHEETS 1

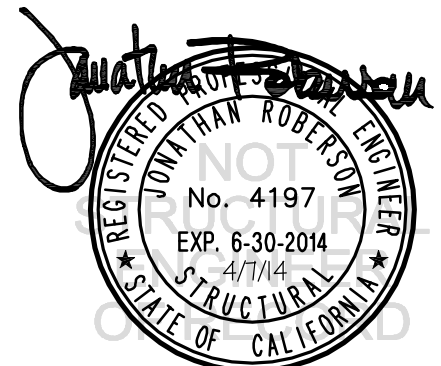

## STRYKER COMMUNICATIONS

## DOCUMENT STATION

DES. **J. ROBERSON**

JOB NO. **11-1405**

DATE **4/7/14**

SHEET

**11**

OF **11** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

TOP CABINET W/ 3 SHELVES

WALL MOUNTED

