



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**APPLICATION FOR OSHPD PREAPPROVAL  
OF MANUFACTURER'S CERTIFICATION (OPM)**

OFFICE USE ONLY	
APPLICATION #:	OPM-0093-13

**OSHPD Preapproval of Manufacturer's Certification (OPM)**

Type:  New  Renewal  Update to Pre-CBC 2013 OPA Number: \_\_\_\_\_

**Manufacturer Information**

Manufacturer: Peerless Industries, Inc.

Manufacturer's Technical Representative: Peter Dworakowski

Mailing Address: 2300 White Oak Circle, Aurora, IL. 60502

Telephone: (630) 375-5135 Email: PDworakowski@peerless-av.com


**Product Information**

Product Name: DS-VW765 Video Wall Mount

Product Type: Computer

Product Model Number: DS-VW765-POR, DS-VW765-LAND

General Description: Wall Mount for Video Monitor

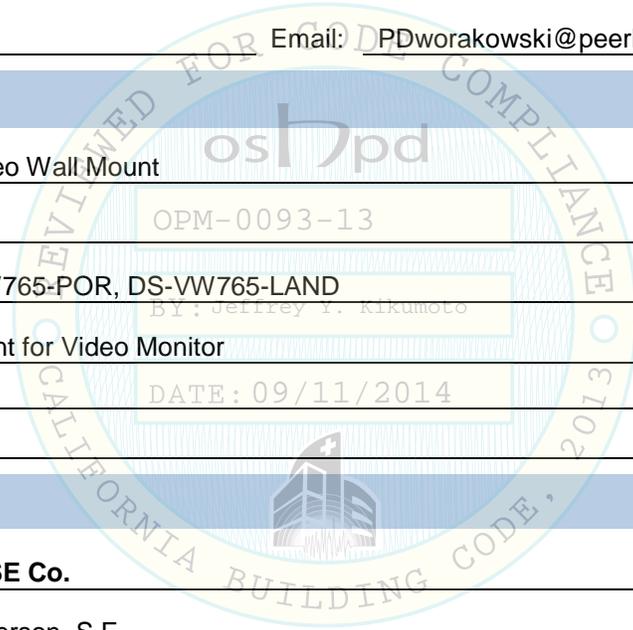

**Applicant Information**

Applicant Company Name: EASE Co.

Contact Person: Jonathan Roberson, S.E.

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709


Telephone: (909) 606-7622 Email: J.Roberson@EASECo.com

I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2013.

Signature of Applicant:  Date: 4/23/14

Title: Principal Engineer Company Name: EASE Co.

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**Registered Design Professional Preparing Engineering Recommendations**

Company

Name: EASE Co.

Name: Jonathan Roberson, S.E. California License Number: S4197

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709

Telephone: 909-606-7667 Email: J.Roberson@EASECo.com

**OSHPD Special Seismic Certification Preapproval (OSP)**

- Special Seismic Certification is preapproved under OSP- (Separate application for OSP is required)
- Special Seismic Certification is not preapproved

**Certification Method(s)**

- Testing in accordance with:  ICC-ES AC156  FM 1950-10
- Other\* (Please Specify): \_\_\_\_\_

\*Use of test criteria other than those adopted by the California Building Standards Code, 2013 (CBSC 2013) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2013 may be used when approved by OSHPD prior to testing.

- Analysis
- Experience Data
- Combination of Testing, Analysis, and/or Experience Data (Please Specify): \_\_\_\_\_

**List of Attachments Supporting the Manufacturer's Certification**

- Test Report  Drawings  Calculations  Manufacturer's Catalog
- Other(s) (Please Specify): \_\_\_\_\_

**OFFICE USE ONLY – OSHPD APPROVAL VALID FOR CBC 2013 ONLY**


Signature:  Date: 09/11/2014

Print Name: Jeffrey Kikumoto

Title: SSE

Condition of Approval (if applicable): \_\_\_\_\_

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**EQUIPMENT ANCHORAGE  
& SEISMIC ENGINEERING**

5877 Pine Ave, Ste. 210  
Chino Hills, CA. 91709  
Phn: (909) 606-7622

Office of Statewide Health Planning and Development  
**PREAPPROVAL OF MANUFACTURER'S CERTIFICATION**  
**OPM-0093-13**

**THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE**

MANUFACTURER: **PEERLESS INDUSTRIES INC.**  
EQUIPMENT NAME: **DS-VW765 WALL MOUNT**

Sheet: 1 of 9  
Date: 9/2/14

GENERAL NOTES

1. THIS OSHPD PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2013 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2013 CBC
2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
3. THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE.
4. FORCES PER ASCE 7-10 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3, WHERE  $S_{ds} = 2.2$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h \leq 1$ .
5. THE DETAILS IN THIS PREAPPROVAL MAY BE USED AT ANY LOCATION IN THE STATE OF CALIFORNIA, WHERE SDS IS NOT GREATER THAN 2.2.
6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
7. SHEET METAL SCREWS SHALL BE TEKS SCREWS BY ITW BUILDEX (ICC ESR-1976).
8. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
9. RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING
  - A. PROVIDE SUPPORTING STRUCTURE REQUIRED TO SUPPORT WEIGHTS AND FORCES SHOWN, IN ADDITION TO ALL OTHER LOADS.
  - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2013 CBC AND WITH THE DETAILS SHOWN IN THIS PREAPPROVAL. VERIFY THAT THE ACTUAL EQUIPMENT'S WEIGHT, CG LOCATION, ANCHOR LOCATIONS, ANCHOR DETAILS AND THE MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
  - C. VERIFY THAT THE COMBINATION OF  $S_{ds}$  &  $z/h$  RESULT IN SEISMIC FORCES ( $E_h$ ,  $E_v$ ) THAT ARE NOT GREATER THAN THE VALUES ON THE DETAILS.
  - D. DESIGN BACKING BARS, STUDS, ETC. WHICH THE UNITS ARE ATTACHED TO AS NOTED ON THE DRAWINGS.



**PEERLESS INDUSTRIES INC.**

**DS-VW765 WALL MOUNT**

DES. **J. ROBERSON**

JOB NO. **11-1418**

DATE **9/2/14**


SHEET

**2**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

WALL MOUNTED

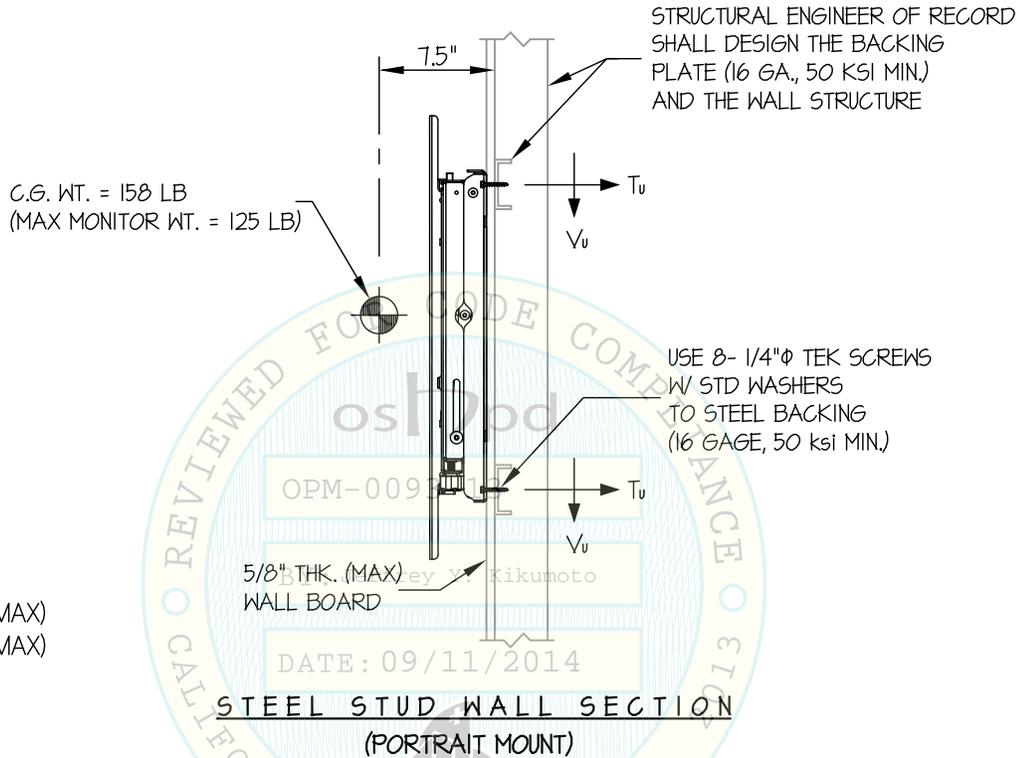

T<sub>u</sub> = 126 LB/SCREW (MAX)  
V<sub>u</sub> = 160 LB/SCREW (MAX)

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE (E<sub>h</sub>) = 3.96 W<sub>p</sub> (S<sub>Ds</sub> = 2.2, a<sub>p</sub> = 2.5, I<sub>p</sub> = 1.5, R<sub>p</sub> = 2.5, z/h ≤ 1)  
VERTICAL FORCE (E<sub>v</sub>) = 0.44 W<sub>p</sub>

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES ON SHEET 1



## PEERLESS INDUSTRIES INC.

### DS-VW765 WALL MOUNT

DES. **J. ROBERSON**

JOB NO. **11-1418**

DATE **9/2/14**


SHEET

**3**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

WALL MOUNTED

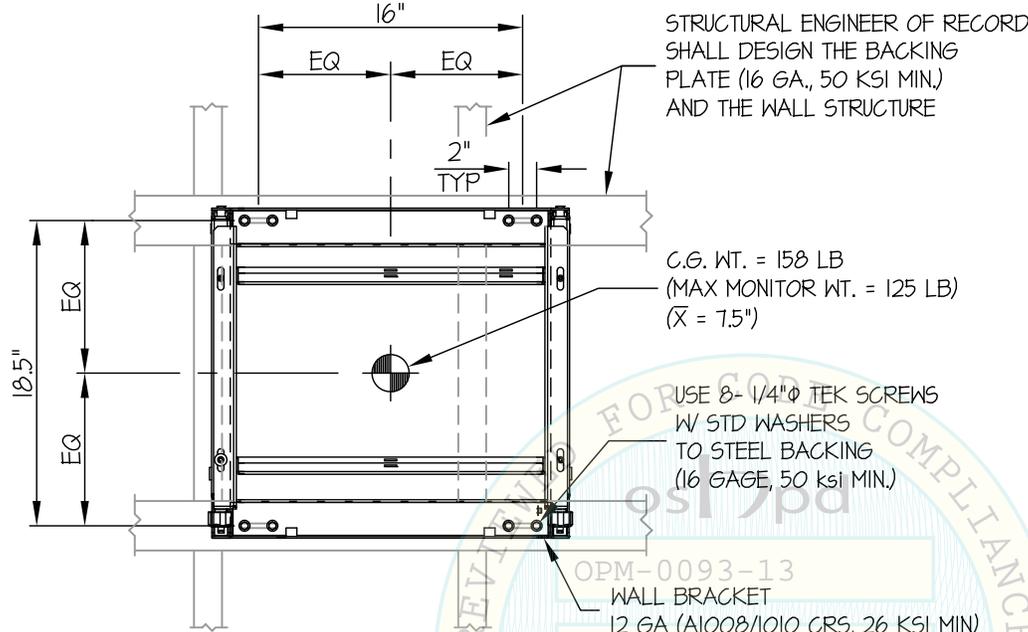

**FRONT ELEVATION**  
(PORTRAIT MOUNT)


DATE: 09/11/2014

4 x BLKG  
(DOUGLAS-FIR LARCH  
NUMBER 2 MIN.)  
(DESIGNED BY STRUCTURAL  
ENGINEER OF RECORD)

USE 8- 1/4"  $\phi$  X 4"  
WOOD SCREWS TO  
WOOD BLKG.  
(PRE-DRILL HOLES  
TO 0.70 X SHANK  
DIAMETER)

5/8" THK. (MAX)  
WALL BOARD

**SECTION AT WOOD STUD WALL**

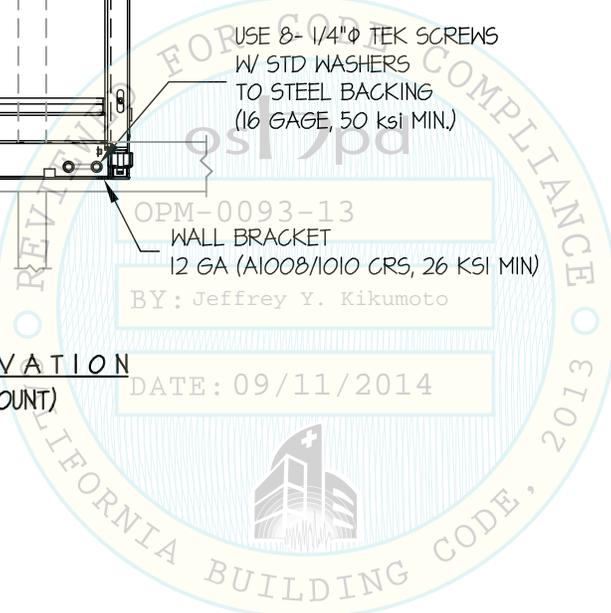

**PEERLESS INDUSTRIES INC.**

**DS-VW765 WALL MOUNT**

DES. **J. ROBERSON**

JOB NO. **11-1418**

DATE **9/2/14**


SHEET

**4**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

WALL MOUNTED

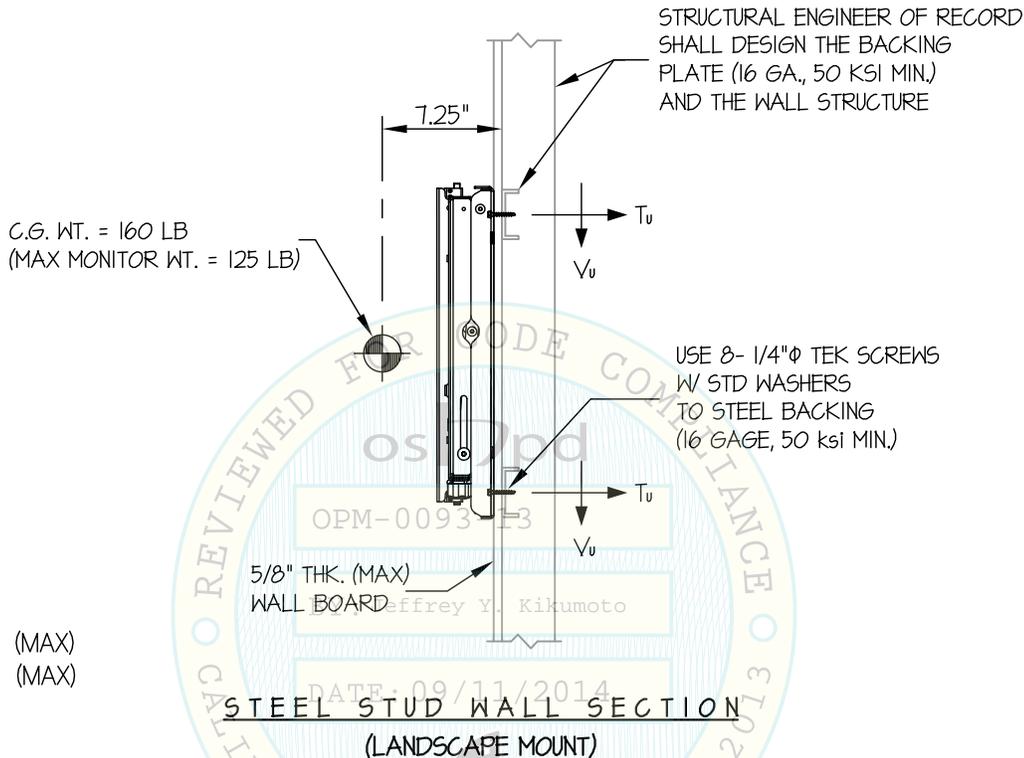

$T_u = 213$  LB/SCREW (MAX)  
 $V_u = 168$  LB/SCREW (MAX)

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE ( $E_h$ ) =  $3.96 W_p$  ( $S_Ds = 2.2, a_p = 2.5, I_p = 1.5, R_p = 2.5, z/h \leq 1$ )  
VERTICAL FORCE ( $E_v$ ) =  $0.44 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES ON SHEET 1



**PEERLESS INDUSTRIES INC.**

**DS-VW765 WALL MOUNT**

DES. **J. ROBERSON**

JOB NO. **11-1418**

DATE **9/2/14**


SHEET

**5**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

WALL MOUNTED

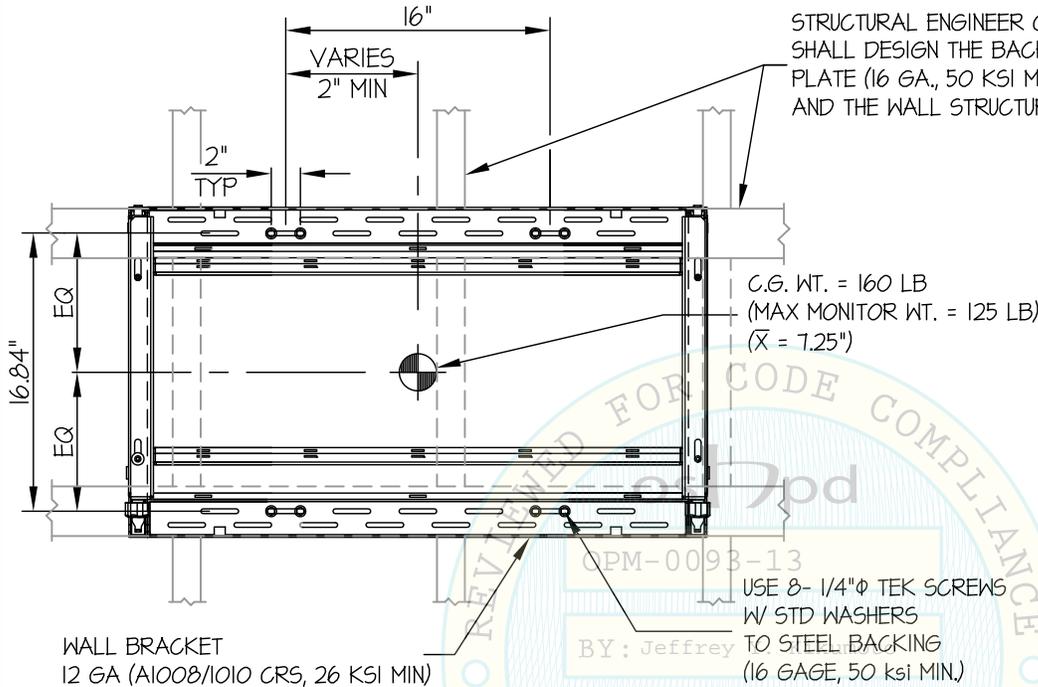


**FRONT ELEVATION**  
(LANDSCAPE MOUNT)

STRUCTURAL ENGINEER OF RECORD  
SHALL DESIGN THE BACKING  
PLATE (16 GA., 50 KSI MIN.)  
AND THE WALL STRUCTURE


4 x BLKG  
(DOUGLAS-FIR LARCH  
NUMBER 2 MIN.)  
(DESIGNED BY STRUCTURAL  
ENGINEER OF RECORD)

USE 8- 1/4"φ X 4"  
WOOD SCREWS TO  
WOOD BLKG.  
(PRE-DRILL HOLES  
TO 0.70 X SHANK  
DIAMETER)

5/8" THK. (MAX)  
WALL BOARD

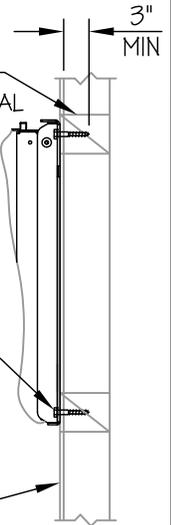

**SECTION AT WOOD STUD WALL**

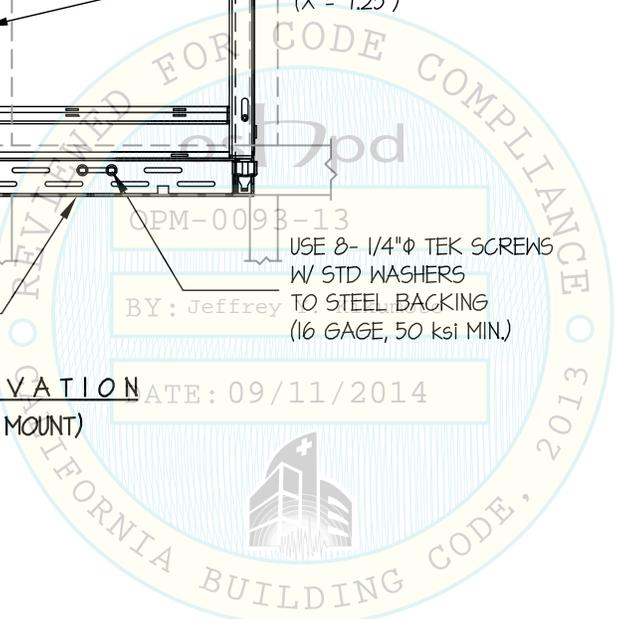

**PEERLESS INDUSTRIES INC.**

**DS-VW765 WALL MOUNT**

DES. **J. ROBERSON**

JOB NO. **11-1418**

DATE **9/2/14**

SHEET

**6**

OF **9** SHEETS


SEISMIC SUPPORTS & ATTACHMENTS  
(15° TILT BOX ADAPTER)

WALL MOUNTED

STRUCTURAL ENGINEER OF RECORD SHALL DESIGN THE BACKING PLATE (16 GA., 50 KSI MIN.) AND THE WALL STRUCTURE

C.G. WT. = 168 LB  
(MAX MONITOR WT. = 125 LB)

C.G. WT. = 170 LB  
(MAX MONITOR WT. = 125 LB)

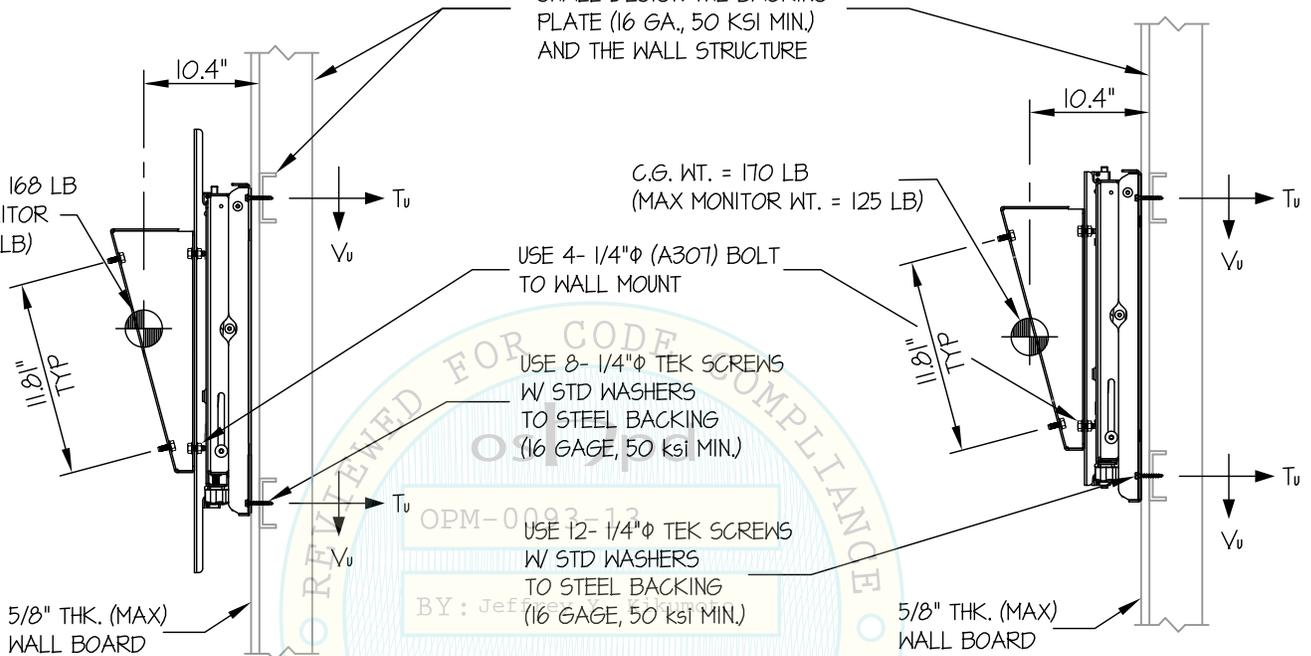

STEEL STUD WALL SECTION  
(AT DS-VW765-PORTRAIT)

STEEL STUD WALL SECTION  
(AT DS-VW765-LANDSCAPE)

NOTES:

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED.

HORIZONTAL FORCE ( $E_h$ ) =  $3.96 W_p$  ( $S_Ds = 2.2, a_p = 2.5, I_p = 1.5, R_p = 2.5, z/h \leq 1$ )

VERTICAL FORCE ( $E_v$ ) =  $0.44 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES ON SHEET 1



**PEERLESS INDUSTRIES INC.**

DES. **J. ROBERSON**

SHEET

**7**

JOB NO. **11-1418**


**DS-VW765 WALL MOUNT**

DATE **9/2/14**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS  
(15° TILT BOX ADAPTER)

WALL MOUNTED

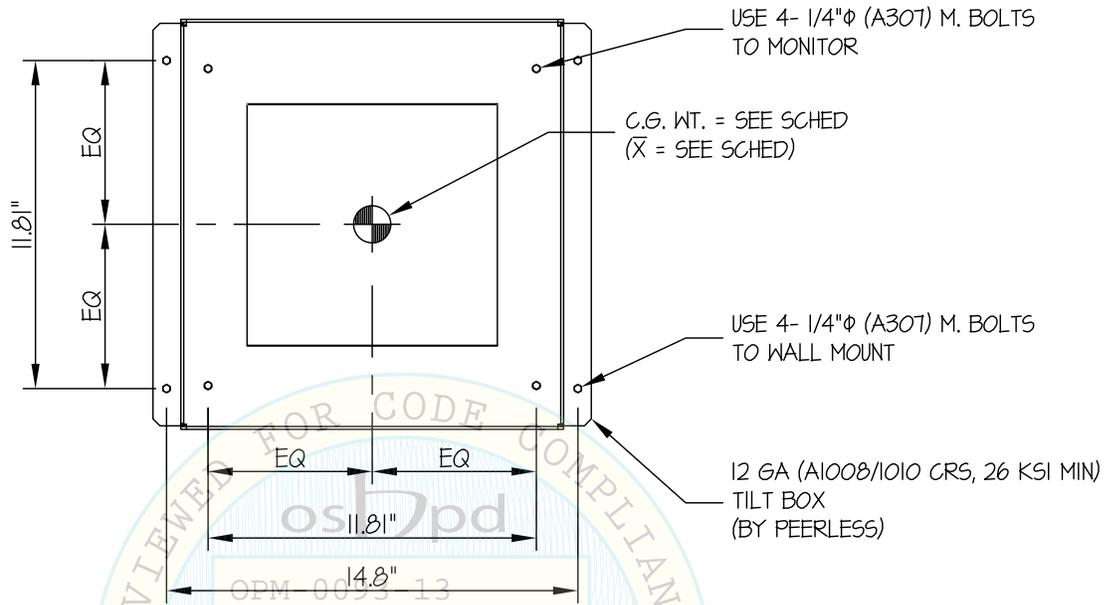

**FRONT ELEVATION**

BY: Jeffrey Y. Kikumoto

UNIT	WEIGHT (lb.)	$\bar{X}$ (in)	$T_u$ (lb.)	$V_u$ (lb.)
TV TO TILT BOX	125	2	155	134
TILT BOX TO MOUNT	135	6.5	231	145



**PEERLESS INDUSTRIES INC.**

**DS-VW765 WALL MOUNT**

DES. **J. ROBERSON**

JOB NO. **11-1418**

DATE **9/2/14**


SHEET

**8**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS  
(15° TILT BOX ADAPTER)

WALL MOUNTED

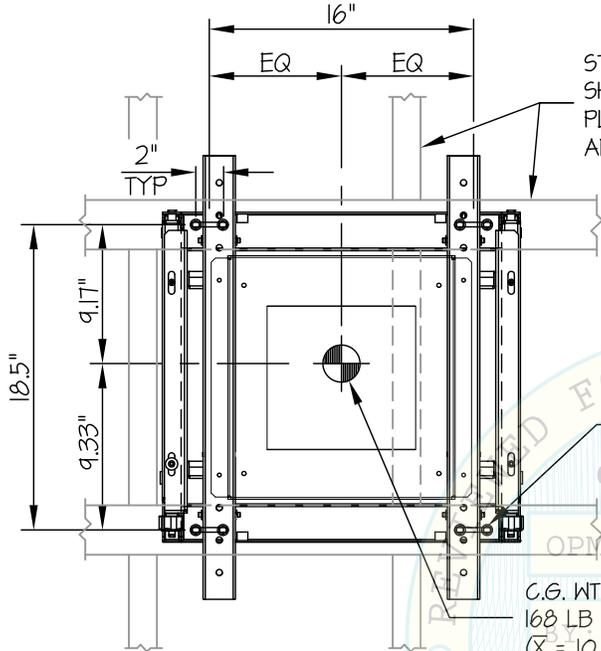

STRUCTURAL ENGINEER OF RECORD SHALL DESIGN THE BACKING PLATE (16 GA., 50 KSI MIN.) AND THE WALL STRUCTURE

4 x BLKG (DOUGLAS-FIR LARCH NUMBER 2 MIN.) (DESIGNED BY STRUCTURAL ENGINEER OF RECORD)

USE 8- 1/4"Φ TEK SCREWS W/ STD WASHERS TO STEEL BACKING (16 GAGE, 50 ksi MIN.)

USE 8- 1/4"Φ X 4" WOOD SCREWS TO WOOD BLKG. (PRE-DRILL HOLES TO 0.70 X SHANK DIAMETER)

C.G. WT. = 168 LB (X = 10.4")


5/8" THK. (MAX) WALL BOARD

FRONT ELEVATION  
(PORTRAIT MOUNT)

SECTION AT WOOD STUD WALL

DATE: 09/11/2014

T<sub>u</sub> = 174 LB/SCREW (MAX)  
V<sub>u</sub> = 171 LB/SCREW (MAX)

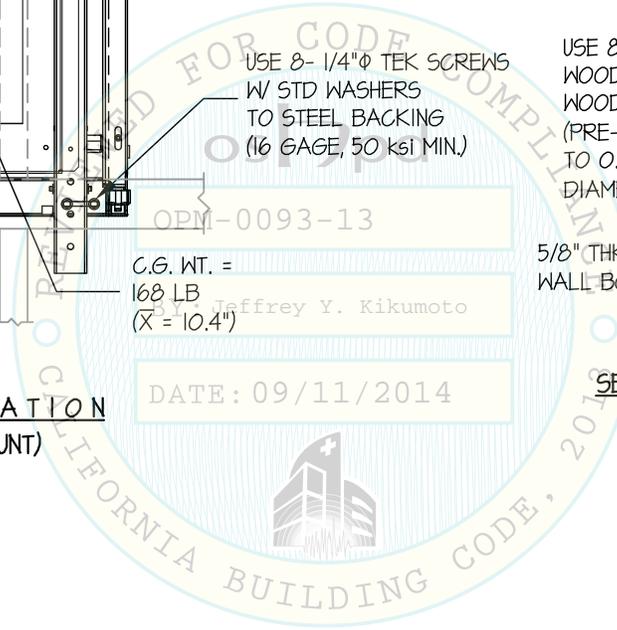

**PEERLESS INDUSTRIES INC.**

DES. **J. ROBERSON**

SHEET

**9**

**DS-VW765 WALL MOUNT**

JOB NO. **11-1418**


DATE **9/2/14**

OF **9** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS  
(15° TILT BOX ADAPTER)

STRUCTURAL ENGINEER OF RECORD SHALL DESIGN THE BACKING PLATE (16 GA., 50 KSI MIN.) AND THE WALL STRUCTURE

WALL MOUNTED

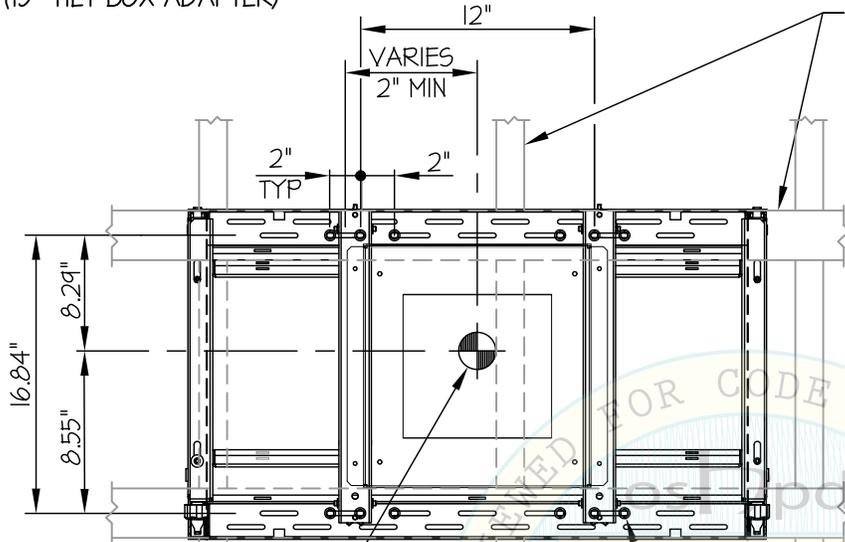

C.G. WT. =  
170 LB  
( $\bar{X}$  = 10.4")

FRONT ELEVATION  
(LANDSCAPE MOUNT)

USE 12- 1/4"  $\phi$  TEK SCREWS  
W/ STD WASHERS  
TO STEEL BACKING  
(16 GAGE, 50 ksi MIN.)

4 x BLKG  
(DOUGLAS-FIR LARCH  
NUMBER 2 MIN.)  
(DESIGNED BY STRUCTURAL  
ENGINEER OF RECORD)

USE 12- 1/4"  $\phi$  X 4"  
WOOD SCREWS TO  
WOOD BLKG.  
(PRE-DRILL HOLES  
TO 0.70 X SHANK  
DIAMETER)

5/8" THK. (MAX)  
WALL BOARD

SECTION AT WOOD STUD WALL

$T_u$  = 181 LB/SCREW (MAX)  
 $V_u$  = 176 LB/SCREW (MAX)

