



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**APPLICATION FOR OSHPD PREAPPROVAL  
OF MANUFACTURER'S CERTIFICATION (OPM)**

OFFICE USE ONLY	
APPLICATION #:	OPM-0121-13

**OSHPD Preapproval of Manufacturer's Certification (OPM)**

Type:  New  Renewal  Update to Pre-CBC 2013 OPA Number: \_\_\_\_\_

**Manufacturer Information**

Manufacturer: Ergotron

Manufacturer's Technical Representative: Jay Sorlie

Mailing Address: 1181 Trapp Road, St. Paul, MN. 55121

Telephone: (651) 681-7623 Email: Djsorlie@ergotron.com


**Product Information**

Product Name: StyleView Sit-Stand Combo Arm with Worksurface

Product Type: Computer OPM-0121-13

Product Model Number: 45-272 with 45-261

General Description: Wall Mounted CPU, Monitor and Keyboard Support

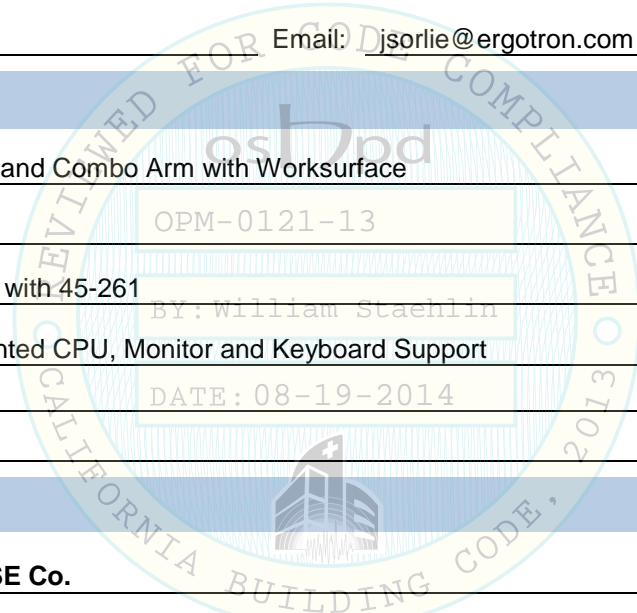

**Applicant Information**

Applicant Company Name: EASE Co.

Contact Person: Jonathan Roberson, S.E.

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709


Telephone: (909) 606-7622 Email: J.Roberson@EASECo.com

I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2013.

Signature of Applicant: \_\_\_\_\_ Date: 7/11/14

Title: Principal Engineer Company Name: EASE Co.

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**Registered Design Professional Preparing Engineering Recommendations**

Company Name: EASE Co.

Name: Jonathan Roberson, S.E. California License Number: S4197

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709

Telephone: 909-606-7667 Email: J.Roberson@EASECo.com

**OSHPD Special Seismic Certification Preapproval (OSP)**

- Special Seismic Certification is preapproved under OSP- (Separate application for OSP is required)
- Special Seismic Certification is not preapproved

**Certification Method(s)**

- Testing in accordance with:  ICC-ES AC156  FM 1950-10
- Other\* (Please Specify): \_\_\_\_\_

\*Use of test criteria other than those adopted by the California Building Standards Code, 2013 (CBSC 2013) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2013 may be used when approved by OSHPD prior to testing.

- Analysis
- Experience Data
- Combination of Testing, Analysis, and/or Experience Data (Please Specify): \_\_\_\_\_

**List of Attachments Supporting the Manufacturer's Certification**

- Test Report  Drawings  Calculations  Manufacturer's Catalog
- Other(s) (Please Specify): \_\_\_\_\_


**OFFICE USE ONLY – OSHPD APPROVAL VALID FOR CBC 2013 ONLY**

Signature: *William Staehlin* Date: 08/19/2014


Print Name: William Staehlin

Title: SSE

Condition of Approval (if applicable): \_\_\_\_\_

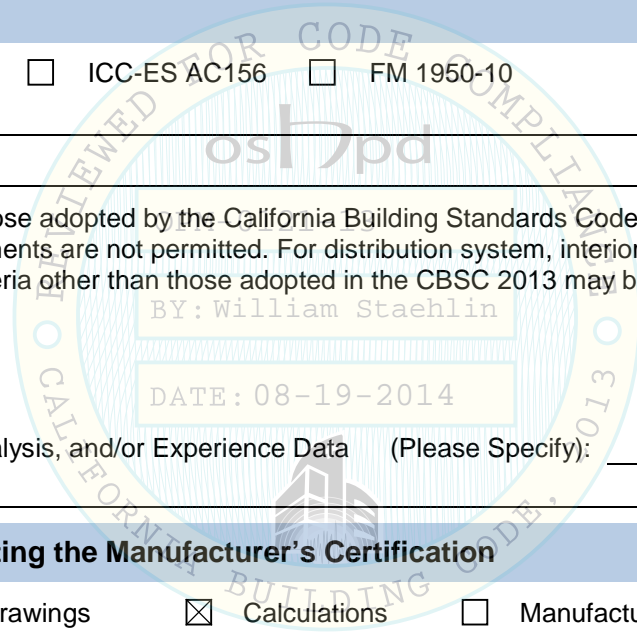

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**EQUIPMENT ANCHORAGE  
& SEISMIC ENGINEERING**

5877 Pine Ave, Ste. 210  
Chino Hills, CA. 91709  
Phn: (909) 606-7622

Office of Statewide Health Planning and Development  
**PREAPPROVAL OF MANUFACTURER'S CERTIFICATION**  
**OPM-0121-13**

**THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE**

MANUFACTURER: **ERGOTRON** Sheet: 1 of 5  
EQUIPMENT NAME: **STYLEVIEW SIT-STAND COMBO ARM WITH WORKSURFACE** Date: 7/24/14

GENERAL NOTES

1. THIS OSHPD PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2013 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2013 CBC
2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
3. THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE.
4. FORCES PER ASCE 7-10 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3, WHERE  $S_{ds} = 2.2$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h \leq 1$ .
5. THE DETAILS IN THIS PREAPPROVAL MAY BE USED AT ANY LOCATION IN THE STATE OF CALIFORNIA, WHERE SDS IS NOT GREATER THAN 2.2.
6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
7. SHEET METAL SCREWS SHALL BE TEKS SCREWS BY ITW BUILDEX (ICC ESR-1976).
8. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
9. RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING
  - A. PROVIDE SUPPORTING STRUCTURE REQUIRED TO SUPPORT WEIGHTS AND FORCES SHOWN, IN ADDITION TO ALL OTHER LOADS.
  - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2013 CBC AND WITH THE DETAILS SHOWN IN THIS PREAPPROVAL. VERIFY THAT THE ACTUAL EQUIPMENT'S WEIGHT, CG LOCATION, ANCHOR LOCATIONS, ANCHOR DETAILS AND THE MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
  - C. VERIFY THAT THE COMBINATION OF  $S_{ds}$  &  $z/h$  RESULT IN SEISMIC FORCES ( $E_h$ ,  $E_v$ ) THAT ARE NOT GREATER THAN THE VALUES ON THE DETAILS.
  - D. DESIGN BACKING BARS, STUDS, ETC. WHICH THE UNITS ARE ATTACHED TO AS NOTED ON THE DRAWINGS.



## ERGOTRON

### STYLEVIEW SIT-STAND COMBO ARM WITH WORKSURFACE

DES. **J. ROBERSON**

JOB NO. **11-1359**

DATE **7/24/14**


SHEET

**2**

OF **5** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

WALL MOUNTED

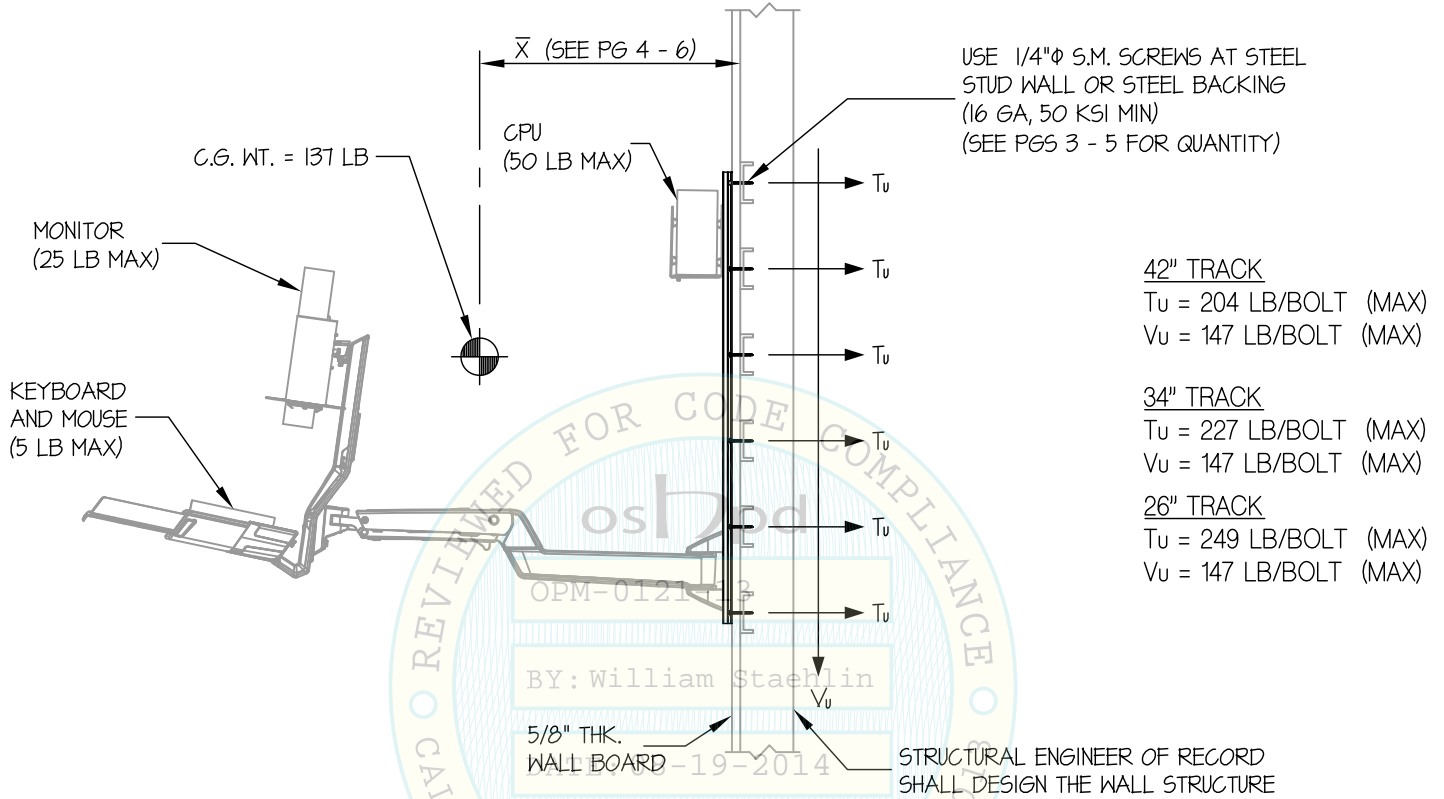

**STEEL STUD WALL SECTION**

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10 STRENGTH DESIGN IS USED. ( $S_{ds} = 2.2$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h \leq 1$ )

HORIZONTAL FORCE ( $E_h$ ) =  $3.96 W_p$

VERTICAL FORCE ( $E_v$ ) =  $0.44 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.

*Jonathan Roberson*  
 REGISTERED PROFESSIONAL ENGINEER  
 No. 4197  
 EXP. 6-30-2016  
 7/24/14  
 STRUCTURAL  
 STATE OF CALIFORNIA

## ERGOTRON

### STYLEVIEW SIT-STAND COMBO ARM WITH WORKSURFACE

DES. **J. ROBERSON**

JOB NO. **11-1359**

DATE **7/24/14**

SHEET

**3**

OF **5** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

42" TRACK


WALL MOUNTED

2 x STUDS OR 4 x BLKG  
(DOUGLAS-FIR LARCH  
NUMBER 2 MIN.)  
(DESIGNED BY STRUCTURAL  
ENGINEER OF RECORD)

USE 12- 1/4"φ X 4"  
WOOD SCREWS TO  
WOOD STUD OR BLKG.  
(PRE-DRILL HOLES  
TO 70% SHANK DIAMETER)

5/8" THK.  
WALL BOARD


NOTE: WOOD SCREWS TO BE  
INSTALLED AT CENTERLINE  
OF 2X WOOD STUD

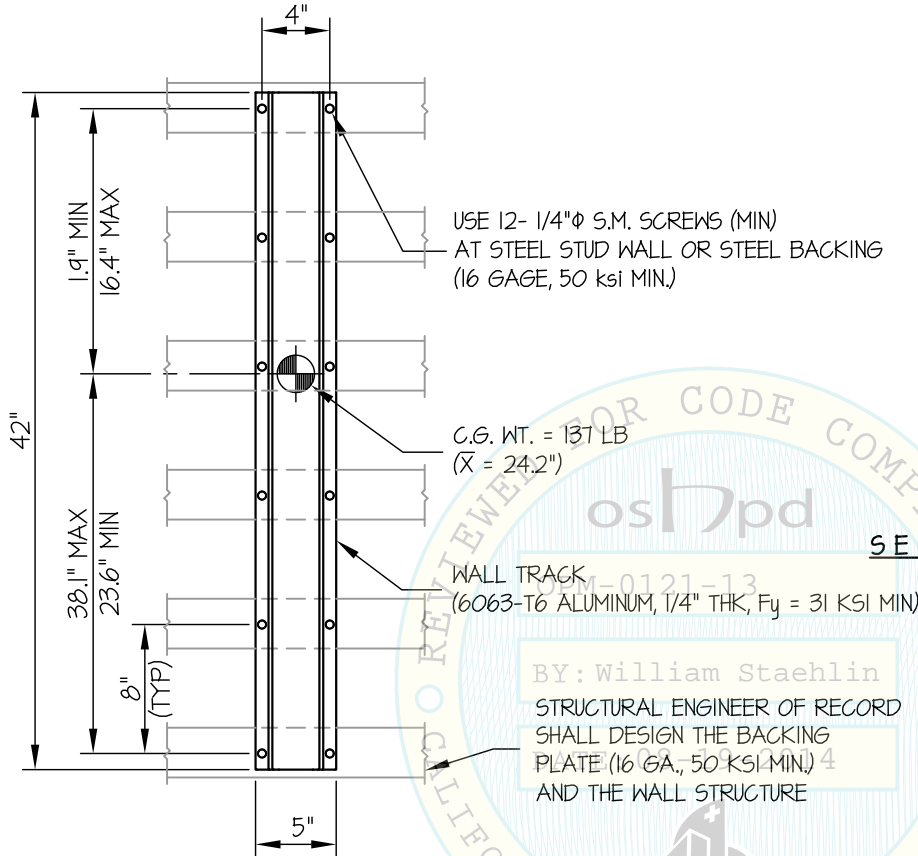

SECTION AT WOOD STUD WALL

BY: William Staehlin  
STRUCTURAL ENGINEER OF RECORD  
SHALL DESIGN THE BACKING  
PLATE (16 GA., 50 KSI MIN.)  
AND THE WALL STRUCTURE

ELEVATION AT WALL TRACK  
(STEEL STUD CONDITION)

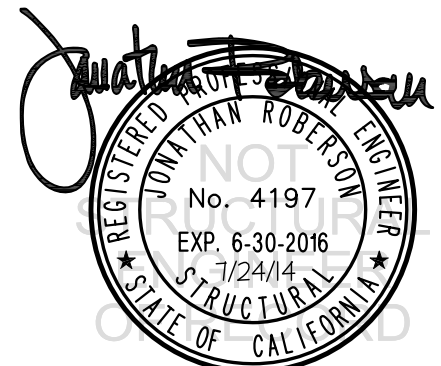

## ERGOTRON

### STYLEVIEW SIT-STAND COMBO ARM WITH WORKSURFACE

DES. **J. ROBERSON**

JOB NO. **11-1359**

DATE **7/24/14**

SHEET


**4**

OF **5** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

34" TRACK

WALL MOUNTED

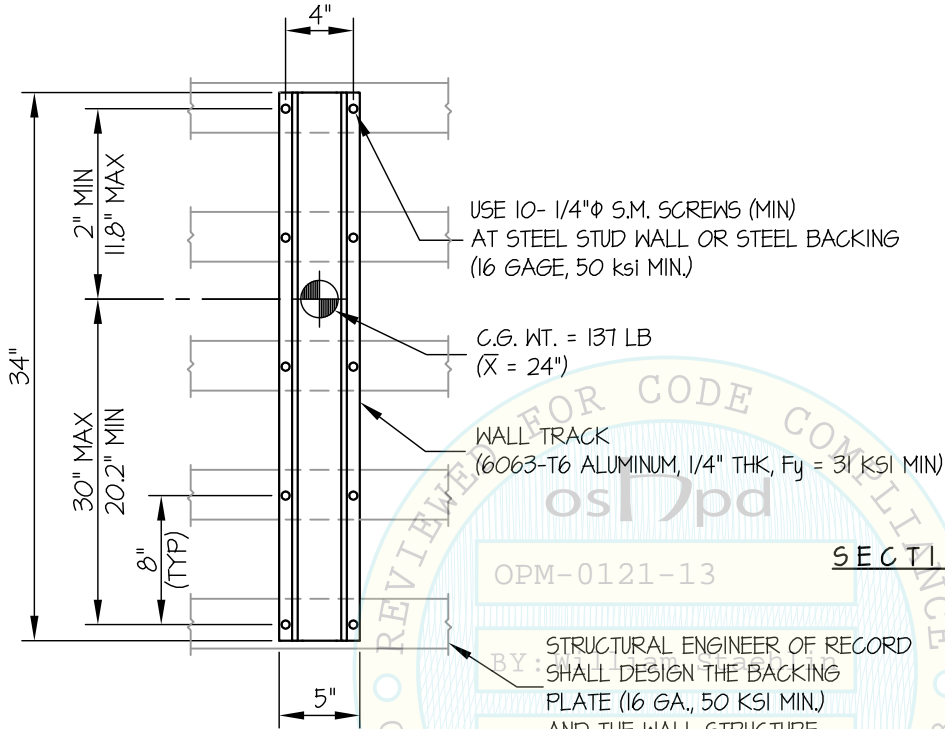

2 x STUDS OR 4 x BLKG  
(DOUGLAS-FIR LARCH  
NUMBER 2 MIN.)  
(DESIGNED BY STRUCTURAL  
ENGINEER OF RECORD)

USE 10- 1/4" x 4"  
WOOD SCREWS TO  
WOOD STUD OR BLKG.  
(PRE-DRILL HOLES  
TO 70% SHANK DIAMETER)

5/8" THK.  
WALL BOARD

NOTE: WOOD SCREWS TO BE  
INSTALLED AT CENTERLINE  
OF 2X WOOD STUD

SECTION AT WOOD STUD WALL

ELEVATION AT WALL TRACK  
(STEEL STUD CONDITION)

OPM-0121-13

BY: STRUCTURAL ENGINEER OF RECORD  
SHALL DESIGN THE BACKING  
PLATE (16 GA., 50 KSI MIN.)  
AND THE WALL STRUCTURE  
DATE: 08-19-2014



## ERGOTRON

### STYLEVIEW SIT-STAND COMBO ARM WITH WORKSURFACE

DES. **J. ROBERSON**

JOB NO. **11-1359**

DATE **7/24/14**

SHEET


**5**

OF **5** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

26" TRACK

WALL MOUNTED

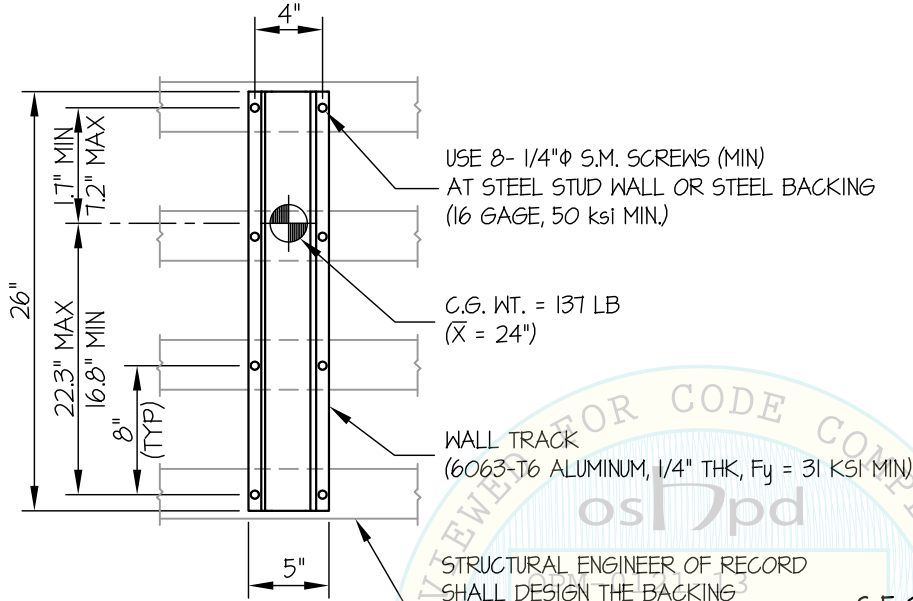

USE 8- 1/4"φ S.M. SCREWS (MIN)  
AT STEEL STUD WALL OR STEEL BACKING  
(16 GAGE, 50 ksi MIN.)

C.G. WT. = 137 LB  
( $\bar{X}$  = 24")

WALL TRACK  
(6063-T6 ALUMINUM, 1/4" THK,  $F_y$  = 31 KSI MIN)

STRUCTURAL ENGINEER OF RECORD  
SHALL DESIGN THE BACKING  
PLATE (16 GA., 50 KSI MIN.)  
AND THE WALL STRUCTURE

2 x STUDS OR 4 x BLKG  
(DOUGLAS-FIR LARCH  
NUMBER 2 MIN.)  
(DESIGNED BY STRUCTURAL  
ENGINEER OF RECORD)

USE 8- 1/4"φ X 4"  
WOOD SCREWS TO  
WOOD STUD OR BLKG.  
(PRE-DRILL HOLES  
TO 70% SHANK DIAMETER)

5/8" THK.  
WALL BOARD

NOTE: WOOD SCREWS TO BE  
INSTALLED AT CENTERLINE  
OF 2X WOOD STUD

**SECTION AT WOOD STUD WALL**

**ELEVATION AT WALL TRACK  
(STEEL STUD CONDITION)**

