



DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
FACILITIES DEVELOPMENT DIVISION

APPLICATION FOR HCAI PREAPPROVAL OF  
MANUFACTURER'S CERTIFICATION (OPM)

OFFICE USE ONLY

APPLICATION #: OPM-0261

HCAI Preapproval of Manufacturer's Certification (OPM)

Type:  New  Renewal/Update

Manufacturer Information

Manufacturer: Chatsworth Products

Manufacturer's Technical Representative: Todd Schneider

Mailing Address: 4175 Guardian Street, Simi Valley, CA 93063

Telephone: (203) 969-4862

Email: TSchneider@chatsworth.com

Product Information

Product Name: UNIVERSAL & STANDARD RACKS OPM-0261

Product Type: Instrumentation Cabinet

Product Model Number: 46353-X03, 46353-X05, 46353-X15, 55053-X03

General Description: Telecommunication Rack

Applicant Information

Applicant Company Name: EASE LLC.


Contact Person: Tiffany Tonn

Mailing Address: 1515 FAIRVIEW AVE, STE 205, MISSOULA, MT 59801

Telephone: (406) 541-3273

Email: tiffany@easeco.com

Title: Office Manager

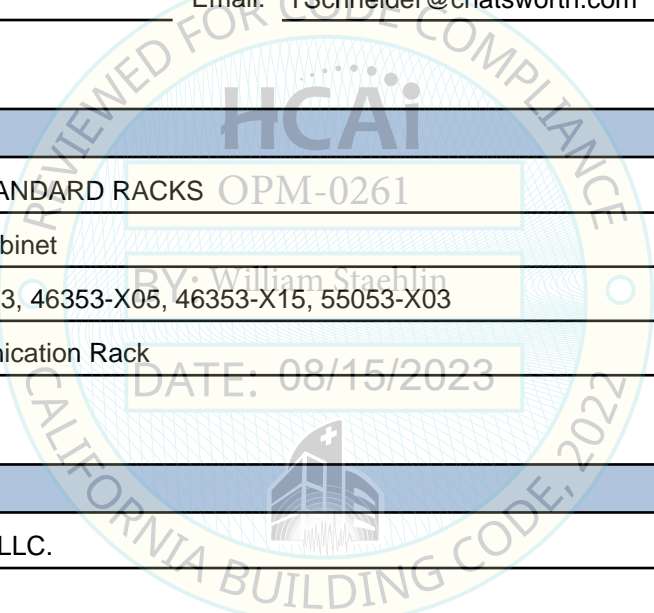

*"A healthier California where all receive equitable, affordable, and quality health care"*

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY





**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
FACILITIES DEVELOPMENT DIVISION**

**Registered Design Professional Preparing Engineering Recommendations**

Company Name: EASE LLC  
Name: Jonathan Roberson California License Number: S4197  
Mailing Address: 5877 Pine Ave., Suite 210, Chino Hills, CA 91709  
Telephone: (951) 295-1892 Email: jon@EASECo.com

**HCAI Special Seismic Certification Preapproval (OSP)**

Special Seismic Certification is preapproved under OSP OSP Number: \_\_\_\_\_

**Certification Method**


Testing in accordance with:  ICC-ES AC156  FM 1950-16  
 Other(s) (Please Specify): \_\_\_\_\_

\*Use of criteria other than those adopted by the California Building Standards Code, 2022 (CBSC 2022) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2022 may be used when approved by HCAI prior to testing.

Analysis  
 Experience Data  
 Combination of Testing, Analysis, and/or Experience Data (Please Specify): \_\_\_\_\_

**HCAI Approval**

Date: 8/15/2023  
Name: William Staehlin Title: Senior Structural Engineer  
Condition of Approval (if applicable): \_\_\_\_\_

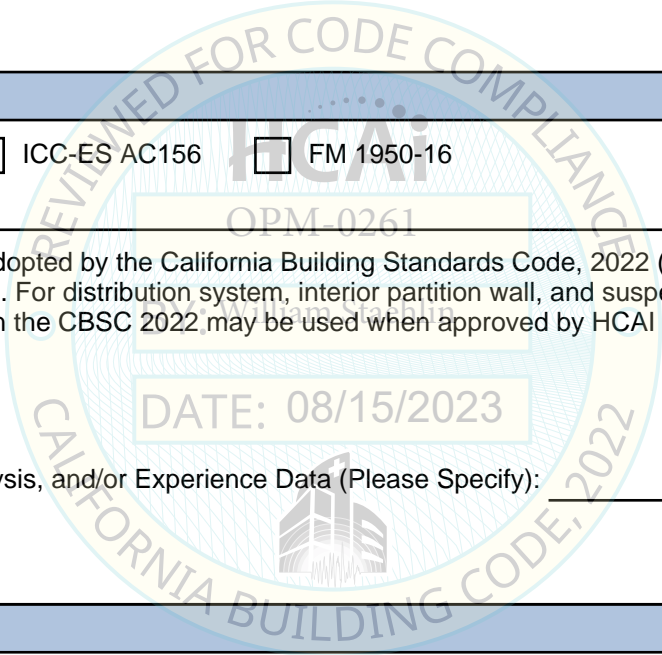

*"A healthier California where all receive equitable, affordable, and quality health care"*

**STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY**





**EQUIPMENT ANCHORAGE  
& SEISMIC ENGINEERING**

5877 Pine Ave, Ste. 210  
Chino Hills, CA. 91709  
Phn: (909) 606-7622

The Department of Health Care Access and Information  
**PREAPPROVAL OF MANUFACTURER'S CERTIFICATION**  
**OPM-0261**

**THIS PREAPPROVAL CONFORMS TO THE 2022 CALIFORNIA BUILDING CODE**

MANUFACTURER: **CHATSWORTH PRODUCTS, INC**  
EQUIPMENT NAME: **STANDARD & UNIVERSAL RACKS**

Sheet: 1 of 15

Date: 8/7/23

**GENERAL NOTES**

1. THIS HCAI PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2022 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2022 CBC
2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
3. THIS PREAPPROVAL CONFORMS TO THE 2022 CALIFORNIA BUILDING CODE WHERE  $S_{ds}$  IS NOT GREATER THAN 2.30. SEE DETAIL FOR APPLICABILITY
4. FORCES PER ASCE 7-16 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3, WHERE  $S_{ds} = 2.30$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 6.0$ ,  $z/h = 0$  AT CONCRETE SLAB &  $z/h \leq 1$  AT CONCRETE SLAB ON METAL DECK. SEE FOLLOWING SHEETS FOR  $\Omega$ .
5. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
7. CONCRETE SLAB ON METAL DECK DETAIL VALID FOR DEMANDS SHOWN AT ANY ELEVATION IN THE BUILDING. (i.e.  $z/h \leq 1$ )
8. CONCRETE SLAB DETAIL VALID FOR DEMANDS SHOWN AT OR BELOW GRADE. (i.e.  $z/h = 0$ )
9. **RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING**
  - A. PROVIDE SUPPORTING STRUCTURE TO SUPPORT WEIGHTS AND FORCES SHOWN IN ADDITION TO ALL OTHER LOADS.
  - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2022 CBC AND WITH THE DETAILS, MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
  - C. VERIFY THAT PROJECT SPECIFIC VALUES OF  $S_{ds}$  &  $z/h$  RESULT IN SEISMIC FORCES ( $E_h$ ,  $E_v$ ) THAT DO NOT EXCEED THE VALUES ON THE DETAILS.
  - D. VERIFY THAT THE CONCRETE SLAB TO WHICH THE EQUIPMENT IS ANCHORED MEETS THE REQUIREMENTS OF THE APPLICABLE ICC ESR REPORT. AND THIS OPM.
  - E. VERIFY THAT THE ANCHORS ARE AN ADEQUATE DISTANCE FROM ANY SLAB EDGES OR OPENINGS (SEE TYPICAL DETAIL ON SHEET 2).
  - F. VERIFY THAT ALL NEW OR EXISTING ANCHORS ARE AN ADEQUATE DISTANCE FROM THE UNIT ATTACHMENTS AND CHECK FOR INTERACTION WHERE OTHER ANCHORS ARE WITHIN 18" OR  $6h_{ef}$  FROM THIS UNIT'S ANCHORS.



## CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

**2**

JOB NO. **11-2314**

## STANDARD & UNIVERSAL RACKS

DATE **8/7/23**

OF **15** SHEETS

### 10. EXPANSION ANCHORS:

- A. ATTACHMENT IS TO BE MADE WITH THE ANCHORS LISTED BELOW AND INSTALLED AS DESCRIBED IN THE CORRESPONDING ICC REPORT.

Anchor Diameter	Concrete Type	Min. f'c (psi)	Anchor Type	ICC Report No.	Min. Embed.	Min. Spacing	Min. Edge Dist.	Min. Conc. Thickness	Torque Test	Direct Tension Test
3/8"	Sand Light Weight	3000	Hilti Kwik Bolt TZ2 (CARBON STEEL)	ESR-4266	2"	6.75"	12"	See Detail "A"	30 FT-LB	N/A
5/8"	Normal Weight	3000	Hilti Kwik Bolt TZ2 (CARBON STEEL)	ESR-4266	6"	12"	26"	6"	40 FT-LB	4538 lb

- B. THIS PREAPPROVAL ALLOWS FOR UP TO A MAXIMUM OF 2 ADJACENT CONCRETE SLAB EDGES, 26" AWAY MINIMUM (i.e. - CORNER). SEE ADJACENT DETAIL FOR ADDITIONAL MINIMUM ALLOWABLE CONCRETE EDGE DISTANCES.

- C. TESTING AND SPECIAL INSPECTION OF EXPANSION ANCHORS SHALL BE PERFORMED BY AN APPROVED INDEPENDENT AGENCY EMPLOYED BY THE FACILITY OWNER PER CBC 1704A & 1910A.5 AND CAC 7-149. ALL REPORTS SHALL BE SENT TO THE INSPECTOR OF RECORD, OWNER AND THE ARCHITECT OR ENGINEER IN RESPONSIBLE CHARGE.

- (i) AFTER AT LEAST 24 HOURS HAVE ELAPSED SINCE INSTALLATION, DIRECT PULL TENSION TEST OR TORQUE TEST AT LEAST 50% OF THE ANCHORS.

- (ii) ACCEPTANCE CRITERIA:

- DIRECT TENSION TEST: THE ANCHOR SHOULD HAVE NO OBSERVABLE MOVEMENT AT THE TEST LOAD. A PRACTICAL WAY TO DETERMINE OBSERVABLE MOVEMENT IS THAT THE WASHER BECOMES LOOSE.
- TORQUE TEST: THE APPLICABLE TORQUE MUST BE ACHIEVED WITHIN THE FOLLOWING LIMITS: WEDGE TYPE : 1/2 TURN OF THE NUT


- (iii) IF ANY ANCHOR FAILS, TEST ALL ANCHORS.

- D. AVOID DAMAGING EXISTING STEEL REINFORCING IN CONCRETE SLAB WHEN INSTALLING CONCRETE EXPANSION ANCHORS.

- E. PROVIDE FOR FULL THREAD ENGAGEMENT OF NUT & WASHER.

### 11. BOLTS THROUGH CONCRETE ON METAL DECK

- A. BOLTS SHALL BE TORQUED BY 3/4 TURN OF THE NUTS AFTER THE SNUG TIGHT (THE SNUG-TIGHT CONDITION IS DEFINED AS THE TIGHTNESS REQUIRED TO BRING THE CONNECTED PLIES INTO FIRM CONTACT) CONDITION IS ACHIEVED, UNLESS OTHERWISE NOTED.
- B. THROUGH BOLT HOLES SHALL BE 1/16" LARGER THAN BOLT SIZE (HOLE SIZE = BOLT SIZE + 1/16) FOR CONCRETE.
- C. THROUGH-BOLTS IN CONCRETE SHALL RECEIVE SPECIAL INSPECTION AND TESTING (THROUGH BOLTS WITH STEEL TO STEEL CONNECTION IN TENSION DO NOT REQUIRE TENSION TESTING) IN ACCORDANCE WITH REQUIREMENTS FOR POST-INSTALLED ANCHORS.

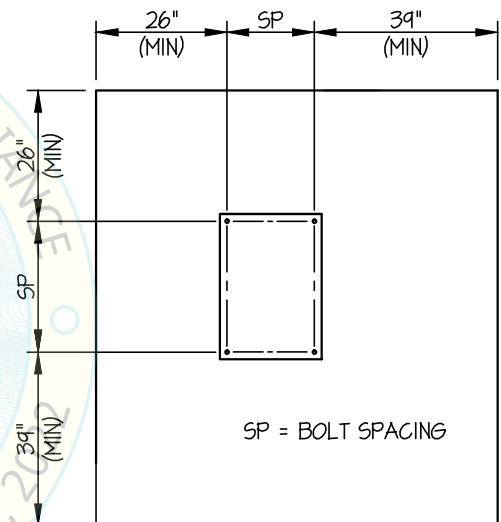

TYPICAL CONCRETE EDGE DETAIL  
(SLAB ON GRADE ONLY)



### CHATSWORTH PRODUCTS, INC

DES. J. ROBERSON

SHEET

3

### STANDARD & UNIVERSAL RACKS


JOB NO. 11-2314

DATE 8/7/23

OF 15 SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

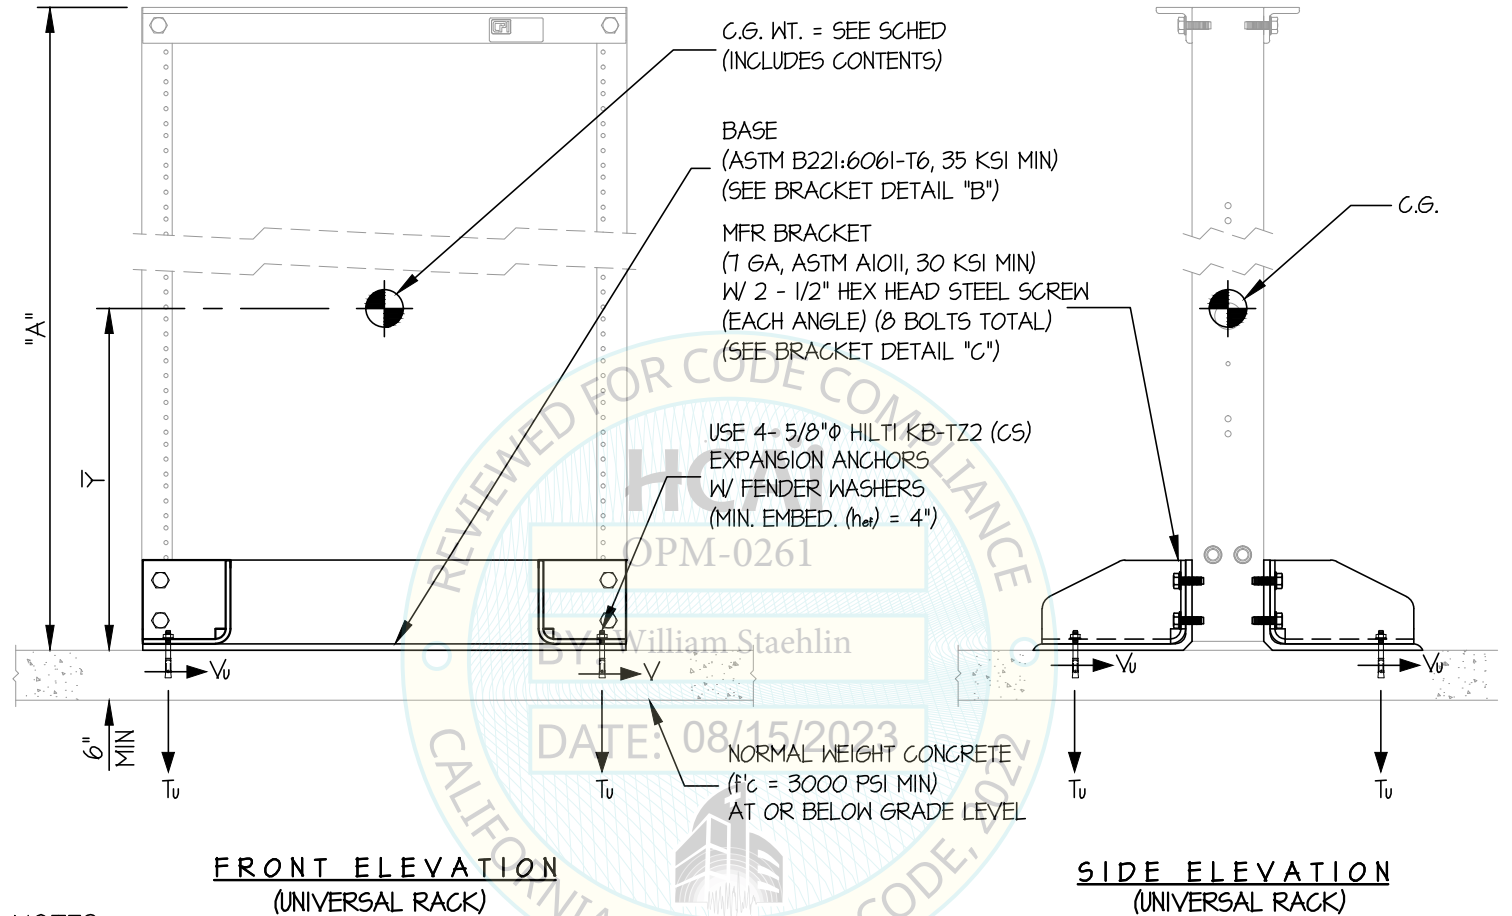

**FRONT ELEVATION**  
(UNIVERSAL RACK)

**SIDE ELEVATION**  
(UNIVERSAL RACK)

**NOTES:**

1. FORCES ARE DETERMINED PER 2022 CALIFORNIA BUILDING CODE AND ASCE 7-16.

STRENGTH DESIGN IS USED. (EXAMPLE:  $S_{Ds} = 2.30$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_0 = 2.0$ ,  $z/h = 0$ )

HORIZONTAL FORCE ( $E_h$ ) =  $1.035 W_p$

HORIZONTAL FORCE ( $E_{mh}$ ) =  $2.07 W_p$  (FOR CONCRETE ANCHORAGE)


VERTICAL FORCE ( $E_v$ ) =  $0.46 W_p$

2. THIS CALCULATION ENCOMPASSES WEIGHTS AND VERTICAL C.G. POSITIONS NOT EXCEEDING VALUES SHOWN.

3. THIS CALCULATION WAS PREPARED WITHOUT KNOWLEDGE OF ANY SITE CONDITION. COMPATIBILITY FOR USE WITH A SITE SHALL BE EVALUATED BY THE STRUCTURAL ENGINEER OF RECORD OF THE INSTALLATION (SEOR). USE REQUIRES APPROVAL BY THE SEOR.

4. STRUCTURAL ENGINEER OF RECORD FOR THE INSTALLATION SHALL VERIFY ALL CONDITIONS, EVALUATE INTERACTION WITH ADJACENT EQUIPMENT AND ANCHORS, AND PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.

5. SEE GENERAL NOTES: SHEETS 1 AND 2

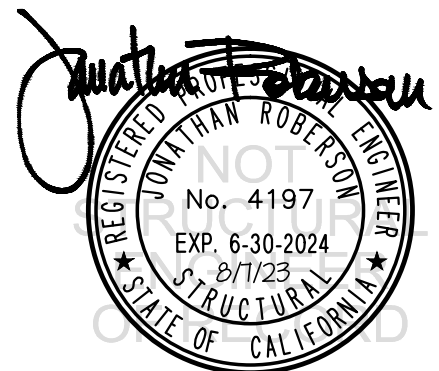

### CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

**4**

### STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

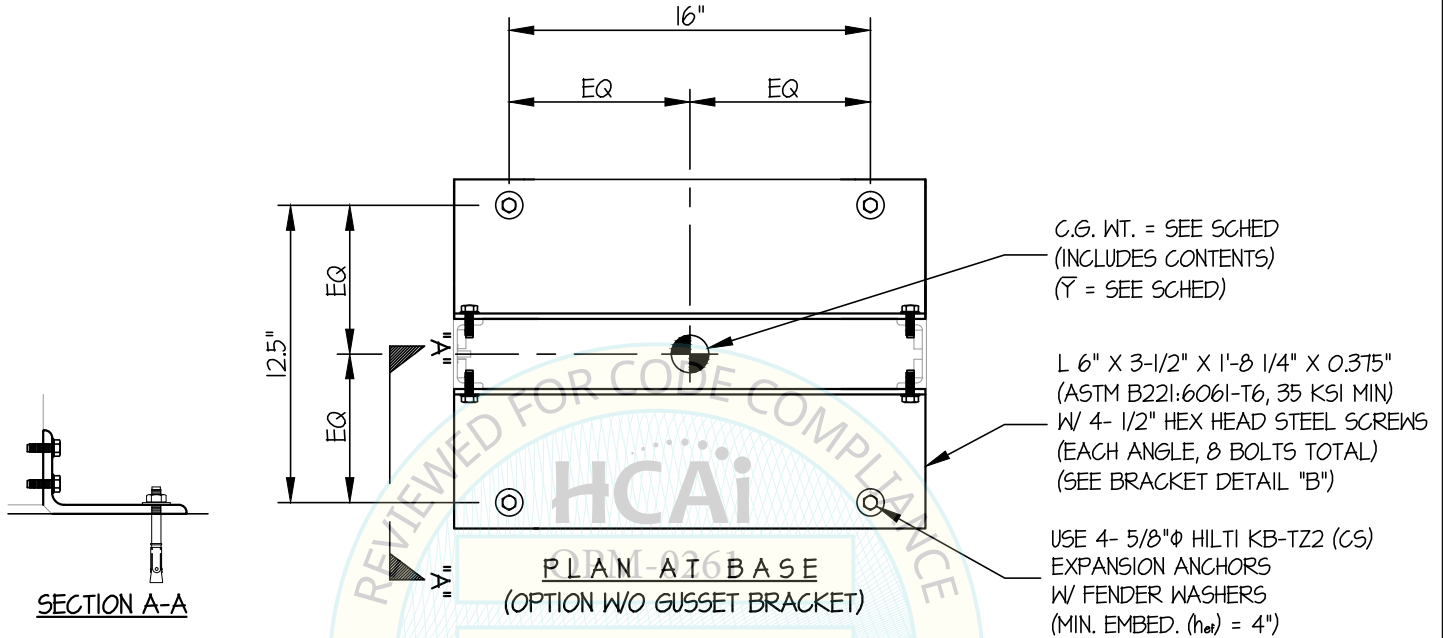

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	** Tu (lb.)	** Vu (lb.)
46353-X03 / 48353-X03	164	36	84	44	3275	110
46353-X05 / 48353-X05	144	37	90	47	3089	97
46353-X15 / 48353-X15	124	39	96	50	2843	83

\*\* (VALUES INCLUDE  $\Omega$ )

*Jonathan Roberson*

REGISTERED PROFESSIONAL ENGINEER  
JONATHAN ROBERSON  
No. 4197  
EXP. 6-30-2024  
8/7/23  
STRUCTURAL  
STATE OF CALIFORNIA

### CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

**5**

### STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

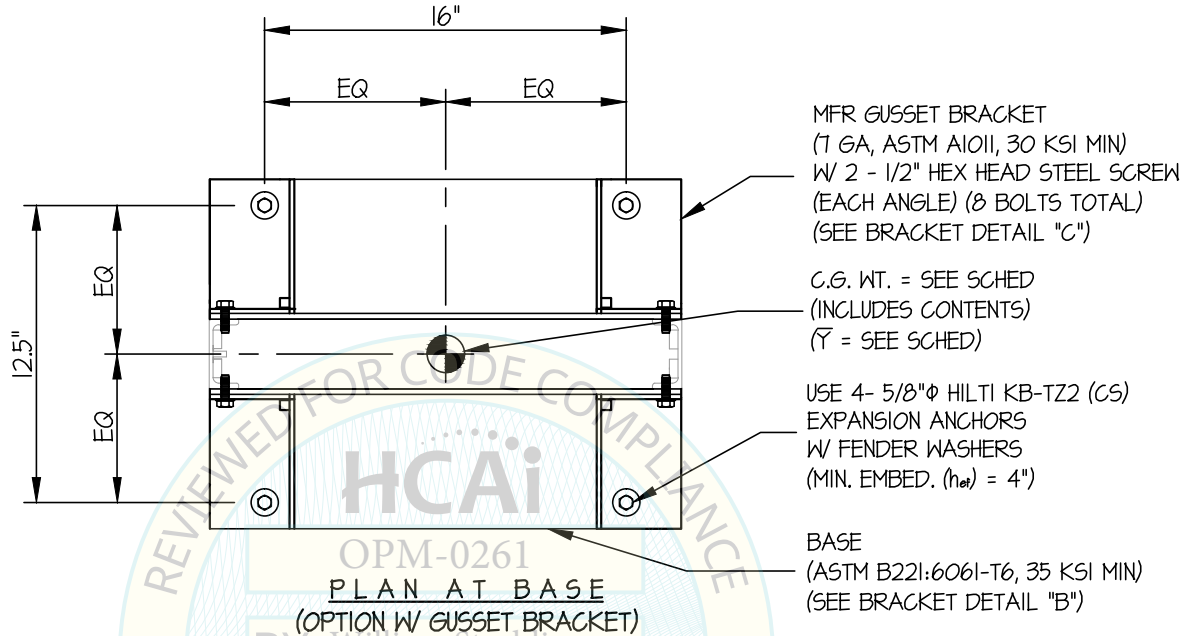

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	** $T_u$ (lb.)	** $V_u$ (lb.)
46353-X03 / 48353-X03	339	44	84	44	1487	228
46353-X05 / 48353-X05	157	45	90	47	737	106
46353-X15 / 48353-X15	129	47	96	50	645	87

\*\* (VALUES INCLUDE  $\Omega$ )



## CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

**6**

## STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

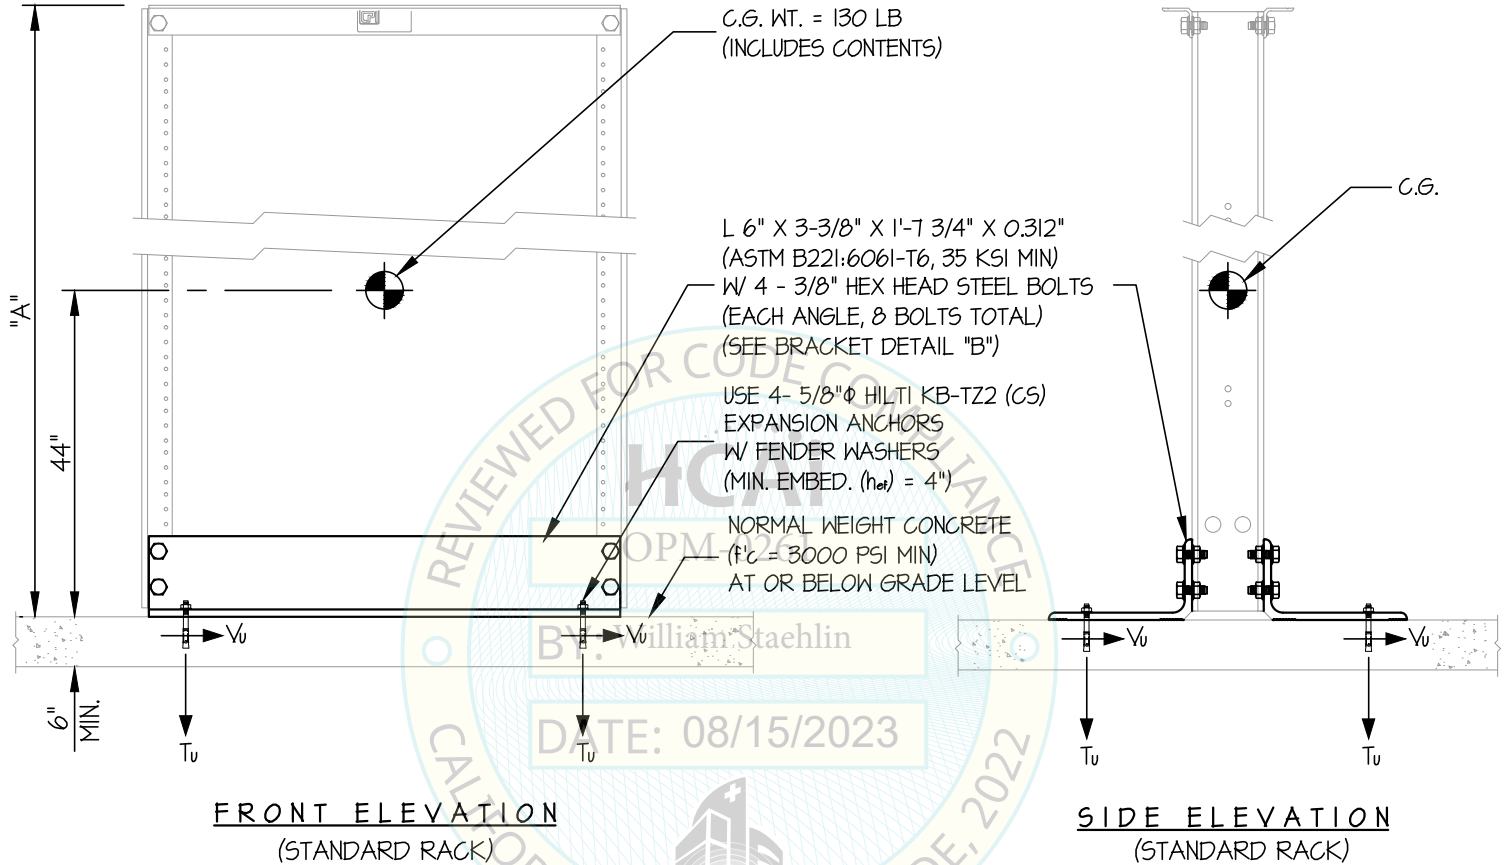

**FRONT ELEVATION**  
(STANDARD RACK)


**SIDE ELEVATION**  
(STANDARD RACK)

**NOTES:**

- FORCES ARE DETERMINED PER 2022 CALIFORNIA BUILDING CODE AND ASCE 7-16. STRENGTH DESIGN IS USED. (EXAMPLE:  $S_{Ds} = 2.30$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_0 = 2.0$ ,  $z/h = 0$ )

HORIZONTAL FORCE ( $E_h$ ) =  $1.035 W_p$   
 HORIZONTAL FORCE ( $E_{mh}$ ) =  $2.07 W_p$  (FOR CONCRETE ANCHORAGE)  
 VERTICAL FORCE ( $E_v$ ) =  $0.46 W_p$

- THIS CALCULATION ENCOMPASSES WEIGHTS AND VERTICAL C.G. POSITIONS NOT EXCEEDING VALUES SHOWN.
- THIS CALCULATION WAS PREPARED WITHOUT KNOWLEDGE OF ANY SITE CONDITION. COMPATIBILITY FOR USE WITH A SITE SHALL BE EVALUATED BY THE STRUCTURAL ENGINEER OF RECORD OF THE INSTALLATION (SEOR). USE REQUIRES APPROVAL BY THE SEOR.
- STRUCTURAL ENGINEER OF RECORD FOR THE INSTALLATION SHALL VERIFY ALL CONDITIONS, EVALUATE INTERACTION WITH ADJACENT EQUIPMENT AND ANCHORS, AND PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEETS 1 AND 2

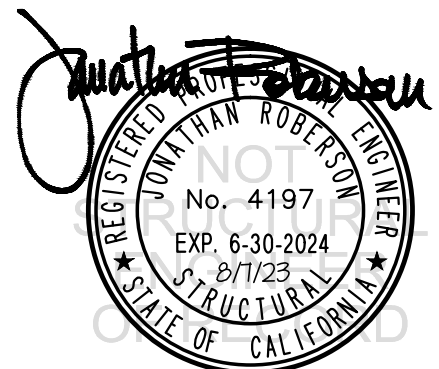



### CHATSWORTH PRODUCTS, INC

DES. J. ROBERSON

SHEET

7

### STANDARD & UNIVERSAL RACKS


JOB NO. 11-2314

DATE 8/7/23

OF 15 SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

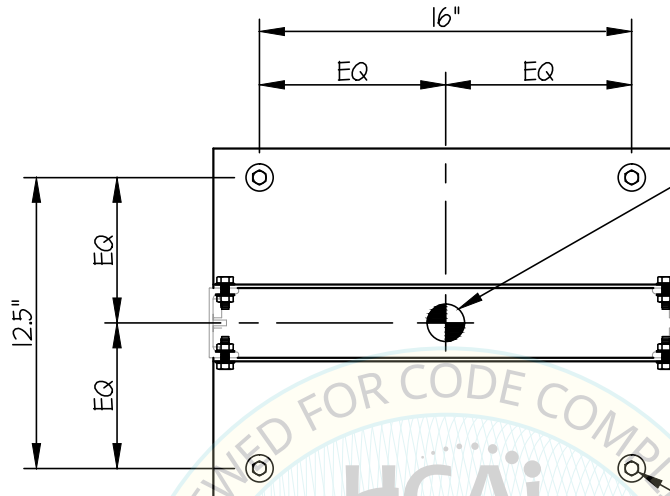

C.G. WT. = 130 LB  
(INCLUDES CONTENTS)  
( $\bar{Y}$  = 44")

STD BRACKET  
L 6" X 3-3/8" X 1'-7 3/4" X 0.312"  
(ASTM B221:6061-T6, 35 KSI MIN)  
W 4 - 3/8" HEX HEAD STEEL BOLTS  
(EACH ANGLE, 8 BOLTS TOTAL)  
(SEE BRACKET DETAIL "B")

USE 4- 5/8"  $\phi$  HILTI KB-TZ2 (CS)  
EXPANSION ANCHORS  
W FENDER WASHERS  
(MIN. EMBED. ( $h_{ef}$ ) = 4")

PLAN AT BASE  
(STANDARD RACK)

BY: William Staehlin

MODEL NUMBER (STANDARD RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	** T <sub>u</sub> (lb.)	** V <sub>u</sub> (lb.)
55053-X03	130	25	84	44	2598	87
55053-X15	122	32	96	47	2617	82
55053-X08	105	35	108	50	2407	71

\*\* (VALUES INCLUDE  $\Omega$ )



### CHATSWORTH PRODUCTS, INC

DES. J. ROBERSON

SHEET

8

### STANDARD & UNIVERSAL RACKS


JOB NO. 11-2314

DATE 8/7/23

OF 15 SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE DETAILS

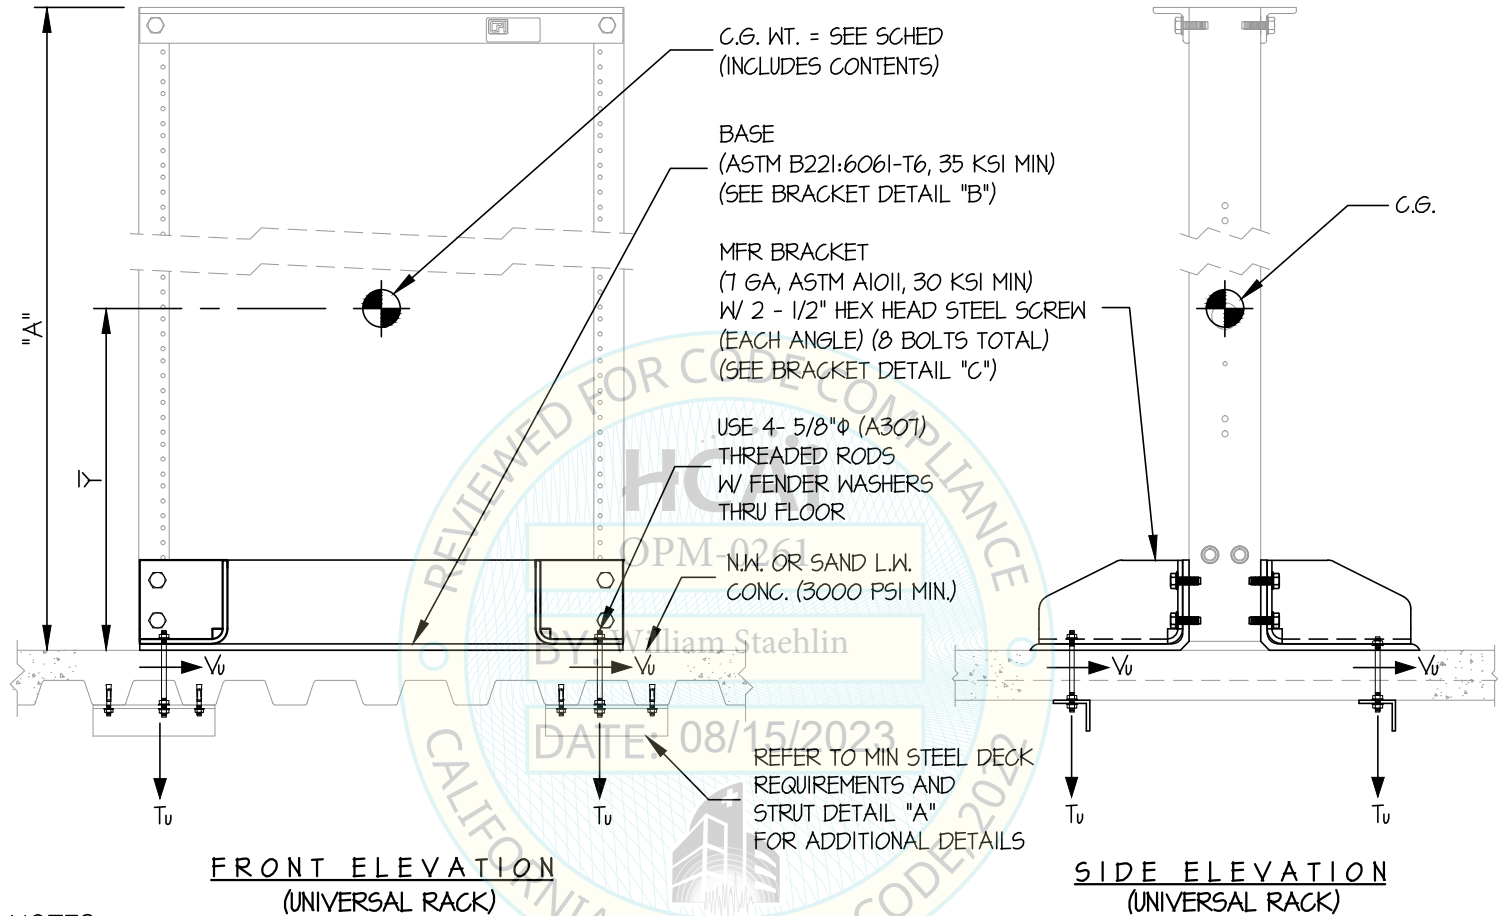


FRONT ELEVATION  
(UNIVERSAL RACK)

SIDE ELEVATION  
(UNIVERSAL RACK)

NOTES:

- FORCES ARE DETERMINED PER 2022 CALIFORNIA BUILDING CODE AND ASCE 7-16. STRENGTH DESIGN IS USED. (EXAMPLE:  $S_{Ds} = 2.30$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_0 = 2.0$ ,  $z/h \leq 1$ )
  - HORIZONTAL FORCE ( $E_h$ ) =  $1.73 W_p$
  - HORIZONTAL FORCE ( $E_{mh}$ ) =  $3.46 W_p$  (FOR CONCRETE ANCHORAGE)
  - VERTICAL FORCE ( $E_v$ ) =  $0.46 W_p$
- THIS CALCULATION ENCOMPASSES WEIGHTS AND VERTICAL C.G. POSITIONS NOT EXCEEDING VALUES SHOWN.
- THIS CALCULATION WAS PREPARED WITHOUT KNOWLEDGE OF ANY SITE CONDITION. COMPATIBILITY FOR USE WITH A SITE SHALL BE EVALUATED BY THE STRUCTURAL ENGINEER OF RECORD OF THE INSTALLATION (SEOR). USE REQUIRES APPROVAL BY THE SEOR.
- STRUCTURAL ENGINEER OF RECORD FOR THE INSTALLATION SHALL VERIFY ALL CONDITIONS, EVALUATE INTERACTION WITH ADJACENT EQUIPMENT AND ANCHORS, AND PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEETS 1 AND 2

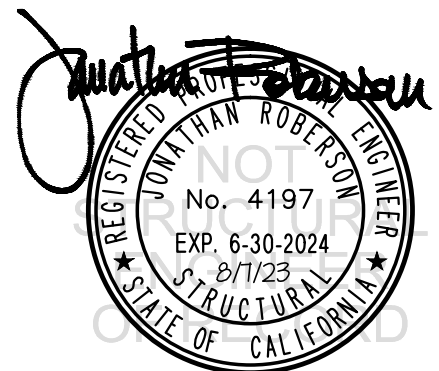

## CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

**9**

## STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BRACKET DETAILS

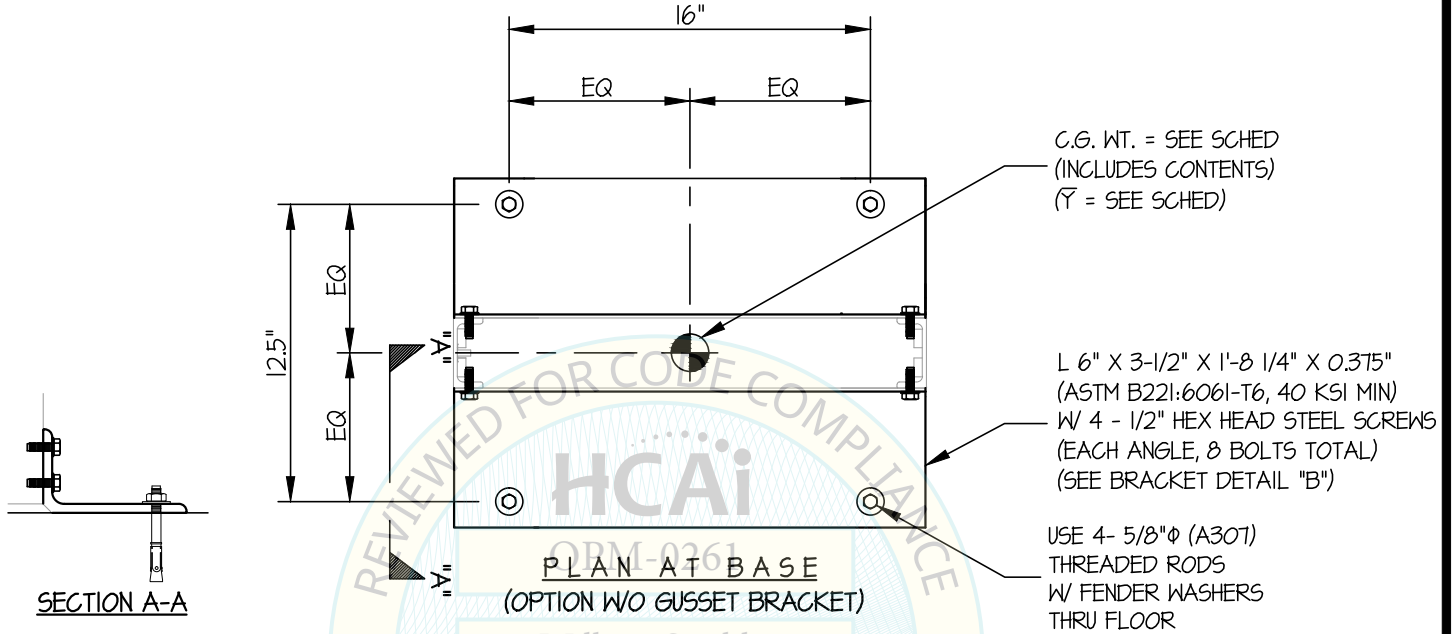

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	** Tu (lb.)	** Vu (lb.)
46353-X03 / 48353-X03	164	36	84	44	2725	92
46353-X05 / 48353-X05	144	37	90	47	2569	81
46353-X15 / 48353-X15	124	39	96	50	2365	70

\*\* (VALUES DO NOT INCLUDE  $\Omega$ )



## CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

**10**

## STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS


SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB ON METAL DECK

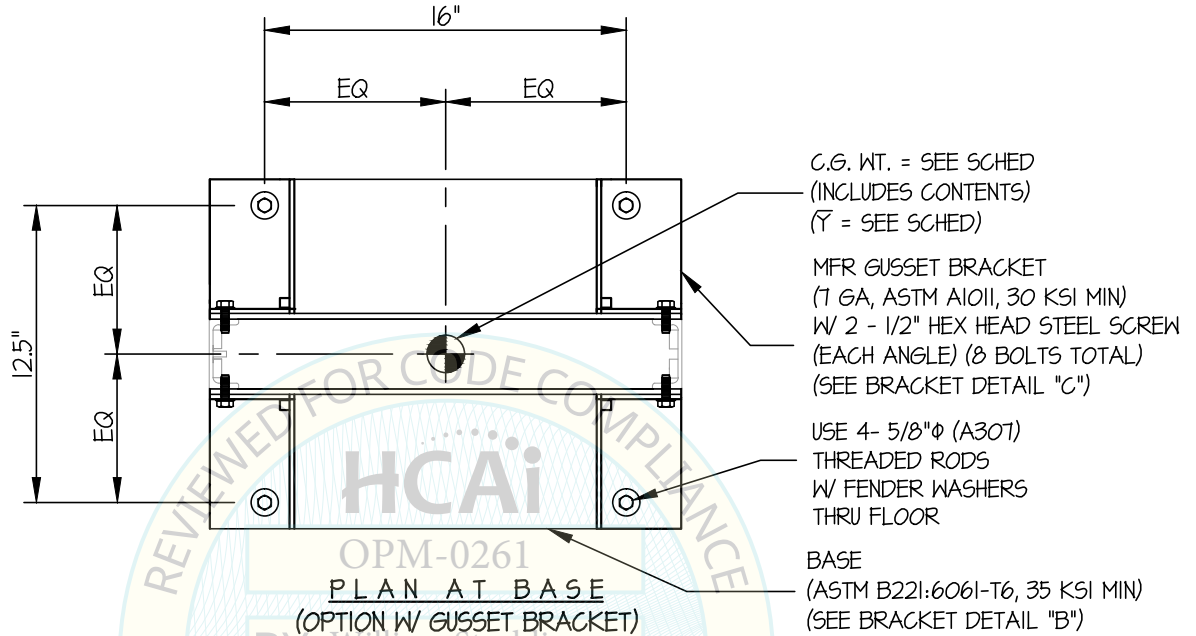

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	** Tu (lb.)	** Vu (lb.)
46353-X03 / 48353-X03	339	44	84	44	1257	191
46353-X05 / 48353-X05	157	45	90	47	613	88
46353-X15 / 48353-X15	129	47	96	50	537	73

\*\* (VALUES DO NOT INCLUDE  $\Omega$ )

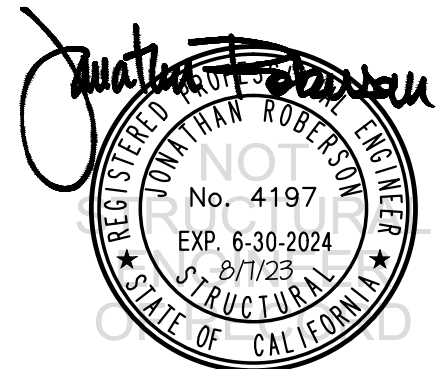

### CHATSWORTH PRODUCTS, INC

DES. J. ROBERSON

SHEET

11

### STANDARD & UNIVERSAL RACKS


JOB NO. 11-2314

DATE 8/7/23

OF 15 SHEETS


SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB ON METAL DECK

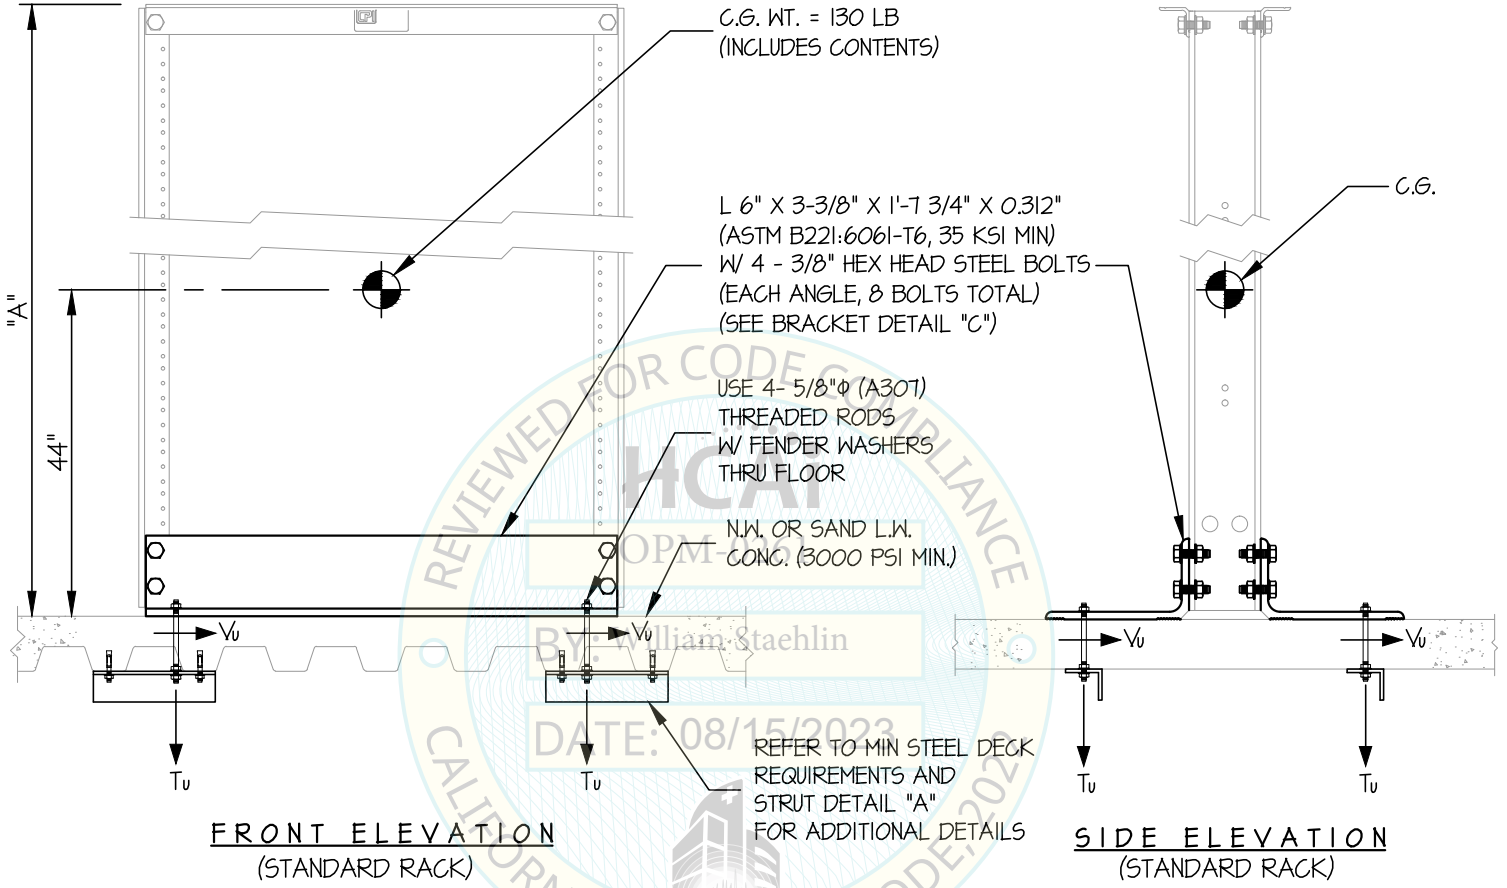

NOTES:

- FORCES ARE DETERMINED PER 2022 CALIFORNIA BUILDING CODE AND ASCE 7-16. STRENGTH DESIGN IS USED. (EXAMPLE:  $S_{Ds} = 2.30$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_0 = 2.0$ ,  $z/h \leq 1$ )
  - HORIZONTAL FORCE ( $E_h$ ) =  $1.73 W_p$
  - HORIZONTAL FORCE ( $E_{mh}$ ) =  $3.46 W_p$  (FOR CONCRETE ANCHORAGE)
  - VERTICAL FORCE ( $E_v$ ) =  $0.46 W_p$
- THIS CALCULATION ENCOMPASSES WEIGHTS AND VERTICAL C.G. POSITIONS NOT EXCEEDING VALUES SHOWN.
- THIS CALCULATION WAS PREPARED WITHOUT KNOWLEDGE OF ANY SITE CONDITION. COMPATIBILITY FOR USE WITH A SITE SHALL BE EVALUATED BY THE STRUCTURAL ENGINEER OF RECORD OF THE INSTALLATION (SEOR). USE REQUIRES APPROVAL BY THE SEOR.
- STRUCTURAL ENGINEER OF RECORD FOR THE INSTALLATION SHALL VERIFY ALL CONDITIONS, EVALUATE INTERACTION WITH ADJACENT EQUIPMENT AND ANCHORS, AND PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEETS 1 AND 2

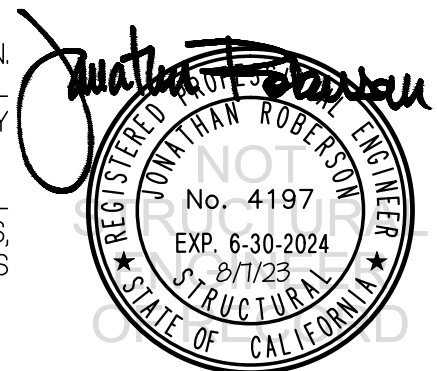

### CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

# 12

### STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB ON METAL DECK

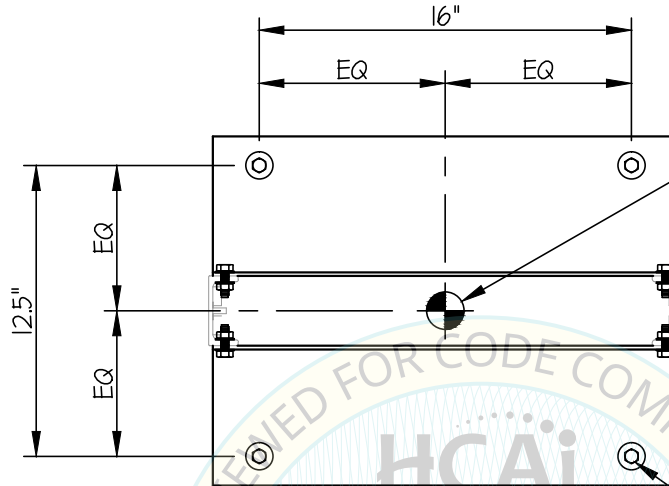

C.G. WT. = 130 LB  
(INCLUDES CONTENTS)  
( $\bar{Y}$  = 44")

L 6" X 3-3/8" X 1'-1 3/4" X 0.312"  
(ASTM B221:6061-T6, 35 KSI MIN)  
W/ 4 - 3/8" HEX HEAD STEEL BOLTS  
(EACH ANGLE, 8 BOLTS TOTAL)  
(SEE SHEET 12 OF 13)

USE 4- 5/8"Φ (A307)  
THREADED RODS  
W/ FENDER WASHERS  
THRU FLOOR

PLAN AT BASE  
(STANDARD RACK)

MODEL NUMBER (STANDARD RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	** Tu (lb.)	** Vu (lb.)
55053-X03	130	25	84	44	2160	73
55053-X15	122	32	96	47	2176	69
55053-X08	105	35	108	50	2003	59

\*\* (VALUES DO NOT INCLUDE  $\Omega$ )



## CHATSWORTH PRODUCTS, INC

DES. **J. ROBERSON**

SHEET

# 13

## STANDARD & UNIVERSAL RACKS


JOB NO. **11-2314**

DATE **8/7/23**


OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE DETAILS

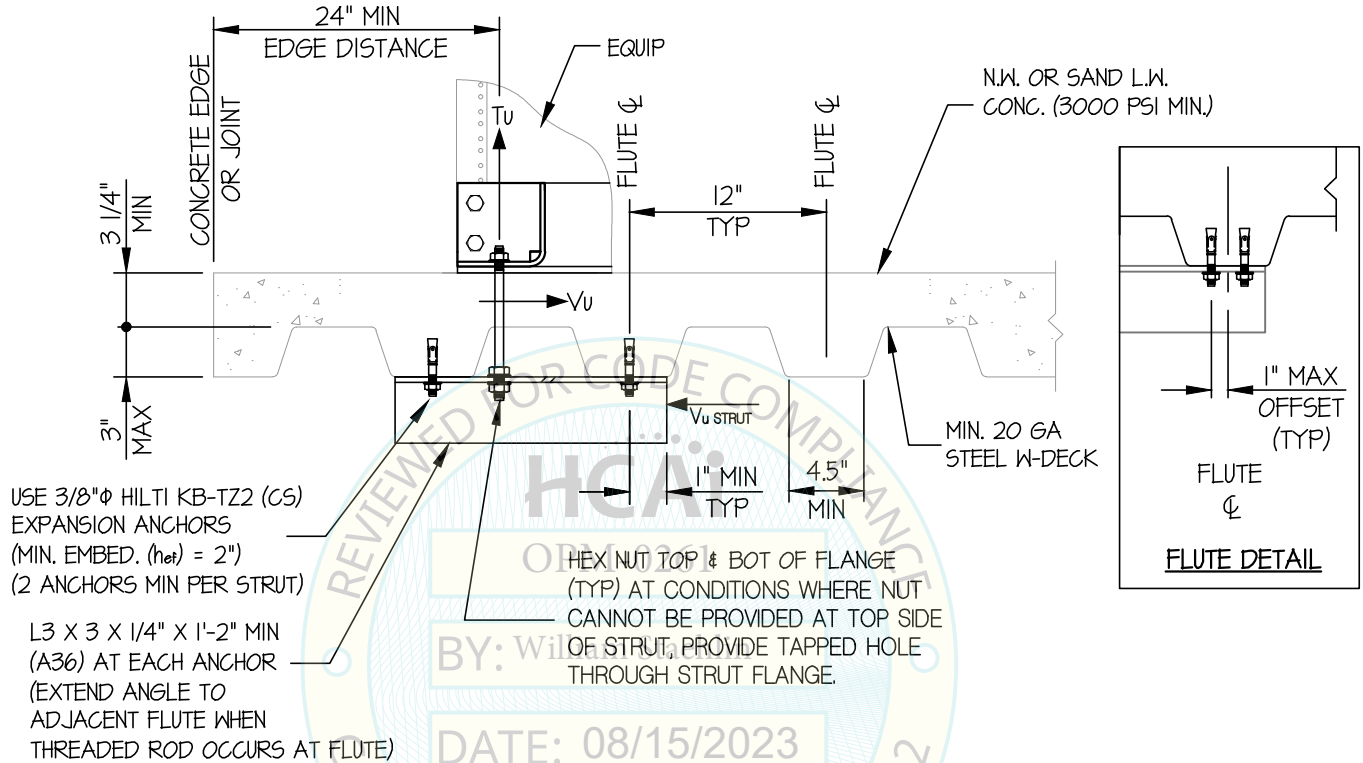

MIN STEEL DECK REQUIREMENTS AND STRUT DETAIL (A)

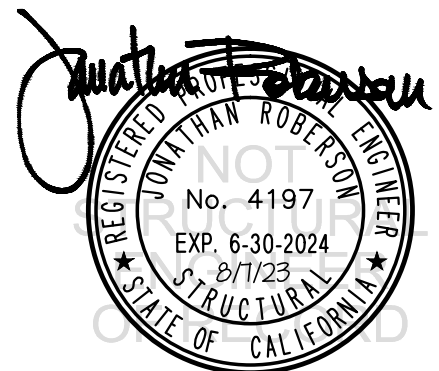

### CHATSWORTH PRODUCTS, INC

DES. J. ROBERSON

SHEET

14

### STANDARD & UNIVERSAL RACKS

JOB NO. 11-2314

DATE 8/7/23

OF 15 SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BRACKET DETAILS

STD = STD RACK 55053-X03  
UNIV = UNIVERSAL RACK

0.312" THK (STD)

0.375" THK (UNIV)


BENT ANGLE: ASTM B221 6064-T6 AL, 35 KSI MIN

0.405" (STD)  
0.70" (UNIV)

18.37" (STD)


18.85" (UNIV)

(2)- 3/4"φ HOLES (TYP)

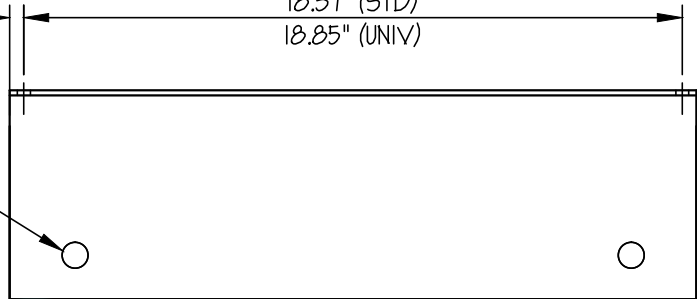

PLAN

(4)- 3/8"φ BOLTS (STD)  
(4)- 1/2"φ SCREWS (UNIV)

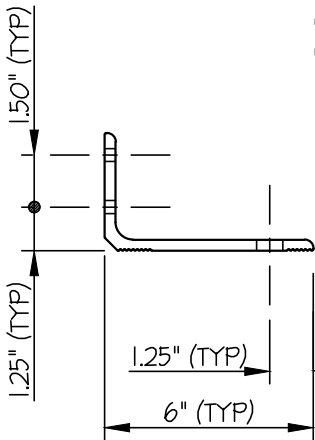

SIDE

3.375" (STD)  
3.5" (UNIV)

1.875" (STD)  
2.125" (UNIV)



16" (TYP)

19.75" (STD)

20.25" (UNIV)

BRACKET DETAIL (B)

ELEVATION

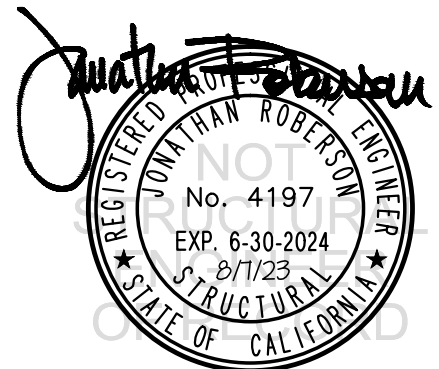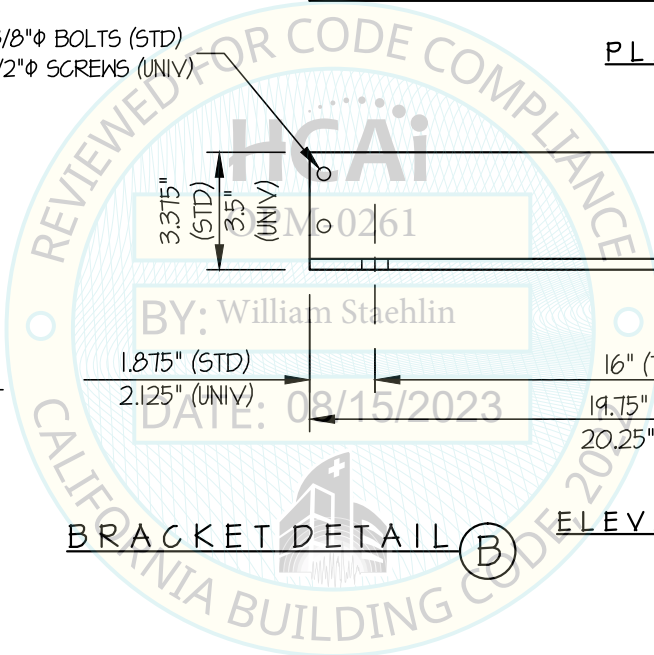



**CHATSWORTH PRODUCTS, INC**

DES. **J. ROBERSON**

SHEET

**15**

**STANDARD & UNIVERSAL RACKS**


JOB NO. **11-2314**

DATE **8/7/23**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BRACKET DETAILS

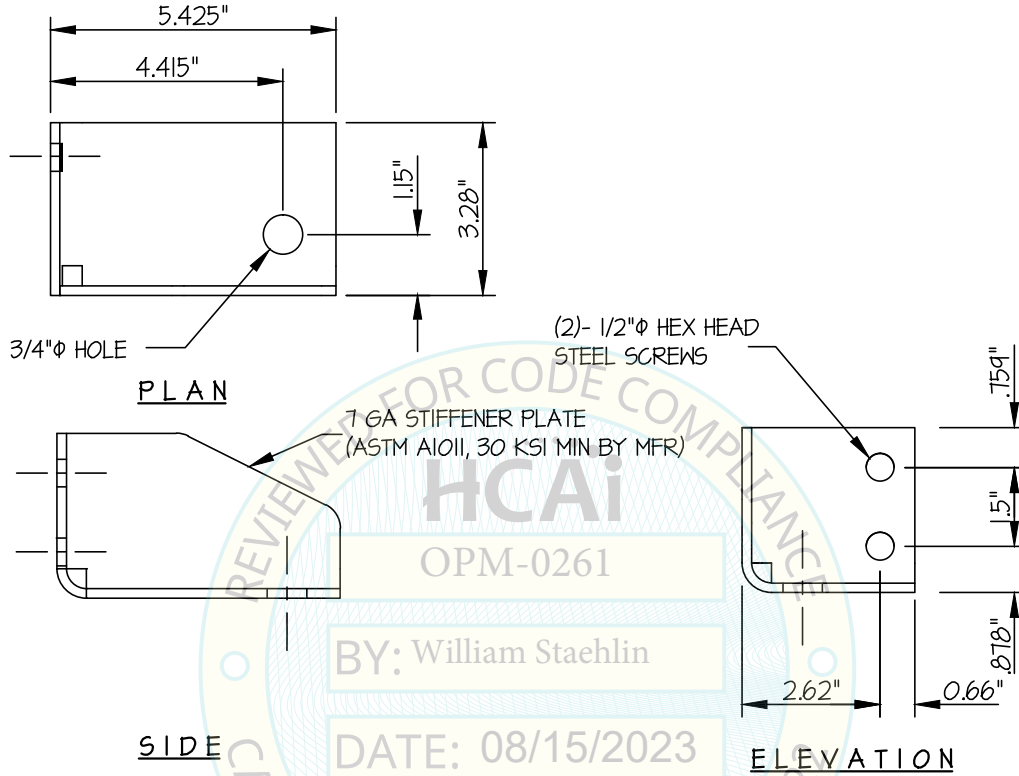

GUSSET BRACKET FOR UNIVERSAL RACK

BRACKET DETAIL (C)

