

APPLICATION FOR OSHPD PREAPPROVAL OF

OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT FACILITIES DEVELOPMENT DIVISION

MANUFACTURER'S CERTIFICATION (OPM) APPLICATION #: OPM-0416-13
OSHPD Preapproval of Manufacturer's Certification (OPM)
Type: ☐ New ☐ Renewal ☐ Update to Pre-CBC 2013 OPA Number:
Manufacturer Information
Manufacturer: AMICO CORPORATION
Manufacturer's Technical Representative: Paul Tilcox
Mailing Address:85 Fulton Way, Richmond Hill, ONT, L4B 2N4 Canada
Telephone: On File Email: On File
Product Information OS Dod
Product Name: Serenity Series Panel Wall (Surface Mount)
Product Type: Other mechanical and electrical components
Product Model Number: 3 panel system; widths from 16"-60" per panel; height at 120" max
General Description: Headwall system providing lighting, electrical and med gas services
DATE: 09/28/2018
Applicant Information
Applicant Company Name: EASE Co. BUILDING
Contact Person: Jonathan Roberson, S.E.
Mailing Address:5877 Pine Ave. Suite 210, Chino Hills, CA. 91709
Telephone: (909) 606-7622 Email: J.Roberson@EASECo.com
I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2016.
Signature of Applicant: Date: 4/5/17
Title: Principal Engineer Company Name: EASE Co.

"Access to Safe. Quality Healthcare Environments that Meet





OFFICE USE ONLY



OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT FACILITIES DEVELOPMENT DIVISION

Registered Design Professional Preparing Engineering Recommendations
Company Name: EASE Co.
Name: Jonathan Roberson, S.E. California License Number: S4197
Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709
Telephone: 909-606-7622 Email: <u>J.Roberson@EASECo.com</u>
OSHPD Special Seismic Certification Preapproval (OSP)
 ☐ Special Seismic Certification is preapproved under OSP- (Separate application for OSP is required) ☑ Special Seismic Certification is not preapproved
Certification Method(s)
☐ Testing in accordance with: ☐ ICC-ES AC156 ☐ FM 1950-16 ☐ Other* (Please Specify): ☐ OPN-0416-13
*Use of criteria other than those adopted by the California Building Standards Code, 2016 (CBSC 2016) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2016 may be used when approved by OSHPD prior to testing. Analysis DATE: 09/28/2018
Experience Data
Combination of Testing, Analysis, and/or Experience Data (Please Specify):
List of Attachments Supporting the Manufacturer's Certification
 ☐ Test Report ☐ Other(s) (Please Specify): Manufacturer's Catalog
OFFICE USE ONLY – OSHPD APPROVAL VALID FOR CBC 2016 & ALL PRE-2016 CODE BASED PROJECTS
Signature:
Condition of Approval (if applicable):

"Access to Safe, Quality Healthcare Environments that Meet





Page 2 of 2



EQUIPMENT ANCHORAGE & SEISMIC ENGINEERING

5877 Pine Ave, Ste. 210 Chino Hills, CA. 91709 Phn: (909) 606-7622

Office of Statewide Health Planning and Development
PREAPPROVAL OF MANUFACTURER'S CERTIFICATION
OPM-0416-13

THIS PREAPPROVAL CONFORMS TO THE 2016 CALIFORNIA BUILDING CODE

MANUFACTURER:

AMICO CORPORATION

Sheet: 1 of 5


EQUIPMENT NAME:

SERENITY SERIES PANEL WALL (SURFACE MOUNTED)

Date: 5/31/18

GENERAL NOTES

- 1. THIS OSHPD PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2016 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2016 CBC
- 2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
- 3. THIS PREAPPROVAL CONFORMS TO THE 2016 CALIFORNIA BUILDING CODE.
- 4. FORCES PER ASCE 7-10 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3, WHERE SDS = 2.20, $a_p = 1.0$, $I_p = 1.5$, $R_p = 1.5$, $I_p = 1.5$, I
- 5. THE DETAILS IN THIS PREAPPROVAL MAY BE USED AT ANY LOCATION IN THE STATE OF CALIFORNIA, WHERE SDS IS NOT GREATER THAN 2.20.
- 6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
- 7. SHEET METAL SCREWS SHALL BE TEKS SCREWS BY ITW BUILDEX (ICC ESR-1976).
- 8. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
- 9. RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING
 - A. PROVIDE SUPPORTING STRUCTURE REQUIRED TO SUPPORT WEIGHTS AND FORCES SHOWN, IN ADDITION TO ALL OTHER LOADS.
 - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2016 CBC AND WITH THE DETAILS SHOWN IN THIS PREAPPROVAL. VERIFY THAT THE ACTUAL EQUIPMENT'S WEIGHT, CG LOCATION, ANCHOR LOCATIONS, ANCHOR DETAILS AND THE MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
 - C. VERIFY THAT THE COMBINATION OF SDS & z/h RESULT IN SEISMIC FORCES (Eh , Ev) THAT ARE NOT GREATER THAN THE VALUES ON THE DETAILS.
 - D. DESIGN BACKING BARS, STUDS, ETC. WHICH THE UNITS ARE ATTACHED TO AS NOTED ON THE DRAWINGS.



EQUIPMENT ANCHORAGE & SEISMIC ENGINEERING

www.EquipmentAnchorage.com

AMICO CORPORATION

SÉRENITY SERIES PANEL WALL (SURFACE MOUNTED)


DES. J. ROBERSON

JOB NO. 11-1704

DATE 5/31/18

SHEET 2

of <u>5</u> sheets

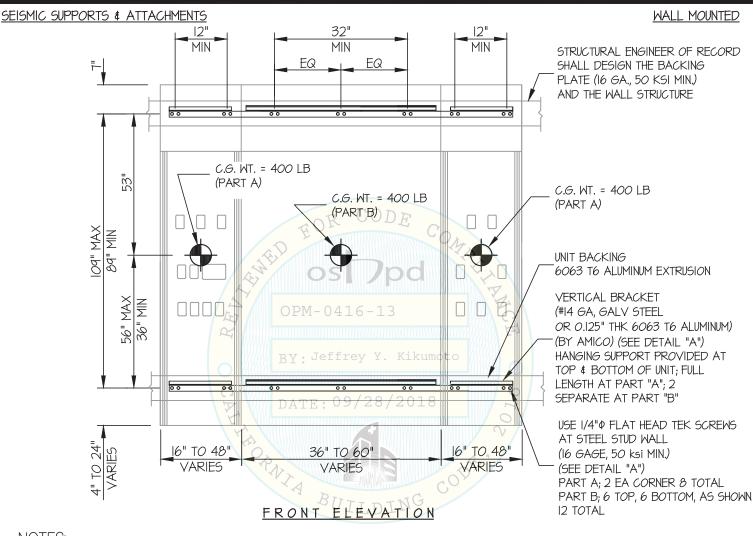


NOTES:

1. FORCES ARE DETERMINED PER 2016 CALIFORNIA BUILDING CODE AND ASCE 7-10.

STRENGTH DESIGN IS USED. (SDS = 2.20, Ap = 1.0, lp = 1.5, Rp = 1.5, Z/h < 1)

HORIZONTAL FORCE (Eh) = 2.64 Wp VERTICAL FORCE (Ev) = 0.44 Wp

- 2. CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- 3. STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN, IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- 4. SEE GENERAL NOTES: SHEETS 1



EQUIPMENT ANCHORAGE & SEISMIC ENGINEERING www.EquipmentAnchorage.com

AMICO CORPORATION

SÉRENITY SERIES PANEL WALL (SURFACE MOUNTED)


DES. J. ROBERSON

JOB NO. 11-1704

DATE 5/31/18

3

of 5 sheets

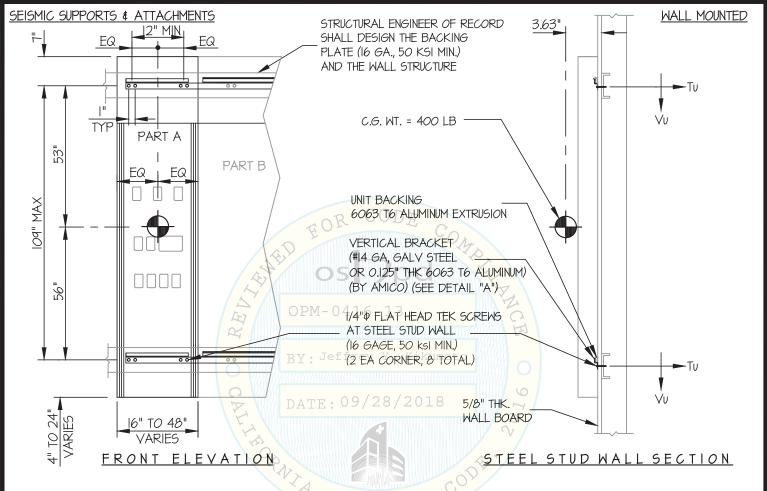


TOP SCREW FORCES (PART A)

Tu = 168 LB/SCREW (MAX) Vu = 159 LB/SCREW (MAX)

(VALUES DO NOT INCLUDE Ω)

BOT SCREW FORCES (PART A)

Tu = 186 LB/SCREW (MAX) Vu = 178 LB/SCREW (MAX) (VALUES DO NOT INCLUDE Ω_0)



EQUIPMENT ANCHORAGE & SEISMIC ENGINEERING

www.EquipmentAnchorage.com

AMICO CORPORATION

SÉRENITY SERIES PANEL WALL (SURFACE MOUNTED)

DES. J. ROBERSON


11-1704 JOB NO.

DATE

5/31/18

SHEET

SHEETS

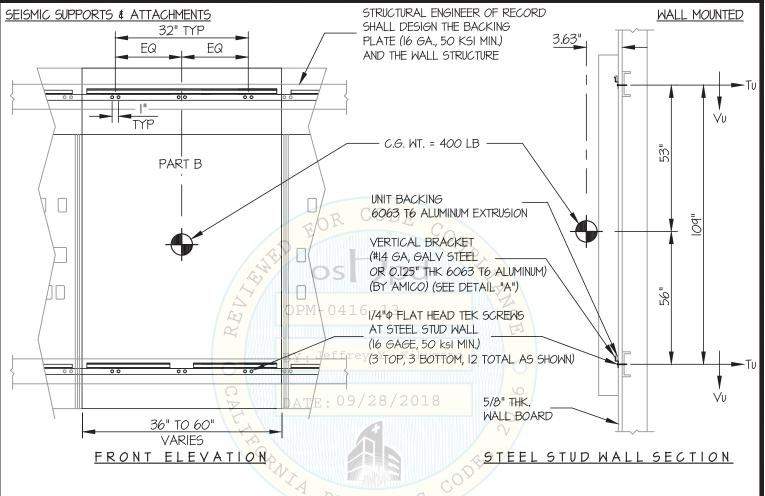

BUILDING

TOP SCREW FORCES (PART B)

Tu = 106 LB/SCREW (MAX) Vu = 106 LB/SCREW (MAX)

(VALUES DO NOT INCLUDE Ω)

BOT SCREW FORCES (PART B)

Tu = 116 LB/SCREW (MAX) Vu = 119 LB/SCREW (MAX) (VALUES DO NOT INCLUDE Ω)



EQUIPMENT ANCHORAGE & SEISMIC ENGINEERING

www.EquipmentAnchorage.com

AMICO CORPORATION

SEISMIC SUPPORTS & ATTACHMENTS

SÉRENITY SERIES PANEL WALL (SURFACE MOUNTED)

DES. J. ROBERSON

JOB NO. 11-1704

DATE 5/31/18

5

WALL MOUNTED

