



DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
FACILITIES DEVELOPMENT DIVISION

APPLICATION FOR HCAI PREAPPROVAL OF
MANUFACTURER'S CERTIFICATION (OPM)

OFFICE USE ONLY

APPLICATION #: OPM-0695

HCAI Preapproval of Manufacturer's Certification (OPM)

Type: New Renewal/Update

Manufacturer Information

Manufacturer: Strongarm Designs, Inc.

Manufacturer's Technical Representative: Arulselvi Selvaraja

Mailing Address: 425 Caredean Drive, Horsham, PA 19044

Telephone: (800) 778-7901

Email: aselvaraja@strongarm.com

Product Information

Product Name: Strongarm FPCW Workstation

OPM-0695

Product Type: Computer

Product Model Number: FPCW (Available Vertical Track Lengths: 18", 36", 48")

General Description: Wall mounted monitor and computer workstation

Applicant Information

Applicant Company Name: EASE LLC.

Contact Person: Tiffany Tonn

Mailing Address: 1515 FAIRVIEW AVE, STE 205, MISSOULA, MT 59801

Telephone: (406) 541-3273

Email: tiffany@easeco.com

Title: Office Manger

"A healthier California where all receive equitable, affordable, and quality health care"

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY





**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
FACILITIES DEVELOPMENT DIVISION**

Registered Design Professional Preparing Engineering Recommendations

Company Name: EASE LLC
Name: Jonathan Roberson California License Number: S4197
Mailing Address: 5877 Pine Ave., Suite 210, Chino Hills, CA 91709
Telephone: (951) 295-1892 Email: jon@EASECo.com

HCAI Special Seismic Certification Preapproval (OSP)

Special Seismic Certification is preapproved under OSP OSP Number: _____

Certification Method


Testing in accordance with: ICC-ES AC156 FM 1950-16
 Other(s) (Please Specify): _____

*Use of criteria other than those adopted by the California Building Standards Code, 2022 (CBSC 2022) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2022 may be used when approved by HCAI prior to testing.

Analysis
 Experience Data
 Combination of Testing, Analysis, and/or Experience Data (Please Specify): _____

HCAI Approval

Date: 10/4/2023
Name: William Staehlin Title: Senior Structural Engineer
Condition of Approval (if applicable): _____

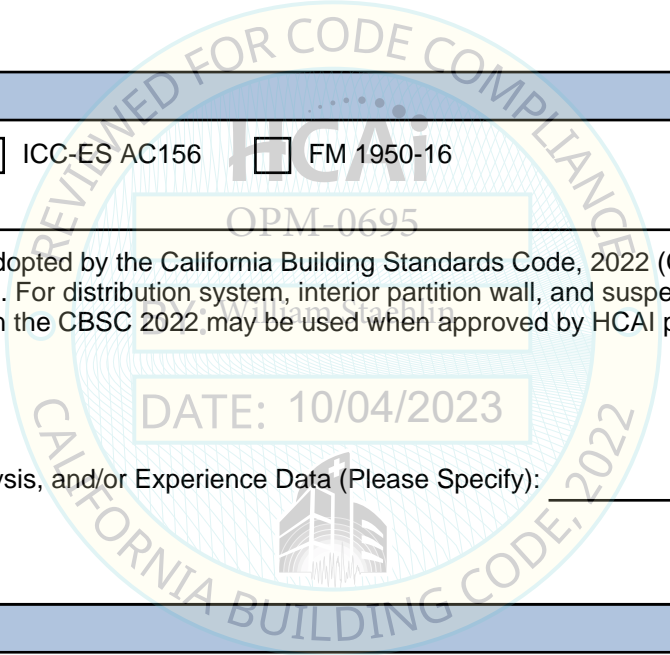

"A healthier California where all receive equitable, affordable, and quality health care"

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY





**EQUIPMENT ANCHORAGE
& SEISMIC ENGINEERING**

5877 Pine Ave, Ste. 210
Chino Hills, CA. 91709
Phn: (909) 606-7622

The Department of Health Care Access and Information
PREAPPROVAL OF MANUFACTURER'S CERTIFICATION
OPM-0695


THIS PREAPPROVAL CONFORMS TO THE 2022 CALIFORNIA BUILDING CODE

MANUFACTURER: **STRONGARM DESIGN, INC**
EQUIPMENT NAME: **FPCW WALL MOUNTED WORKSTATION**

Sheet: 1 of 6
Date: 10/2/23

GENERAL NOTES

1. THIS HCAI PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2022 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2022 CBC
2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
3. THIS PREAPPROVAL CONFORMS TO THE 2022 CALIFORNIA BUILDING CODE.
4. FORCES PER ASCE 7-16 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3, WHERE $S_{Ds} = 2.30$, $a_p = 1.0$, $I_p = 1.5$, $R_p = 2.5$, $z/h \leq 1$.
5. THE DETAILS IN THIS PREAPPROVAL MAY BE USED AT ANY LOCATION IN THE STATE OF CALIFORNIA, WHERE S_{Ds} IS NOT GREATER THAN 2.30.
6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
7. SHEET METAL SCREWS SHALL BE TEKS SCREWS BY ITW BUILDEX (ICC ESR-1976).
8. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
9. RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING
 - A. PROVIDE SUPPORTING STRUCTURE REQUIRED TO SUPPORT WEIGHTS AND FORCES SHOWN, IN ADDITION TO ALL OTHER LOADS.
 - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2022 CBC AND WITH THE DETAILS SHOWN IN THIS PREAPPROVAL. VERIFY THAT THE ACTUAL EQUIPMENT'S WEIGHT, CG LOCATION, ANCHOR LOCATIONS, ANCHOR DETAILS AND THE MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
 - C. VERIFY THAT THE COMBINATION OF S_{Ds} & z/h RESULT IN SEISMIC FORCES (E_h , E_v) THAT ARE NOT GREATER THAN THE VALUES ON THE DETAILS.
 - D. DESIGN BACKING BARS, STUDS, ETC. WHICH THE UNITS ARE ATTACHED TO AS NOTED ON THE DRAWINGS.

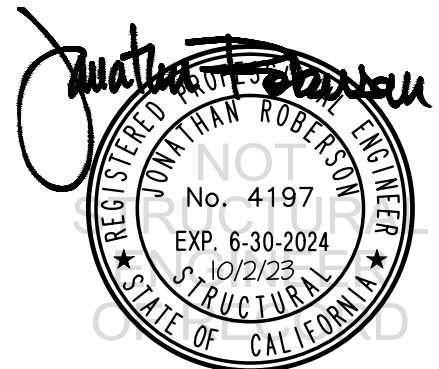

STRONGARM DESIGN, INC

DES. **J. ROBERSON**

SHEET

2

JOB NO. **11-2318**


FPCW WALL MOUNTED WORKSTATION

DATE **10/2/23**

OF **6** SHEETS

SEISMIC ANCHORAGE

WALL MOUNTED

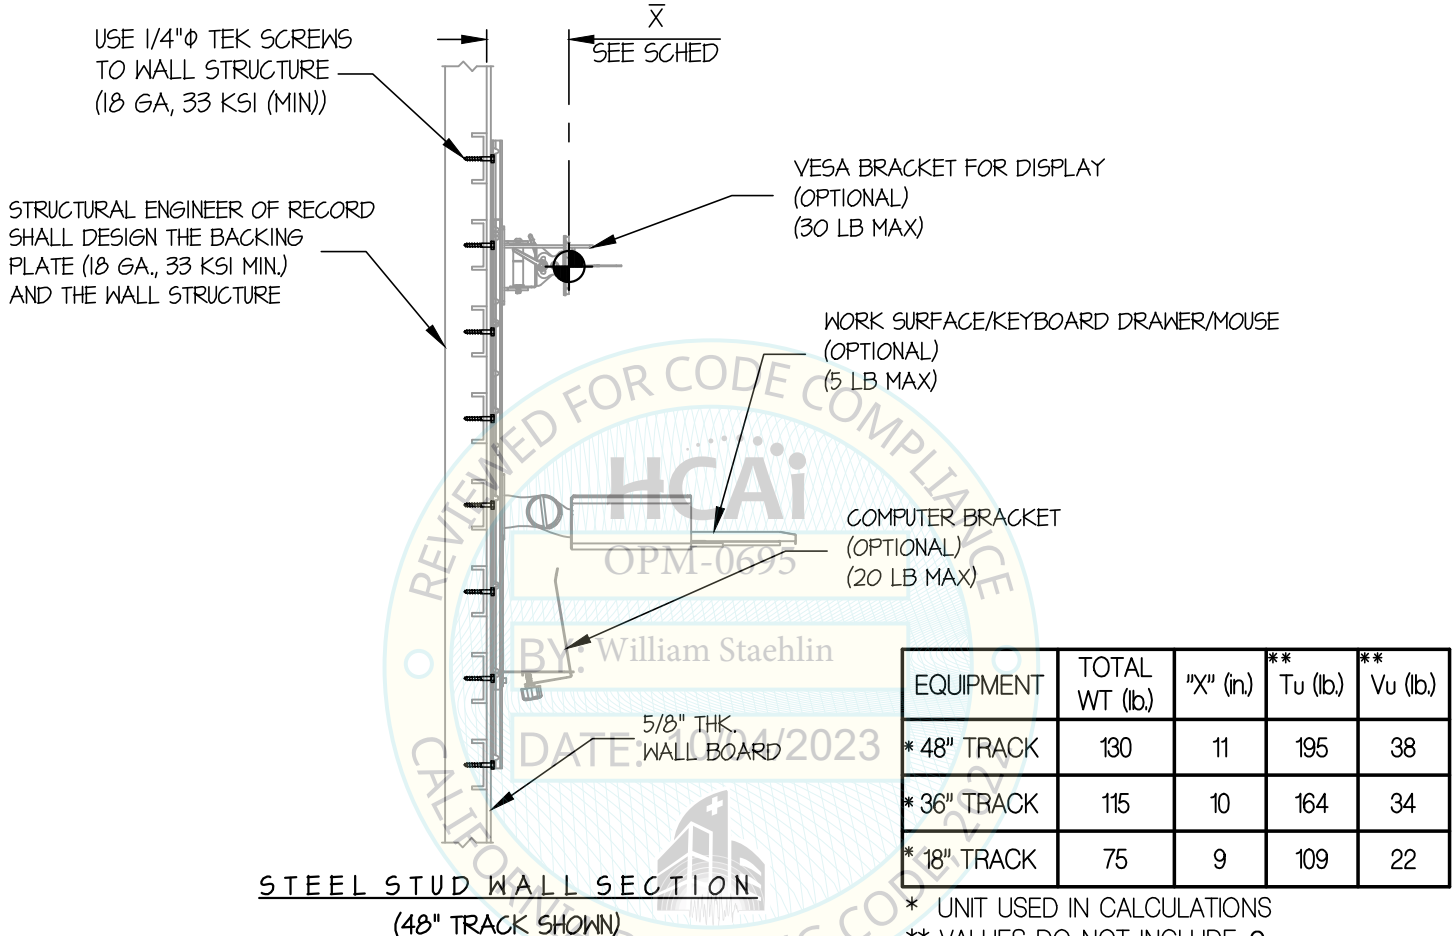

STEEL STUD WALL SECTION
(48" TRACK SHOWN)

EQUIPMENT	TOTAL WT (lb.)	"X" (in.)	** Tu (lb.)	** Vu (lb.)
* 48" TRACK	130	11	195	38
* 36" TRACK	115	10	164	34
* 18" TRACK	75	9	109	22

* UNIT USED IN CALCULATIONS
** VALUES DO NOT INCLUDE Ω

NOTES:


1. FORCES ARE DETERMINED PER 2022 CALIFORNIA BUILDING CODE AND ASCE 7-16. STRENGTH DESIGN IS USED. (EXAMPLE: $S_{ds} = 2.30$, $a_p = 1.0$, $I_p = 1.5$, $R_p = 2.5$, $z/h \leq 1$)

HORIZONTAL FORCE (E_h) = $1.66 W_p$
VERTICAL FORCE (E_v) = $0.46 W_p$

2. THIS PREAPPROVAL ENCOMPASSES WEIGHTS AND VERTICAL C.G. POSITIONS NOT EXCEEDING VALUES SHOWN.

3. THIS PREAPPROVAL WAS PREPARED WITHOUT KNOWLEDGE OF ANY SITE CONDITION. COMPATIBILITY FOR USE WITH A SITE SHALL BE EVALUATED BY THE STRUCTURAL ENGINEER OF RECORD OF THE INSTALLATION (SEOR). USE REQUIRES APPROVAL BY THE SEOR.

4. STRUCTURAL ENGINEER OF RECORD FOR THE INSTALLATION SHALL VERIFY ALL CONDITIONS, EVALUATE INTERACTION WITH ADJACENT EQUIPMENT AND ANCHORS, AND PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.

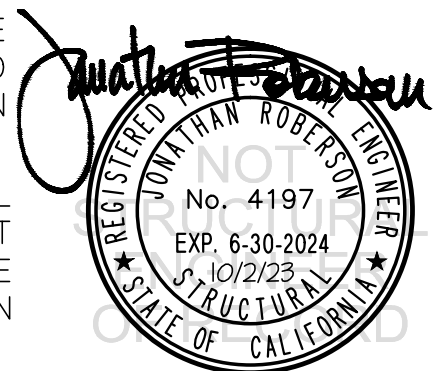

STRONGARM DESIGN, INC

DES. J. ROBERSON

SHEET

3



JOB NO. 11-2318

FPCW WALL MOUNTED WORKSTATION

DATE 10/2/23


OF 6 SHEETS

SEISMIC ANCHORAGE

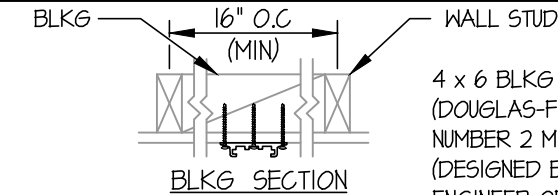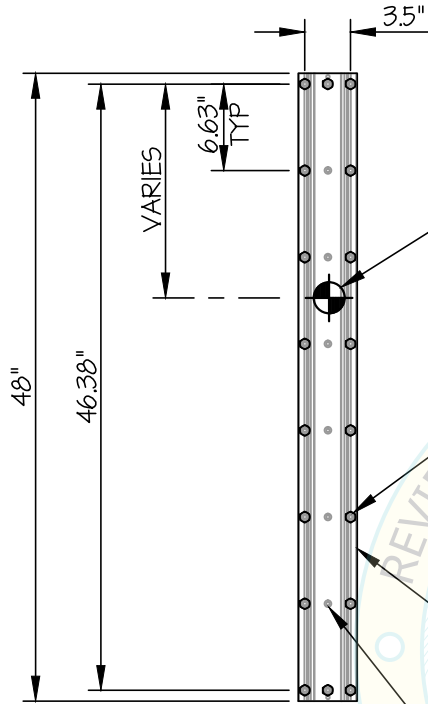

WALL MOUNTED

4 x 6 BLKG MIN
(DOUGLAS-FIR LARCH
NUMBER 2 MIN.)
(DESIGNED BY STRUCTURAL
ENGINEER OF RECORD)

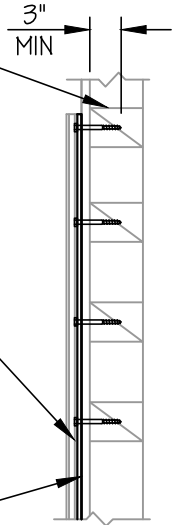

C.G. WT. = 130 LB (MAX)
(\bar{X} = 11")
(WEIGHT INCLUDES
CHANNEL/BRACKETS/
DISPLAY/KEYBOARD DRAWER/MOUSE)

USE 18- 1/4" ϕ X 4" FLAT HEAD
WOOD SCREWS TO
WOOD STUD
(PRE-DRILL PILOT HOLES)

USE 18- 1/4" ϕ TEK SCREWS
TO STEEL STUD WALL
(18 GAGE, 33 ksi MIN.)
OR 18- 1/4" ϕ WOOD SCREWS
W/ 3" EMBED. (MIN) INTO
WOOD BACKING

PRE-MANUFACTURED
MOUNTING TRACK
(3/16" THK. 6063T5 AL)
(BY STRONGARM DESIGN, INC)



(24) 0.21" ϕ HOLES PROVIDED

NOTE: (TEK SCREWS)
MIN EDGE DISTANCE = 0.75"
MIN END DISTANCE = 0.75"

NOTE: (WOOD SCREWS)
MIN EDGE DISTANCE = 2"
MIN END DISTANCE = 2"

ELEVATION AT 48" TRACK

WOOD STUD WALL SECTION

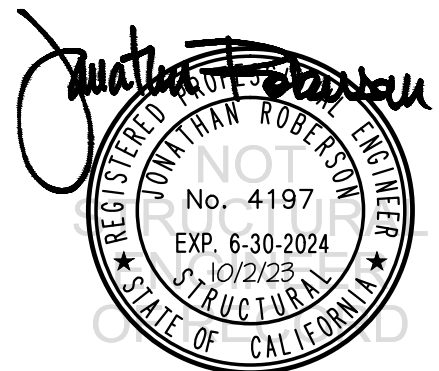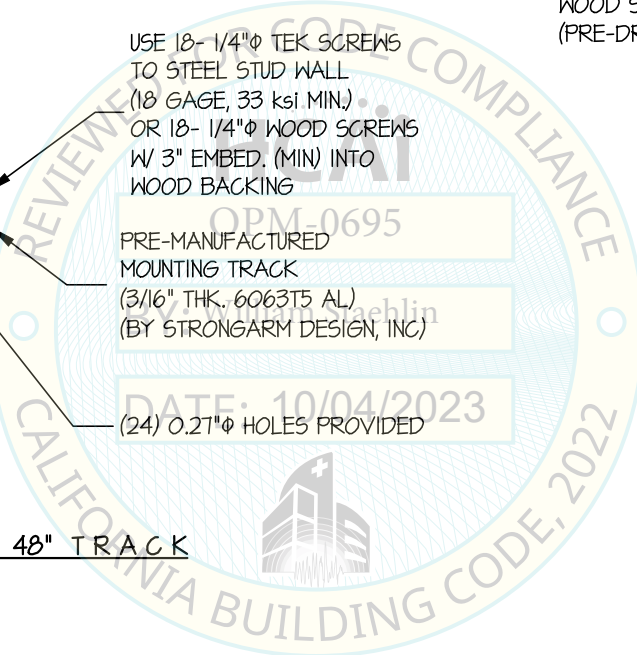

STRONGARM DESIGN, INC

DES. J. ROBERSON

SHEET

4


JOB NO. 11-2318

FPCW WALL MOUNTED WORKSTATION


DATE 10/2/23

OF 6 SHEETS

SEISMIC ANCHORAGE

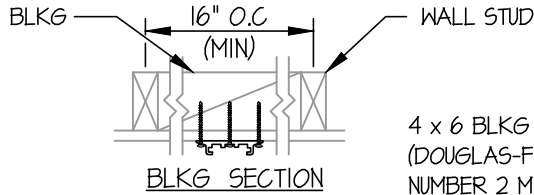

WALL MOUNTED

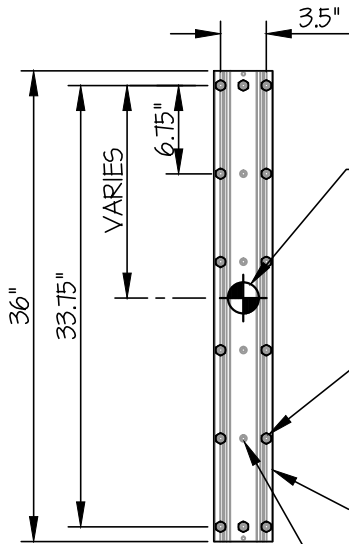

C.G. WT. = 115 LB (MAX)
 (\bar{X} = 10")
 (WEIGHT INCLUDES CHANNEL/BRACKETS/ DISPLAY/KEYBOARD DRAWER/MOUSE)


USE 14- 1/4" ϕ TEK SCREWS TO STEEL STUD WALL (18 GAGE, 33 ksi MIN.) OR 14- 1/4" ϕ WOOD SCREWS W/ 3" EMBED. (MIN) INTO WOOD BACKING

PRE-MANUFACTURED MOUNTING TRACK (3/16" THK. 6063T5 AL) (BY STRONGARM DESIGN, INC.) (18) 0.21" ϕ HOLES PROVIDED

4 x 6 BLKG MIN (DOUGLAS-FIR LARCH NUMBER 2 MIN.) (DESIGNED BY STRUCTURAL ENGINEER OF RECORD)

USE 14- 1/4" ϕ X 4" FLAT HEAD WOOD SCREWS TO WOOD STUD (PRE-DRILL PILOT HOLES)

5/8" THK. WALL BOARD


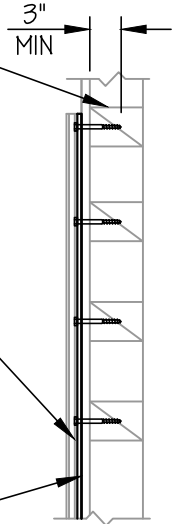


NOTE: (TEK SCREWS)
 MIN EDGE DISTANCE = 0.75"
 MIN END DISTANCE = 0.75"

NOTE: (WOOD SCREWS)
 MIN EDGE DISTANCE = 2"
 MIN END DISTANCE = 2"

ELEVATION AT 36" TRACK

WOOD STUD WALL SECTION

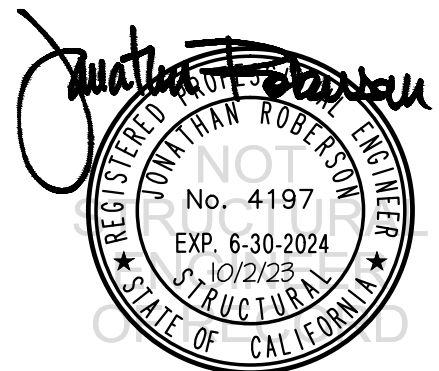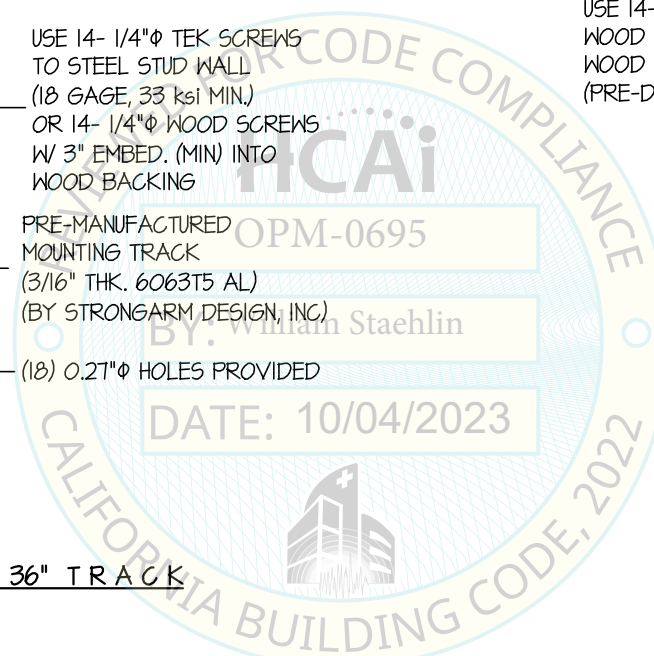

STRONGARM DESIGN, INC

DES. J. ROBERSON

SHEET

5


JOB NO. 11-2318

FPCW WALL MOUNTED WORKSTATION


DATE 10/2/23

OF 6 SHEETS

SEISMIC ANCHORAGE

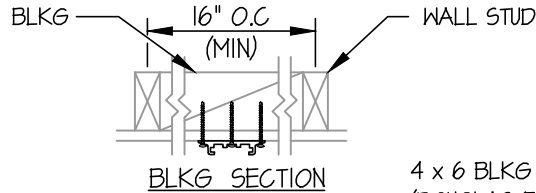

WALL MOUNTED

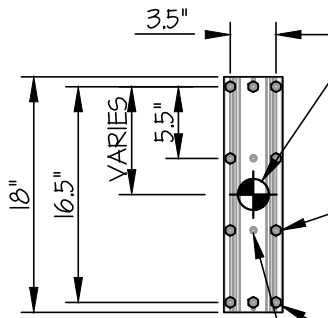

C.G. WT. = 75 LB (MAX)
 (X̄ = 9")
 (WEIGHT INCLUDES
 CHANNEL/BRACKETS/
 DISPLAY/KEYBOARD DRAWER/MOUSE)

USE 10- 1/4"Φ TEK SCREWS
 TO STEEL STUD WALL
 (18 GAGE, 33 ksi MIN.)
 OR 10- 1/4"Φ WOOD SCREWS
 W/ 3" EMBED. (MIN) INTO
 WOOD BACKING

PRE-MANUFACTURED
 MOUNTING TRACK
 (3/16" THK. 6063T5 AL)
 (BY STRONGARM DESIGN, INC)
 (12) 0.27"Φ HOLES PROVIDED


NOTE: (TEK SCREWS)
 MIN EDGE DISTANCE = 0.75"
 MIN END DISTANCE = 0.75"

ELEVATION AT 18" TRACK

4 x 6 BLKG MIN
 (DOUGLAS-FIR LARCH
 NUMBER 2 MIN.)
 (DESIGNED BY STRUCTURAL
 ENGINEER OF RECORD)



USE 10- 1/4"Φ X 4" FLAT HEAD
 WOOD SCREWS TO
 WOOD STUD
 (PRE-DRILL PILOT HOLES)

5/8" THK.
 WALL BOARD

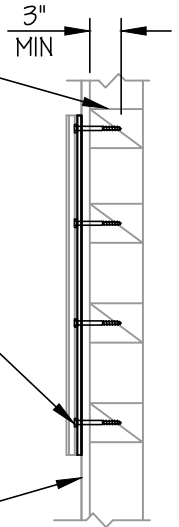

NOTE: (WOOD SCREWS)
 MIN EDGE DISTANCE = 2"
 MIN END DISTANCE = 2"

WOOD STUD WALL SECTION

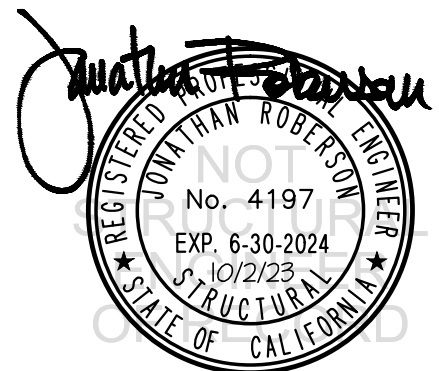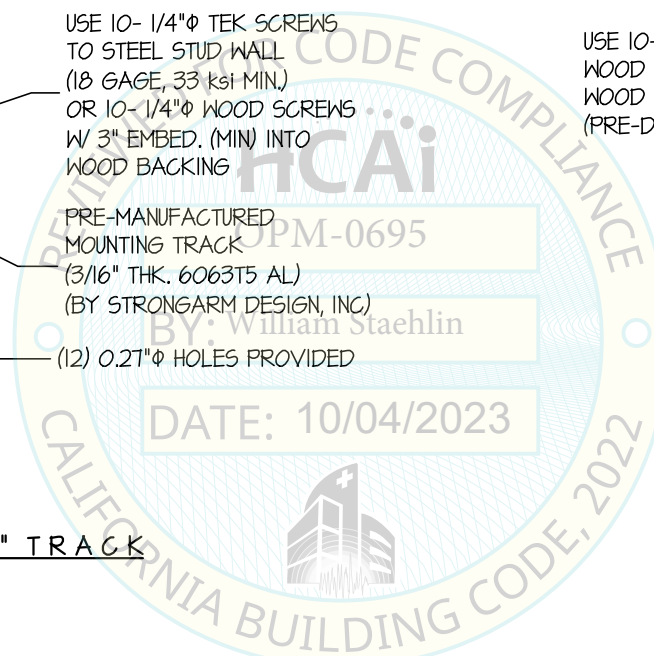

STRONGARM DESIGN, INC

DES. J. ROBERSON

SHEET

6

JOB NO. 11-2318

FPCW WALL MOUNTED WORKSTATION

DATE 10/2/23

OF 6 SHEETS

SEISMIC ANCHORAGE

TRACK DETAILS

