



DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT

APPLICATION FOR HCAI SPECIAL SEISMIC  
CERTIFICATION PREAPPROVAL (OSP)

OFFICE USE ONLY

APPLICATION #: OSP-0065

HCAI Special Seismic Certification Preapproval (OSP)

Type:  New  Renewal

Manufacturer Information

Manufacturer: Honeywell

Manufacturer's Technical Representative: Michael Yanofsky

Mailing Address: 12 Clintonville Road, Northford, CT 06472

Telephone: (203) 484-6247 Email: Michael.Yanofsky@honeywell.com

Product Information

Product Name: Silent Knight

Product Model Number(s): Silent Knight

Product Category: Electrical Control Panels on Life Safety/Critical Branch

Product Sub-Category: Fire Alarm & Security Panels

General Description: Wall Mounted custom Fire Control Panels with Communication Devices

Mounting Description: Wall Mounted Rigid

Tested Seismic Enhancements: Seismic enhancements made to the test units and/or modifications required to address anomalies during the tests shall be incorporated into the production units.

Applicant Information

Applicant Company Name: The VMC Group

Contact Person: John Giuliano

Mailing Address: 113 Main Street, Bloomingdale, NJ 07403

Telephone: (973) 838-1780 Email: john.giuliano@thevmcgroup.com

Title: President

"A healthier California where all receive equitable, affordable, and quality health care"



STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY



DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT

California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)

Company Name: THE VMC GROUP

Name: Kenneth Tarlow California License Number: S2851

Mailing Address: 980 9th Street, 16th Floor, Sacramento, CA 95814

Telephone: (832) 627-2214 Email: ken.tarlow@thevmcgroup.com

**Certification Method**

GR-63-Core  ICC-ES AC156  IEEE 344  IEEE 693  NEBS 3

Other (Please Specify): \_\_\_\_\_

**Testing Laboratory**

Company Name: DYNAMIC CERTIFICATION LABORATORY (DCL)


Contact Person: Kelly LaPlace

Mailing Address: 1315 Greg St., Ste 109, Sparks NV 89431

Telephone: (775) 358-5085 Email: kelly@shaketest.com

BY: Mohammad Karim

DATE: 11/4/2025

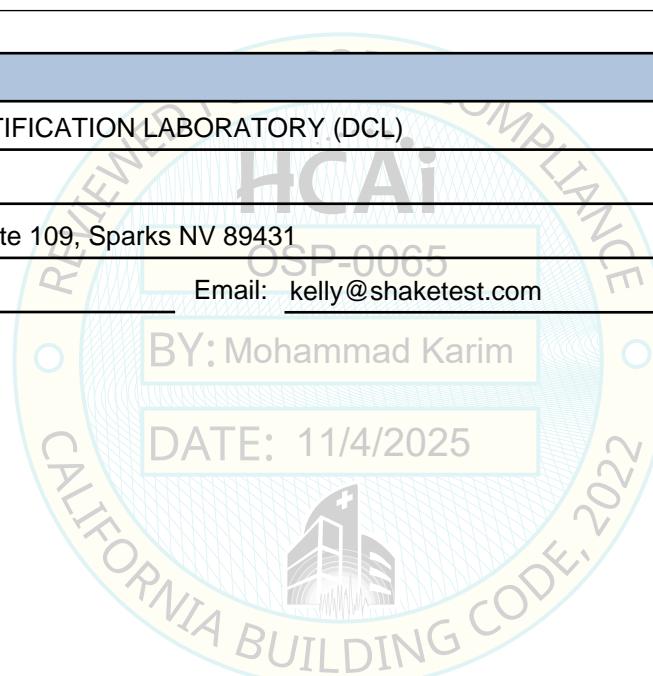

*\*A healthier California where all receive equitable, affordable, and quality health care\**



STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY



**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

**Seismic Parameters**

Design Basis of Equipment or Components ( $F_p/W_p$ ) = 1.50 (z/h = 1.0); 0.625 (z/h = 0.0)

SDs (Design spectral response acceleration at short period, g) = 2.0 (z/h = 1.0); 2.5 (z/h = 0.0)

$a_p$  (Amplification factor) = 2.5

$R_p$  (Response modification factor) = 6.0

$\Omega_0$  (System overstrength factor) = 2.0

$I_p$  (Importance factor) = 1.5

$z/h$  (Height ratio factor) = 0 and 1

Natural frequencies (Hz) = See Attachment

Overall dimensions and weight = See Attachment

**HCAi Approval (For Office Use Only) - Approval Expires on 11/04/2031**

Date: 11/4/2025

Name: Mohammad Karim


Title: Supervisor, Health Facilities

Special Seismic Certification Valid Up to: SDS (g) = 2.0

$z/h$  = 1

Condition of Approval (if applicable): BY: Mohammad Karim

DATE: 11/4/2025

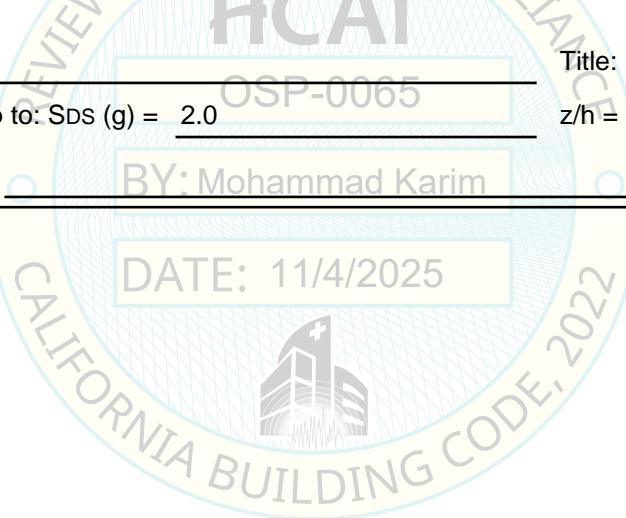

*\*A healthier California where all receive equitable, affordable, and quality health care\**



**STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY**

**Table 1 - Certified Product Table**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
<b>Honeywell</b>	Cell Antenna (GSM)	Antenna	Antenna that Boosts Reception for GSM Communicator Cards	Surface Wall Mount	N/A	0.2	6.3	1.0	0.4	Extrapolated
<b>Honeywell</b>	Cell Antenna (LTE)	Antenna	Antenna that Boosts Reception for LTE Communicator Cards	Surface Wall Mount	N/A	0.2	7.4	1.9	0.4	Extrapolated
<b>Honeywell</b>	CELL-MOD	Cellular Communicator in Small Plastic Enclosure with Antenna	Houses an GSM (Cellular) Communicator Card for Central Station Reporting	Surface Wall Mount	N/A	1	6.0	7.0	2.0	UUT-10
<b>Honeywell</b>	LTE-MOD	Cellular Communicator in Small Plastic Enclosure	Houses an LTE (Cellular) Communicator Card for Central Station Reporting	Surface Wall Mount	N/A	0.8	6.0	7.8	2.0	Interpolated
<b>Silent Knight</b>	CELL-CAB-SK	Cellular Communicator in Small Plastic Enclosure	Houses an GSM (Cellular) Communicator Card for Central Station Reporting	Surface Wall Mount	N/A	4.4	10.2	10.4	3.2	Interpolated
<b>Silent Knight</b>	LTE-CAB-SK	Cellular Communicator in Small Plastic Enclosure with Antenna	Houses an LTE (Cellular) Communicator Card for Central Station Reporting	Surface Wall Mount	N/A	5	10.0	10.0	3.0	UUT-11
<b>Silent Knight</b>	5129	Cellular Communicator in Small Plastic Enclosure (SK2190)	4 Channel Communicator	Surface Wall Mount	N/A	6	10.0	10.0	3.0	Extrapolated
<b>Silent Knight</b>	5135	Cellular Communicator in Small Plastic Enclosure (SK2190)	4 Channel Communicator	Surface Wall Mount	N/A	6	10.0	10.0	3.0	Extrapolated
<b>Honeywell</b>	RBB	Batteries in Small Metal Enclosure	Remote Battery Box Cabinet	Surface Wall Mount	10	55	16.0	10.0	6.0	UUT-8

**Notes:**


- 1) Extrapolated model (GSM) is de-populated UUT-10.
- 2) Extrapolated model (LTE) is de-populated UUT-11.
- 3) Models (5129) and (5135) are extrapolated from UUT-11.

**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
Silent Knight	5104	Fire Alarm Control Panel in Small Metal Cabinet	Fire Control 6 Channel Communicator	Surface Wall Mount	N/A	14	12.0	16.0	3.0	UUT-2
Farenhyt	IFP-75	Fire Alarm Control Panel in Small Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	15	23	12.7	15.1	3.3	Interpolated
Farenhyt	IFP-75B	Fire Alarm Control Panel in Small Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	15	23	12.7	15.1	3.3	Interpolated
Farenhyt	IFP-50	Fire Alarm Control Panel in Small Metal Cabinet	50 Pt. Single Loop Addressable Panel	Surface Wall Mount	11.5	19.5	12.7	15.1	3.3	Extrapolated

**Notes:**

1) Extrapolated models are de-populated UUT-7.

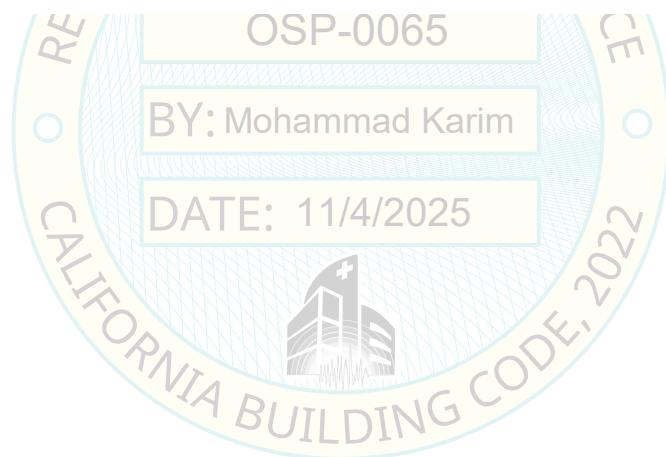

**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
Farenhyt	IFP-25	Fire Alarm Control Panel in Small Metal Cabinet	25 Pt. Single Loop Addressable Panel	Surface Wall Mount	11.5	19.5	12.7	15.1	3.3	Extrapolated
Silent Knight	6700	Fire Alarm Control Panel in Small Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	15	23	13.0	15.0	3.0	UUT-7
Silent Knight	5495	Power Supply in Small Metal Cabinet	6 Amp Distributed Power Module	Surface Wall Mount	18.5	26.5	12.3	15.3	3.0	Interpolated
Silent Knight	5499	Power Supply in Small Metal Cabinet	9 Amp Distributed Power Module	Surface Wall Mount	18.5	26.5	12.3	15.3	3.0	Interpolated
Silent Knight	5496	Power Supply in Small Metal Cabinet	6 Amp Distributed Power Module	Surface Wall Mount	18.5	26.5	12.3	15.3	3.0	Interpolated
Silent Knight	5208	Fire Alarm Control Panel in Medium Metal Cabinet	Fire Alarm Control Panel w/ Digital Communicator	Surface Wall Mount	28	48	17.0	26.0	4.0	UUT-3
Farenhyt	RPS-2000	Power Supply in Medium Metal Cabinet	Distributed Power Module	Surface Wall Mount	28	48	16.0	26.4	4.7	Extrapolated
Silent Knight	5895XL	Power Supply in Medium Metal Cabinet	Distributed Power Module	Surface Wall Mount	28	48	16.1	26.4	4.1	Extrapolated

**Notes:**


- 1) Extrapolated model (IFP-25) is de-populated UUT-7.
- 2) Extrapolated models (RPS-2000), (5895XL) are de-populated UUT-3.

**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			
							Width	Height	Depth	
Farenhyt	RPS-1000	Power Supply in Medium Metal Cabinet	6 Amp Distributed Power Module	Surface Wall Mount	28	48	16.1	26.4	4.1	Extrapolated
Gamewell FCI	FLEX410 / GWF410	Fire Alarm Control Panel in Medium Metal Cabinet	Fire Alarm Control Panel w/ Digital Communicator	Surface Wall Mount	28	48	16.0	26.4	4.0	Interpolated
Farenhyt	IFP-1000	Fire Alarm Control Panel in Medium Metal Cabinet	Addressable Fire Alarm Panel	Surface Wall Mount	28	48	16.2	26.4	4.2	Interpolated
Farenhyt	IFP-100	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.0	26.4	4.7	Interpolated
Farenhyt	IFP-2000	Fire Alarm Control Panel in Medium Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control Panel	Surface Wall Mount	28	48	16.0	26.4	4.7	Interpolated

**Notes:**

1) Extrapolated model (RPS-1000) is de-populated UUT-3.

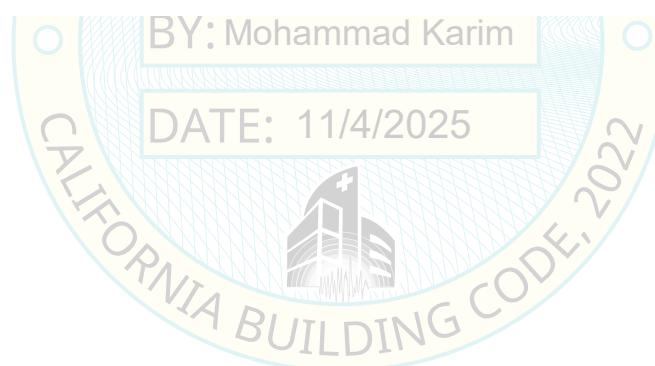

**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
Silent Knight	6820	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	RFP-2100	Fire Alarm Control Panel in Medium Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	IFP-300	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	IFP-2100	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	IFP-300U	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	IFP-300UB	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	IFP-1100U	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Farenhyt	IFP-1100UB	Fire Alarm Control Panel in Medium Metal Cabinet	Intelligent Fire Alarm Control Panel	Surface Wall Mount	28	48	16.4	26.4	4.1	Interpolated
Silent Knight	SKE-450	Fire Alarm Control Panel with Microphone in Medium Metal Cabinet	Voice Evacuation System	Surface Wall Mount	28	56	17.0	26.0	4.0	UUT-1

**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
Farenhyt	ECS-50	Amplifier in Medium Metal Cabinet	50 Watt Amplifier	Surface Wall Mount	11.5	19.5	16.0	26.3	4.0	Extrapolated
Farenhyt	ECS-125	Amplifier in Medium Metal Cabinet	125 Watt Amplifier	Surface Wall Mount	28	46	16.0	26.3	4.0	Extrapolated

**Notes:**

1) Extrapolated models are de-populated UUT-9.



**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
Silent Knight	EVS-125W	Amplifier in Medium Metal Cabinet	External Amplifier	Surface Wall Mount	28	49	16.0	26.3	4.0	UUT-9
Farenhyt	IFP-100VIP	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Voice Integration Panel	Surface Wall Mount	28	46	20.4	27.0	5.0	Interpolated
Farenhyt	IFP-100ECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Voice Integration Panel	Surface Wall Mount	28	46	20.4	27.0	5.0	Interpolated
Farenhyt	IFP- 300ECSB	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Emergency Communication System with Fire Alarm Control Panel	Surface Wall Mount	55	70	21.6	28.1	5.1	Interpolated
Farenhyt	IFP-300 ECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Emergency Communication System with Fire Alarm Control Panel	Surface Wall Mount	55	70	22.0	28.0	5.0	UUT-5
Farenhyt	VIP-RM	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Remote Display / Microphone	Surface / Flush Wall Mount	53	71	20.0	26.5	4.6	Interpolated
Farenhyt	ECS-RM / ECS-RCU- 2000	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Remote Display / Microphone	Surface / Flush Wall Mount	53	71	20.0	26.5	4.6	Interpolated

**Notes:**

1) Extrapolated model (ECC-125DA) is de-populated UUT-9.

**Table 1 - Certified Product Table (Continued)**

Alternate Branding Model Numbers		Basic Description	Unit Details	Mounting	Weight Without Batteries [ lb ]	Max Weight [ lb ]	Max Dimensions [ in ]			UUT
							Width	Height	Depth	
Farenhyt	IFP-2000VIP	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Voice Integration Panel with Analog / Addressable Fire Alarm Control	Surface / Flush Wall Mount	53	71	20.0	26.5	4.6	Interpolated
Farenhyt	IFP-2000ECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Voice Integration Panel with Analog / Addressable Fire Alarm Control	Surface / Flush Wall Mount	53	71	20.0	26.5	4.6	Interpolated
Farenhyt	VIP-RM2000	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Remote Display / Microphone	Surface / Flush Wall Mount	53	71	20.0	26.5	4.6	Interpolated
Farenhyt	IFP-1000VIP	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Emergency Communication System with Fire Alarm Control Panel	Surface / Flush Wall Mount	53	71	20.4	26.5	4.6	Interpolated
Farenhyt	IFP-1000ECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Emergency Communication System with Fire Alarm Control Panel	Surface / Flush Wall Mount	53	71	20.4	26.5	4.6	Interpolated
Silent Knight	5820XL-EVS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Emergency Communication System with Fire Alarm Control Panel	Surface / Flush Wall Mount	53	71	20.4	27.0	5.0	Interpolated
Silent Knight	6820 EVS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Emergency Communication System with Fire Alarm Control Panel	Surface Wall Mount	55	72	22.0	28.0	5.0	UUT-6
Farenhyt	IFP-2100ECSB	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	55	76	21.6	28.1	5.1	Interpolated
Farenhyt	IFP-300UECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	55	76	22.0	28.0	5.0	Interpolated
Farenhyt	IFP-300UECSB	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	55	76	22.0	28.0	5.0	Interpolated
Farenhyt	IFP-1100UECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	55	76	22.0	28.0	5.0	Interpolated
Farenhyt	IFP-1100UECSB	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	55	76	22.0	28.0	5.0	Interpolated
Farenhyt	IFP-2100ECS	Fire Alarm Control Panel with Microphone in Large Metal Cabinet	Scalable Analog / Addressable Fire Alarm Control System	Surface Wall Mount	55	76	22.0	28.0	5.0	UUT-4

**Table 2 - Alternate Branding OEM Chart**

Farenhyt Model Number	UUT	Private Label/OEM Model Numbers						
		Fire-Lite	Gamewell FCI	Notifier	Honeywell	Fike	Triga	Silent Knight
IFP-75	N/A	N/A	GWF-7075	N/A	N/A	FCP-75	N/A	N/A
IFP-50	N/A	N/A	N/A	N/A	N/A	N/A	N/A	5700
IFP-25	N/A	N/A	N/A	N/A	N/A	N/A	N/A	5600 / 5600C
N/A	N/A	N/A	N/A	N/A	N/A	FIK-5496	N/A	5496
RPS-1000	N/A	N/A	N/A	N/A	N/A	FIK-RPS1000	N/A	N/A
IFP-1000	N/A	N/A	N/A	N/A	N/A	N/A	N/A	5820XL
IFP-100	N/A	N/A	N/A	N/A	N/A	N/A	N/A	5808
RFP-2100	N/A	N/A	N/A	N/A	N/A	RFCP-2100	N/A	N/A
IFP-300	N/A	N/A	N/A	N/A	N/A	FCP-300	N/A	6808
IFP-300U	N/A	N/A	N/A	N/A	N/A	FCP-300U	TR-300UR	6808U
IFP-300UB	N/A	N/A	N/A	N/A	N/A	N/A	TR-300UB	N/A
IFP-1100U	N/A	N/A	N/A	N/A	N/A	FCP-1100U	TR-1100U	N/A
IFP-1100UB	N/A	N/A	N/A	N/A	N/A	N/A	TR-1100UB	N/A
IFP-2100	N/A	N/A	N/A	N/A	N/A	FCP-2100	N/A	6820U
N/A	UUT-1	N/A	150-00026 / FV IV-50	N/A	N/A	N/A	N/A	SKE-450
ECS-50	N/A	ECC-50DA	N/A	NFC-50DA	N/A	FIK-50W	N/A	VIP-50
ECS-125	N/A	ECC-125DA	N/A	NFC-125DA	N/A	FIK-125W	N/A	VIP-125
IFP-300ECS	UUT-5	N/A	N/A	N/A	N/A	FCP-300ECS	N/A	N/A
IFP-300UECS	N/A	N/A	N/A	N/A	N/A	FCP-300UECS	TR-300UECSR	N/A
IFP-300UECSB	N/A	N/A	N/A	N/A	N/A	N/A	TR-300UECSB	N/A
IFP-1100UECS	N/A	N/A	N/A	N/A	N/A	FCP-1100UECS	TR-1100UECS	N/A
IFP-1100UECSB	N/A	N/A	N/A	N/A	N/A	N/A	TR-1100UECSB	N/A
IFP-2100ECS	UUT-4	N/A	N/A	N/A	N/A	FCP-2100ECS	N/A	6820UEVS

**Note:** This table lists the OEM model numbers for alternate branding of the certified Farenhyt model numbers of this OSP. Alternately branded models are identical to certified Farenhyt models except for appearance (color, labeling, branding)

**Table 3 - Certified Subcomponents - Audio Splitters**

Model	Manufacturer	Materials	Description	Max Weight [ lb ]	UUT
ECS-CE4	Honeywell	PCB	4 Zone Audio Splitter	<1	Extrapolated
FIK-CE4	Honeywell	PCB	4 Zone Audio Splitter	<1	Extrapolated
EVS-CE4	Honeywell	PCB	4 Zone Audio Splitter	<1	UUT-9
NFC-CE4	Honeywell	PCB	4 Zone Audio Splitter	<1	Interpolated
ECC-CE4	Honeywell	PCB	4 Zone Audio Splitter	<1	Interpolated
VIP-CE4	Honeywell	PCB	4 Zone Audio Splitter	1.0	Interpolated
SKE-ZN4	Honeywell	PCB	4 Zone Audio Splitter	1.0	Interpolated
SKE-ZN6	Honeywell	PCB	6 Zone Audio Splitter	1.0	UUT-1

**Notes:**

1) PCB = Printed Circuit Board

**Table 4 - Certified Subcomponents - Transformers**

Model	Manufacturer	Materials	Description	Max Weight [ lb ]	UUT
5129	Basler Electric Inc.	Copper Windings, Steel Frame	Transformer	2.6	Extrapolated from UUT-11
5135	Basler Electric Inc.	Copper Windings, Steel Frame	Transformer	2.6	Extrapolated from UUT-11
115035	Basler Electric Inc.	Copper Windings, Steel Frame	Transformer	2.6	UUT-2
115061	Basler Electric Inc.	Copper Windings, Steel Frame	Transformer	2.6	UUT-1, UUT-7

**Table 5 - Certified Subcomponents - Control Boards**

Model	Manufacturer	Materials	Description	Max Weight [ lb ]	UUT
051282-PCA	Honeywell	PCB	Main Control Board	<1	Extrapolated
077040-PCA	Honeywell	PCB	Main Control Board	<1	Extrapolated
058200-PCA	Honeywell	PCB	Main Control Board	<1	Extrapolated
051050-PCA	Honeywell	PCB	Main Control Board	<1	UUT-2
068200-PCA	Honeywell	PCB	Main Control Board	<1	Interpolated
057000-PCA	Honeywell	PCB	Main Control Board	1.1	Interpolated
077500-PCA	Honeywell	PCB	Main Control Board	1.5	UUT-1
054960-PCA	Honeywell	PCB	Main Control Board	1.8	Interpolated
054950-PCA	Honeywell	PCB	Main Control Board	1.9	Interpolated
078000-PCB	Honeywell	PCB	Main Control Board	2.1	Interpolated
FIK-50WBD	Honeywell	PCB	Main Control Board	2.1	Interpolated
054990-PCA	Honeywell	PCB	Main Control Board	2.2	Interpolated
058080-PCA	Honeywell	PCB	Main Control Board	2.3	Interpolated
P052090GA	Honeywell	PCB	Main Control Board	2.3	Extrapolated
P052080	Honeywell	PCB	Main Control Board	2.3	UUT-3
058950-PCA	Honeywell	PCB	Main Control Board	2.4	Interpolated
FIK-RPS1000BD	Honeywell	PCB	Main Control Board	2.4	Interpolated
078100-PCA	Honeywell	PCB	Main Control Board	3.1	UUT-9
FIK-125WBD	Honeywell	PCB	Main Control Board	3.1	Interpolated
068970-PCA	Honeywell	PCB	Main Control Board	3.2	UUT-4
FIK-2100BD	Honeywell	PCB	Main Control Board	3.2	Interpolated
EVS-VCM	Honeywell	PCB	Voice Control Board	1.4	UUT-6
ECS-VCM	Honeywell	PCB	Voice Control Board	1.4	Same as UUT-6
VIP-VCM	Honeywell	PCB	Voice Control Board	1.4	Same as UUT-6

**Notes:**

1) The ECS-VCM & VIP-VCM are identical to the EVS-VCM except for software.

2) PCB = Printed Circuit Board.

**Table 6 - Certified Subcomponents - Batteries**

Model	Manufacturer	Materials	Rating (Amps)	Max Weight [ lb ]	UUT
BAT-1270	Power Sonic	Lead Acid Battery	7	4.8	UUT-2, UUT-7
BAT-12180	Power Sonic	Lead Acid Battery	18	12.6	UUT-1, UUT-3, UUT-4, UUT-5, UUT-6, UUT-9
CP12-33	CooPower	Lead Acid Battery	33	26.0	UUT-8

**Table 7 - Certified Subcomponents - Expanders**

Model	Manufacturer	Materials	Description	Max Weight [ lb ]	UUT
VIP-SW24	Honeywell	PCB	24 Switch Expander	1.1	Same as UUT-5
ECS-SW24	Honeywell	PCB	24 Switch Expander	1.1	UUT-5
FIK-SW24	Honeywell	PCB	24 Switch Expander	1.1	Same as UUT-5

**Notes:**

1) The VIP-SW24 is identical to the ECS-SW24 except for software

2) PCB = Printed Circuit Board

BY: Mohammad Karim

**Table 8 - Certified Subcomponents - Other**

Model	Manufacturer	Materials	Description	Max Weight [ lb ]	UUT
LYRIC-3G	Honeywell	PCB	Radio Module for CELL Series	<1	UUT-10
LYRIC-3GLP	Honeywell	PCB	Radio Module for CELL Series	<1	Same as UUT-10
LYRICLTE-A	Honeywell	PCB	Radio Module for LTE Series	<1	UUT-11
5128	Honeywell	PCB	Communicator for 5129	<1	Extrapolated
5130	Honeywell	PCB	Communicator for 5135	<1	Extrapolated
CCP-LYRIC-PCA	Honeywell	PCB	Circuit Board for MOD & CAB Series	<1	UUT-10, UUT-11
Microphone	Shure, Astatic	Plastic	Microphone	<1	UUT-1
SEISKIT-MULTI-1	Honeywell	CRS	Seismic Bracket for EVS-125W	<1	UUT-9
EVS-INT50W	Honeywell	PCB	Internal Amplifier	2.0	UUT-6
SK-NIC	Silent Knight	PCB	Network Card	<1	UUT-5
FIK-NIC	Silent Knight	PCB	Network Card	<1	UUT-5

**Notes:**

1) The LYRIC-3G & LYRIC-3GLP are identical except for nomenclature.

2) 5128 and 5130 PCBs are bookended by UUT 10 and UUT 11.

3) PCB = Printed Circuit Board.

4) CRS = Cold Rolled Steel.

5) The EVS-125W must be installed with the SK-SCK-5104 seismic bracket.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-1

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	SKE-450	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Audio Splitter: Honeywell; Transformer: Basler Electric Inc.; Control Board: Honeywell; Batteries Power Sonic; Microphone: Shure, Astatic

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
56	4	17	26	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{Ds}$ (g)	$z/h$	$l_p$	$A_{FLX-H}$ (g)	$A_{RIG-H}$ (g)	$A_{FLX-V}$ (g)	$A_{RIG-V}$ (g)
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-01 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-2

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	5104	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Transformer: Basler Electric Inc.; Control Board: Honeywell; Batteries: Power Sonic

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
14	3	12	16	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	S <sub>Ds</sub> (g)	z/h	I <sub>P</sub>	A <sub>FLX-H</sub> (g)	A <sub>RIG-H</sub> (g)	A <sub>FLX-V</sub> (g)	A <sub>RIG-V</sub> (g)
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-02 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) #10-24, grade 8 machine screws. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-3

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	5208	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Control Board: Honeywell; Batteries: Power Sonic

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
48	4	17	26	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{Ds}$ (g)	$z/h$	$l_p$	$A_{FLX-H}$ (g)	$A_{RIG-H}$ (g)	$A_{FLX-V}$ (g)	$A_{RIG-V}$ (g)
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-03 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-4

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	IFP-2100 ECS	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Control Board: Honeywell; Batteries: Power Sonic

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
76	5	22	28	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$l_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-04 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-5

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	IFP-300 ECS	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Batteries: Power Sonic; Expander: Honeywell

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
70	5	22	28	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$I_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-05 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-6

30245-1701

Model Line	Model Number	Manufacturer
Silent Knight	6820 EVS	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Control Board: Honeywell; Batteries: Power Sonic; Internal Amplifier: Honeywell

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
72	5	22	28	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$I_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-06 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-7

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	6700	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Transformer: Basler Electric Inc.; Batteries: Power Sonic

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
23	3	13	15	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$I_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-07 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) #10-24, grade 8 machine screws. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-8

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	RBB	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Batteries: CooPower

### UUT Properties


Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
55	6	16	10	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$I_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-08 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) #10-24, grade 8 machine screws. Fixture was hard mounted to the shake table.

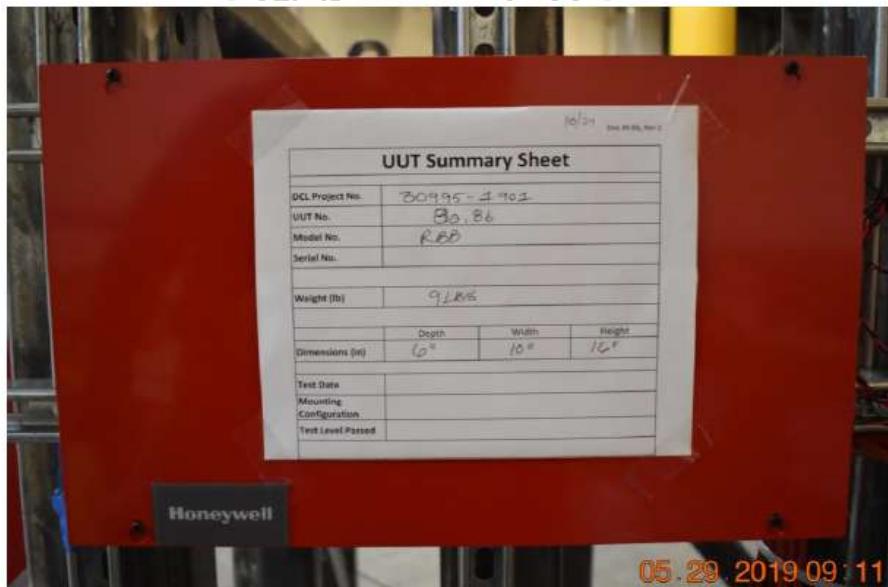

All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-9

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	EVS-125W	Honeywell

### Product Construction Summary

Carbon Steel Enclosure

### Options / Subcomponent Summary

Audio Splitter: Honeywell; Control Board: Honeywell; Batteries: Power Sonic; Seismic Bracket: Honeywell

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
49	4	16	26	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$I_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-09 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-10

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	CELL MOD with CELL ANTENNA	Honeywell

### Product Construction Summary

Plastic Enclosure & Plastic Antenna

### Options / Subcomponent Summary

Radio Module for CELL Series: Honeywell; Circuit Board: Honeywell

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
1	2	6	7	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	$S_{DS}$	$z/h$	$I_p$	$A_{FLX-H}$	$A_{RIG-H}$	$A_{FLX-V}$	$A_{RIG-V}$
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-10 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) 1/4" diameter, grade 8 bolts. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



## UNIT UNDER TEST (UUT) Summary Sheet

UUT-11

30995-1901

Model Line	Model Number	Manufacturer
Silent Knight	LTE-CAB-SK with Cell ANTENNA	Honeywell

### Product Construction Summary

Cold Rolled Steel Enclosure & Plastic Antenna

### Options / Subcomponent Summary

Radio Module for LTE Series: Honeywell; Circuit Board: Honeywell

### UUT Properties

Weight [ lbs ]	Dimensions [ in ]			Lowest Nat. Freq. [ Hz ]		
	Length	Width	Height	F-B	S-S	V
5	3	10	10	N/A	N/A	N/A

### UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	S <sub>DS</sub>	z/h	I <sub>P</sub>	A <sub>FLX-H</sub>	A <sub>RIG-H</sub>	A <sub>FLX-V</sub>	A <sub>RIG-V</sub>
CBC 2022	ICC-ES AC156	2.0	1.0	1.5	3.20	2.40	-	-

### Test Mounting Details

UUT-11 was rigidly, wall mounted to the fixture via 12 gauge unistrut using Qty. (4) #10-24, grade 8 machine screws. Fixture was hard mounted to the shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.