



**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

**APPLICATION FOR HCAI SPECIAL SEISMIC
CERTIFICATION PREAPPROVAL (OSP)**

OFFICE USE ONLY

APPLICATION #: OSP-0444

HCAI Special Seismic Certification Preapproval (OSP)

Type: New Renewal

Manufacturer Information

Manufacturer: Cummins Power Generation

Manufacturer's Technical Representative: Abhishek Patil

Mailing Address: 1400 73rd AVE NE, Fridley, MN 55432

Telephone: (763) 574-5000 Email: abhishek.patil@cummins.com

Product Information

Product Name: QSK95 Diesel Generator Sets

Product Model Number(s): C3000 D6, C3000 D6e, C3250 D6, C3250 D6e, 3500 D6, C3500 D6e, and PCC3300 HMI

Product Category: Emergency and Standby Power Systems

Product Sub-Category: Generators

General Description: Diesel engine powered electrical generator sets, w/ controls, w/ and w/o radiator cooling system. Seismic enhancements made to the test units required to address anomalies observed during the tests shall be incorporated into the production units.

Mounting Description: Generators: Floor Mounted on Spring Isolators; HMI: Mounted on Rigid Floor Mounted Pedestal

Tested Seismic Enhancements: Seismic enhancements made to the test units and/or modifications required to address anomalies during the tests shall be incorporated into the production units.

Applicant Information

Applicant Company Name: VMC Group

Contact Person: John Giuliano

Mailing Address: 113 Main St, Bloomingdale, NJ 07403

Telephone: (973) 838-1780 Email: john.giuliano@thvmcgroup.com

Title: President





**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)


Company Name: THE VMC GROUP
Name: Kenneth Tarlow California License Number: S2851
Mailing Address: 980 9th Street, 16th Floor, Sacramento, CA 95814
Telephone: (832) 627-2214 Email: ken.tarlow@thevmcgroup.com

Certification Method

GR-63-Core ICC-ES AC156 IEEE 344 IEEE 693 NEBS 3
 Other (Please Specify): _____

Testing Laboratory

Company Name: U.S. ARMY ENGINEER RESEARCH AND DEVELOPMENT CENTER, CONSTRUCTION ENGINEERING RESEARCH LABORATORY (CERL)
Contact Person: Jim Wilcoski
Mailing Address: 2902 Newmark Dr., Champaign IL 61822-1076
Telephone: (217) 373-6763 Email: James.wilcoski@usace.army.mil
Company Name: DYNAMIC CERTIFICATION LABORATORY (DCL)
Contact Person: Kelly Laplace
Mailing Address: 1315 Greg St., Ste 109, Sparks NV 89431
Telephone: (775) 358-5085 Email: Kelly@shaketest.com

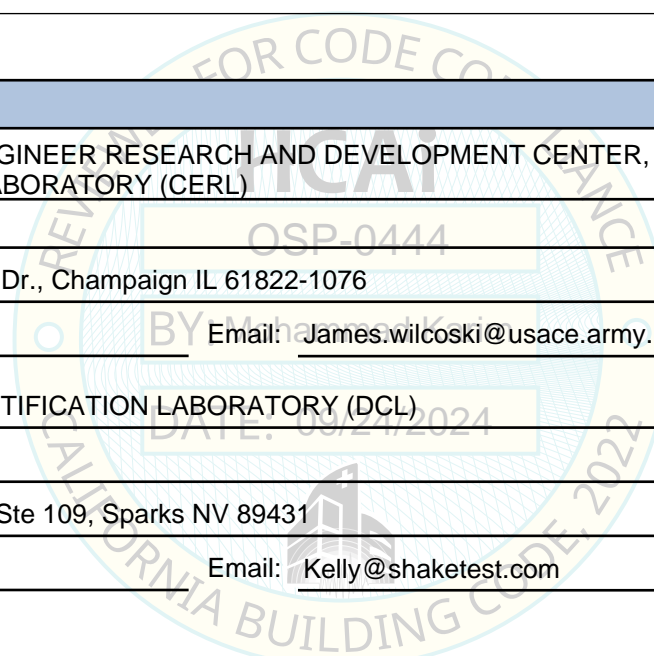



**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

Seismic Parameters

Design Basis of Equipment or Components (F_p/W_p) = 4.5 (SDS=2.0, z/h=1.0), 1.80 (SDS=2.4, z/h=0)] Spring Isolated [1.5 (SDS=2.0, z/h=1.0), 1.08 (SDS=2.4, z/h=0)] Rigid

SDS (Design spectral response acceleration at short period, g) = 2.00 (z/h=1), 2.40 (z/h=0)

a_p (Amplification factor) = 2.5

R_p (Response modification factor) = 2.0 (Spring Isolated); 6.0 (Rigid)


Ω_0 (System overstrength factor) = 2.0

I_p (Importance factor) = 1.5

z/h (Height ratio factor) = 1 and 0

Natural frequencies (Hz) = See Attachment

Overall dimensions and weight = See Attachment

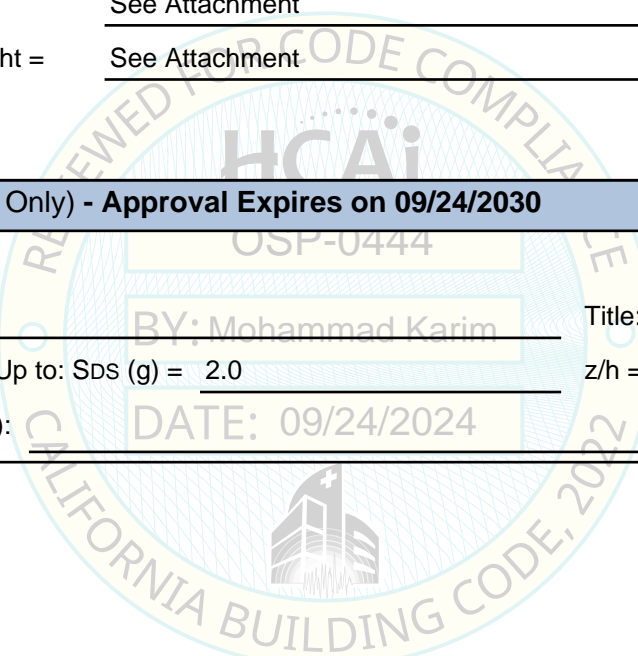

HCAI Approval (For Office Use Only) - Approval Expires on 09/24/2030

Date: 9/24/2024

Name: Mohammad Karim

Title: Supervisor, Health Facilities

Special Seismic Certification Valid Up to: SDS (g) = 2.0

z/h = 1

Condition of Approval (if applicable): DATE: 09/24/2024



Table 1 - Certified 60Hz Diesel Generator Set with Radiators

Model ⁽¹⁾	Skid Type	Power Rating [kW]	Dimensional Data				Engine	Alternator	Radiator	Controller	z/h = 1 S _{Ds} (g)	z/h = 0 S _{Ds} (g)	UUT
			Max Length [in]	Max Width [in]	Max Height [in]	Max Weight [lbs]							
C3000 D6 / C3000 D6e⁽¹⁾	P80	2500 - 3000	311	119	150	67,682	Cummins	Cummins	Young Touchstone	Cummins	2.00	2.40	UUT-01
	DIG		305	119	150	74,060					2.00	2.40	Interpolated
C3250 D6 / C3250 D6e	P80	2500 - 3250	322	125	150	70,218					2.00	2.40	Interpolated
	DIG		341	125	150	79,807					2.00	2.40	Interpolated
C3500 D6 / C3500 D6e⁽¹⁾	P80	2750 - 3500	322	125	150	70,107					2.00	2.40	Interpolated
	DIG		341	125	150	79,807					2.00	2.40	UUT-02

Table 2 - Certified 60Hz Diesel Generator Set without Radiators

Model ^(1, 2)	Skid Type	Power Rating [kW]	Dimensional Data				Engine	Alternator	Radiator	Controller	z/h = 1 S _{Ds} (g)	z/h = 0 S _{Ds} (g)	UUT
			Max Length [in]	Max Width [in]	Max Height [in]	Max Weight [lbs]							
C3000 D6 / C3000 D6e⁽¹⁾	P80	2500 - 3000	239	82	118	56,218	Cummins	Cummins	N/A	Cummins	2.00	2.40	Similar to UUT-01
	DIG		250	99	118	63,544					2.00	2.40	Interpolated
C3250 D6 / C3250 D6e	P80	2500 - 3250	239	82	118	56,218					2.00	2.40	Interpolated
	DIG		250	99	118	63,544					2.00	2.40	Interpolated
C3500 D6 / C3500 D6e⁽¹⁾	P80	2750 - 3500	239	82	118	56,218					2.00	2.40	Interpolated
	DIG		250	99	118	64,816					2.00	2.40	Similar to UUT-02

Table 3 - Certified PCC3300 HMI Pedestal Mounted

Model	Dimensions				Manufacturer	z/h = 1 S _{Ds} (g)	z/h = 0 S _{Ds} (g)	UUT
	Max Length [in]	Max Width [in]	Max Height [in]	Max Weight [lbs]				
PCC3300 HMI (Pedestal Mounted)	20	20	52	64	Cummins	2.00	2.40	UUT-03

Notes

- 1) The only differences between the "e" and non-"e" models is software.
- 2) Generator sets listed in Table 2 are identical to those listed in Table 1 except that they lack a radiator.
- 3) UUT-01 & UUT-02 are floor mounted on spring isolators.

Table 4 - Certified Subcomponents: Engine

Applicable Genset Models	Model Number	Max Weight [lbs]	Manufacturer	Optional Engine Features	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	QSK 95	29,321	Cummins	Duplex Fuel Filters Non-Duplex Fuel Filters Cartridge Lube Oil Filter DC Prelube Device Standard Electric Starter Redundant Electric Starter Coalescing Breather	UUT-01, UUT-02

Table 5 - Certified Subcomponents: Alternator

Applicable Genset Models	Model Number	Manufacturer	Material	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e	S9 E	Cummins	Carbon Steel Laminations and Copper Windings	13,970	Extrapolated
	P80 S			14,065	Extrapolated
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	P80 T			14,992	Extrapolated
	S9 F			15,070	Extrapolated
	S9 G			17,086	Extrapolated
	S9 H			18,078	Extrapolated
	P80 W			18,950	Extrapolated
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	P80 X			19,080	UUT-01
N/A	P80 Y			19,150	Interpolated
C3500 D6 / C3500 D6e	DIG C			20,780	Interpolated
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	DIG D			21,510	Interpolated
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	DIG E			22,330	Interpolated
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	DIG F			24,760	Interpolated
C3500 D6 / C3500 D6e	DIG G	26,032	UUT-02		

Table 6 - Certified Subcomponents: Radiator

Applicable Genset Models	Part Number	Core Size [ft ²]	Material	Manufacturer	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	A065K762 / A065K763 / A065K764 / A065K765	84	Copper Core Carbon Steel Structure	Young Touchstone	11,500	Interpolated
	A049E404	84			11,500	UUT-01
	A065K759	94			13,140	Interpolated
	A048D643	94			13,140	UUT-02

Table 7 - Certified Subcomponents: Skid

Applicable Genset Models	Material	Skid Type	Part Number	Manufacturer	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	Structural Carbon Steel	P80	A074U309	Cummins	4,608	Extrapolated
		P80	A047N790		5,100	UUT-01
		DIG	A047Y181		9,000	UUT-02

Table 8 - Certified Subcomponents: Controller

Applicable Genset Models	Model Number	Manufacturer	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	PCC 3300	Cummins	250	UUT-01, UUT-02
	PCC 3300 HMI ONLY, ON PEDESTAL		65	UUT-03

Table 9 - Certified Subcomponents: Air Cleaner

Applicable Genset Models	Description	Manufacturer	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	Normal Duty	Cummins	1,000	UUT-01
	Heavy Duty		1,400	UUT-02

Table 10 - Certified Subcomponents: Power Distribution Boxes

Applicable Genset Models	Description	Manufacturer	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	AC Distribution Box, A055K503	Cummins	26	UUT-05a, UUT-05b ¹
	DC Distribution Box, A062R012		84	UUT-04a, UUT-04b ¹

1) UUT-04 and UUT-05 tested in rigid wall and flexible wall configuration to certify the boxes to be mounted to the side of the genset. Newly tested boxes mount to the same location on the genset as tested in the full genset models UUT-01 and UUT-02.

Table 11 - Certified Subcomponents: Motor Starter

Applicable Genset Models	Model Number	Manufacturer	Max Weight [lbs]	UUT
C3000 D6 / C3000 D6e / C3250 D6 / C3250 D6e / C3500 D6 / C3500 D6e	M128	Prestolite	38	UUT-06a, UUT-06b





UNIT UNDER TEST (UUT) Summary Sheet

UUT-1

Test Report: VMA-49625-01E

Model Line	Model Number	Manufacturer
3000-3500 kW QSK95 Gensets	C3000 D6	Cummins Power Generation

Product Construction Summary

Diesel powered electrical generator set 3000 kW. Carbon Steel base frame

Options / Subcomponent Summary


Engine: Cummins ; QSK 95, Alternator: Cummins ; P80X, Radiator: Young Touchstone ; A049E404, Skid: Cummins / A047N790, Controller: Cummins / PCC 3300, Air Cleaner: Cummins / Normal Duty

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
67,682	311.00	119.00	150.00	3.3	3.2	6.7

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using (18) VMC M2SSHX-1E spring isolators. Isolators are welded to the fixture.

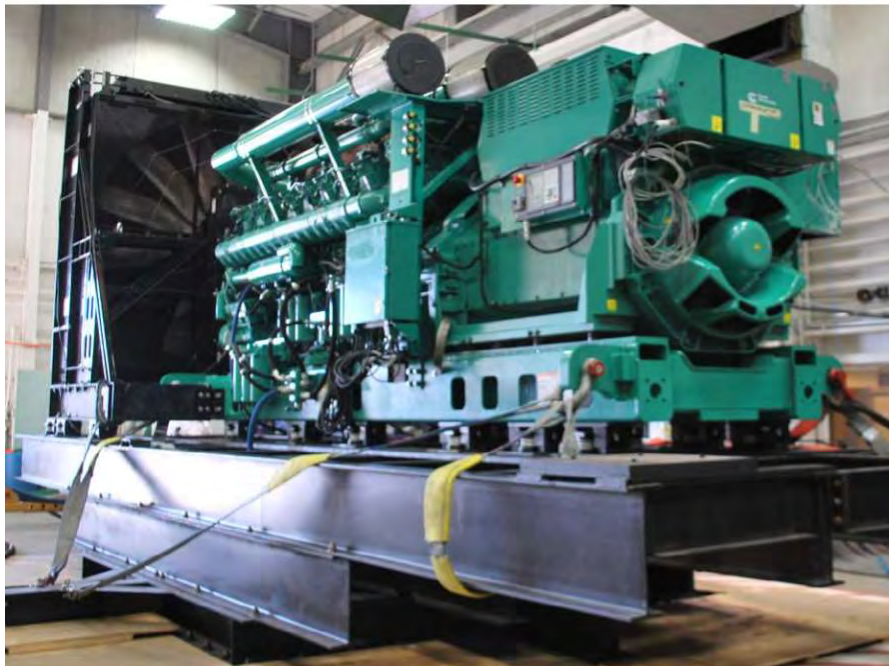

All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-2

Test Report: VMA-49625-01E

Model Line	Model Number	Manufacturer
3000-3500 kW QSK95 Gensets	C3500 D6	Cummins Power Generation

Product Construction Summary

Diesel powered electrical generator set 3500 kW. Carbon Steel base frame

Options / Subcomponent Summary

Engine: Cummins / QSK 95 ; Alternator: Cummins / DIG G ; Radiator: Young Touchstone / A048D643 ; Skid: Cummins / A047Y181 ; Controller: Cummins / PCC 3300 ; Air Cleaner: Cummins / Heavy Duty

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
79,807	341.00	125.00	150.00	3.3	3.2	6.6

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using (20) Caldyn RJEHD spring isolators. Isolators are welded to the fixture.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-3

Test Report: VMA-49625-01E

Model Line	Model Number	Manufacturer
HMI only on pedestal	PCC 3300 HMI	Cummins Power Generation

Product Construction Summary

ASTM A36 mild steel pedestal base, ASTM B221 6063 T-52 Aluminum pedestal upright, ASTM A569 mild steel HMI wrapper

Options / Subcomponent Summary

N/A

UUT Properties

Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
66	20.00	20.00	52.00	7.3	4.3	> 33.3

UUT Highest Passed Seismic Run Information

Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using (4) M12 Grade 8 Bolts.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-4a

Test Report: 31632-2101; UUT-1a

Model Line	Model Number	Manufacturer
DC Distribution Box for QSK95 Gensets	A062R012	Cummins Power Generation

Product Construction Summary

Carbon Steel Enclosure and Mounting Brackets

Options / Subcomponent Summary

Enclosure: Cummins; Mounting Brackets: Cummins

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
84	8.25	21.50	34.25	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using manufacturer provided mounting brackets (PN# A043D580). Mounting brackets were fastened to the unit, via (8) anti-vibration mounts (PN# A045Y867), M8 bolts, and round washers. Unit was mounted to the wall fixture using (8) 3/8" Grade 5 bolts and (8) manufacturer provided bushings (PN# A052N277). Wall fixture attached directly to shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-4b

Test Report: 31632-2101; UUT-1b

Model Line	Model Number	Manufacturer
DC Distribution Box for QSK95 Gensets	A062R012	Cummins Power Generation

Product Construction Summary

Carbon Steel Enclosure and Mounting Brackets

Options / Subcomponent Summary

Enclosure: Cummins; Mounting Brackets: Cummins

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
84	8.25	21.50	34.25	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using manufacturer provided mounting brackets (PN# A043D580). Mounting brackets were fastened to the unit, via (8) anti-vibration mounts (PN# A045Y867), M8 bolts, and round washers. Unit was mounted to the wall fixture using (8) 3/8" Grade 5 bolts and (8) manufacturer provided bushings (PN# A052N277). Wall fixture attached to shake table using (4) VMC Group MSSH-1E-530N external spring isolators.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-5a

Test Report: 31632-2101; UUT-2a

Model Line	Model Number	Manufacturer
AC Distribution Box for QSK95 Gensets	A055K503	Cummins Power Generation

Product Construction Summary

Carbon Steel Enclosure and Mounting Brackets

Options / Subcomponent Summary

Enclosure: Cummins; Mounting Brackets: Cummins

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
26	5.75	10.50	21.25	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using manufacturer provided mounting brackets (PN# A052V294 [top] and A053M862 [bottom]). Mounting brackets were fastened to the unit, via (4) anti-vibration mounts (PN# A043E678), M6 bolts, and round washers. Unit was mounted to the wall fixture using (7) 3/8" Grade 5 bolts and (7) manufacturer provided bushings (PN# A043U714). Wall fixture attached directly to shake table.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-5b

Test Report: 31632-2101; UUT-2b

Model Line	Model Number	Manufacturer
AC Distribution Box for QSK95 Gensets	A055K503	Cummins Power Generation

Product Construction Summary

Carbon Steel Enclosure and Mounting Brackets

Options / Subcomponent Summary

Enclosure: Cummins; Mounting Brackets: Cummins

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
26	5.75	10.50	21.25	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.61	0.65

Test Mounting Details

Unit is mounted to test fixture using manufacturer provided mounting brackets (PN# A052V294 [top] and A053M862 [bottom]). Mounting brackets were fastened to the unit, via (4) anti-vibration mounts (PN# A043E678), M6 bolts, and round washers. Unit was mounted to the wall fixture using (7) 3/8" Grade 5 bolts and (7) manufacturer provided bushings (PN# A043U714). Wall fixture attached to shake table using (4) VMC Group MSSH-1E-530N external spring isolators.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-6a

Test Report: 19534-2201; UUT-4a, 5a

Model Line	Model Number	Manufacturer
Motor Starter for QSK95 Gensets	M128	Prestolite

Product Construction Summary
Carbon Steel

Options / Subcomponent Summary
N/A

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
38	5.00	5.50	15.50	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.60	0.64

Test Mounting Details

Unit is mounted to a 1/4" thick steel mounting plate on the wall fixture with (3) 1/2" Grade 5 bolts. The wall fixture attached to the shake table with (12) Grade 5 M12 threaded rods.



All units were filled with contents and maintained structural integrity and functionality after AC-156 test.



UNIT UNDER TEST (UUT) Summary Sheet

UUT-6b

Test Report: 19534-2201; UUT-4b, 5b

Model Line	Model Number	Manufacturer
Motor Starter for QSK95 Gensets	M128	Prestolite

Product Construction Summary

Carbon Steel

Options / Subcomponent Summary


N/A

UUT Properties						
Weight [lbs]	Dimensions [in]			Lowest Nat. Freq. [Hz]		
	Length	Width	Height	F-B	S-S	V
38	5.00	5.50	15.50	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information								
Building Code	Test Criteria	S _{DS}	z/h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
CBC 2022	ICC-ES AC156	2.00	1.0	1.5	3.20	2.40	-	-
		2.40	0.0	1.5	-	-	1.60	0.64

Test Mounting Details

Unit is mounted to a 1/4" thick steel mounting plate on the wall fixture with (3) 1/2" Grade 5 bolts. The wall fixture attached to (4) VMC M2SSH-1E-530N isolators using (4) 3/4" Grade 5 threaded rods. The isolator base plate attached to the shake table with (16) Grade 5 M12 threaded rods.

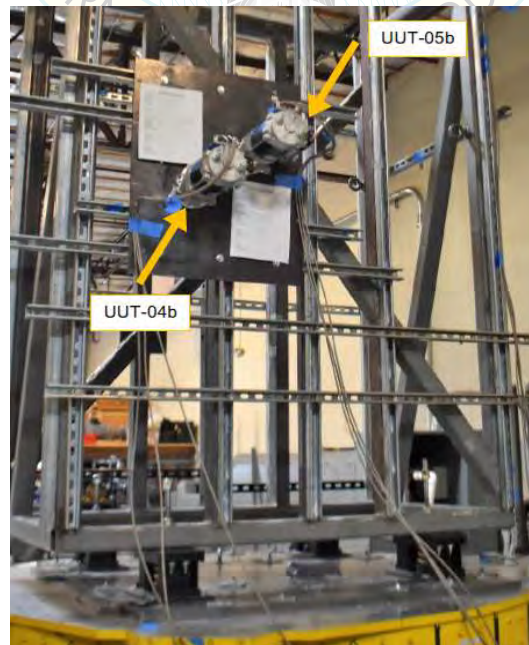

All units were filled with contents and maintained structural integrity and functionality after AC-156 test.