



DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT

**APPLICATION FOR HCAI SPECIAL SEISMIC
CERTIFICATION PREAPPROVAL (OSP)**

OFFICE USE ONLY

APPLICATION #: OSP-0638

HCAI Special Seismic Certification Preapproval (OSP)

Type: New Renewal

Manufacturer Information

Manufacturer: Vertiv Corporation

Manufacturer's Technical Representative: Julian Freeman

Mailing Address: 975 Pittsburgh Drive, Delaware, OH 43015

Telephone: (740) 833-8910

Email: Julian.Freeman@vertiv.com

Product Information

Product Name: Uninterruptible Power Supply (UPS)

Product Model Number(s): EXL-S1

Product Category: UPS and Batteries

Product Sub-Category: UPS

General Description: EXL-S1 600kVA UPS with backfeed disconnect and sharing inductor

Mounting Description: Base Mounted Rigid

Tested Seismic Enhancements: None

Applicant Information

Applicant Company Name: TRU Compliance, by Structural Integrity Associates, Inc.

Contact Person: Victoria Ahrens

Mailing Address: 233 SW Wilson Ave UNIT 101, Bend, OR 97702

Telephone: (541) 292-5820

Email: vahrens@structint.com

Title: Certification Engineer



**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)

Company Name: STRUCTURAL INTEGRITY ASSOCIATES, INC.

Name: LACHEZAR HANDZHIYSKI

California License Number: S6515

Mailing Address: 5215 Hellyer Avenue, Suite 210, San Jose, CA 95138

Telephone: (669) 437-0200

Email: Lhandzhiyski@StructInt.com

Certification Method

GR-63-Core

ICC-ES AC156

IEEE 344

IEEE 693

NEBS 3

Other (Please Specify): _____

Testing Laboratory

Company Name: ENVIRONMENTAL TESTING LABORATORIES, INC. (ETL)

Contact Person: Jeremy Lange


Mailing Address: 11034 Indian Trail, Dallas TX 75229-3513

Telephone: (972) 247-9657

Email: jeremy@etldallas.com

BY: Mohammad Karim

DATE: 06/02/2026

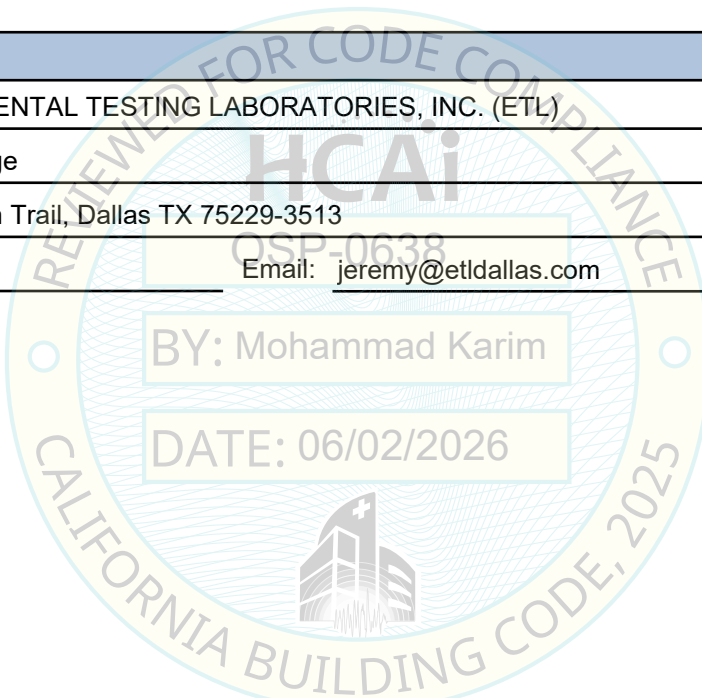



**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

Seismic Parameters

Certified Response Spectral Acceleration Factors:(F_p/W_p)

Horizontal (A Flx-H), $g = \underline{2.50}$ (A Rig-H), $g = \underline{1.68}$

Vertical (A Flx-V), $g = \underline{1.14}$ (A Rig-V), $g = \underline{0.46}$

SDS (Design spectral response acceleration at short period, g) = 1.56 (z/h = 1.0), 1.71 (z/h = 0.0)

Hf (Force amplification height factor) = 3.5 (z/h = 1.0); 1.0 (z/h = 0.0)

Ru (Structure ductility reduction factor) = 1.3 (z/h = 1.0); 1.0 (z/h = 0.0)

I_p (Importance factor) = 1.5

z/h (Height ratio factor) = 0 and 1

HCAI Approval (For Office Use Only) - Approval Expires on 06/02/2032

Date: 6/2/2026

Name: Mohammad Karim

Title: Supervisor, Health Facilities

Condition of Approval (if applicable):

OSP-0638

BY: Mohammad Karim

DATE: 06/02/2026

