



DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT

**APPLICATION FOR HCAI SPECIAL SEISMIC  
CERTIFICATION PREAPPROVAL (OSP)**

OFFICE USE ONLY

**APPLICATION #: OSP-0838**

**HCAI Special Seismic Certification Preapproval (OSP)**

Type:  New  Renewal

**Manufacturer Information**

Manufacturer: Johnson Controls

Manufacturer's Technical Representative: Ken Zhu

Mailing Address: 5000 Renaissance Drive, New Freedom, PA 17349

Telephone: (717) 668-2906 Email: ken.yu.zhu@jci.com

**Product Information**

Product Name: YVWH - Screw Chiller and Heat Pump

Product Model Number(s): YVWH450PC66A22WAX

Product Category: Chillers

Product Sub-Category: Chillers - Water Cooled

General Description: Welded carbon steel evaporator and condenser vessels with compressors, motors, VSD, and controller.

Mounting Description: Base Mounted Spring and Neoprene Vibration Isolated -

Tested Seismic Enhancements: Seismic enhancements made to the test units and/or modifications required to address anomalies during the tests shall be incorporated into the production units.

**Applicant Information**

Applicant Company Name: Manwill Engineering LLC

Contact Person: Derek Manwill

Mailing Address: PO Box 1194, Bend, OR 97709

Telephone: (541) 241-2102 Email: derek@manwillse.com

Title: President





**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

**California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)**


Company Name: MANWILL ENGINEERING LLC  
Name: Derek Manwill California License Number: S6266  
Mailing Address: PO Box 1194, Bend, OR 97709  
Telephone: (541) 241-2102 Email: derek@manwillse.com

**Certification Method**

GR-63-Core     ICC-ES AC156     IEEE 344     IEEE 693     NEBS 3  
 Other (Please Specify): \_\_\_\_\_

**Testing Laboratory**

Company Name: U.S. ARMY ENGINEER RESEARCH AND DEVELOPMENT CENTER, CONSTRUCTION ENGINEERING RESEARCH LABORATORY (CERL)  
Contact Person: James Wilcoski  
Mailing Address: 2902 Newmark Dr., Champaign IL 61822-1076  
Telephone: (217) 373-4565 Email: james.wilcoski@usace.army.mil

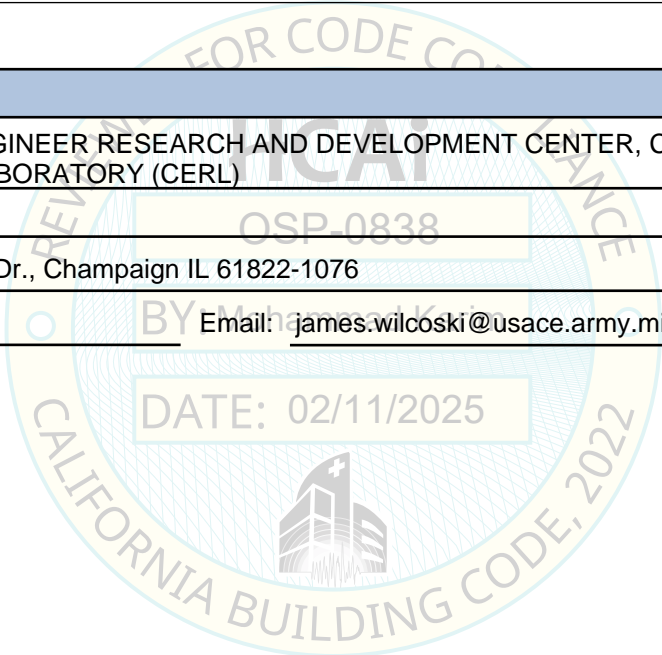



**DEPARTMENT OF HEALTH CARE ACCESS AND INFORMATION  
OFFICE OF STATEWIDE HOSPITAL PLANNING AND DEVELOPMENT**

**Seismic Parameters**

Design Basis of Equipment or Components ( $F_p/W_p$ ) = 3.94 (SDS=1.75, z/h=1), 1.88 (SDS=2.50, z/h=0)

SDS (Design spectral response acceleration at short period, g) = 1.75 (z/h=1), 2.50 (z/h=0)

$a_p$  (Amplification factor) = 2.5

$R_p$  (Response modification factor) = 2.0 (2.5 for neoprene)

$\Omega_0$  (System overstrength factor) = 2.0

$I_p$  (Importance factor) = 1.5

z/h (Height ratio factor) = 1 and 0

Natural frequencies (Hz) = See Attachment

Overall dimensions and weight = See Attachment


**HCAI Approval (For Office Use Only) - Approval Expires on 02/10/2031**

Date: 2/11/2025

Name: Mohammad Karim Title: Supervisor, Health Facilities

Special Seismic Certification Valid Up to: SDS (g) = 1.75 z/h = 1

Condition of Approval (if applicable): DATE: 02/11/2025

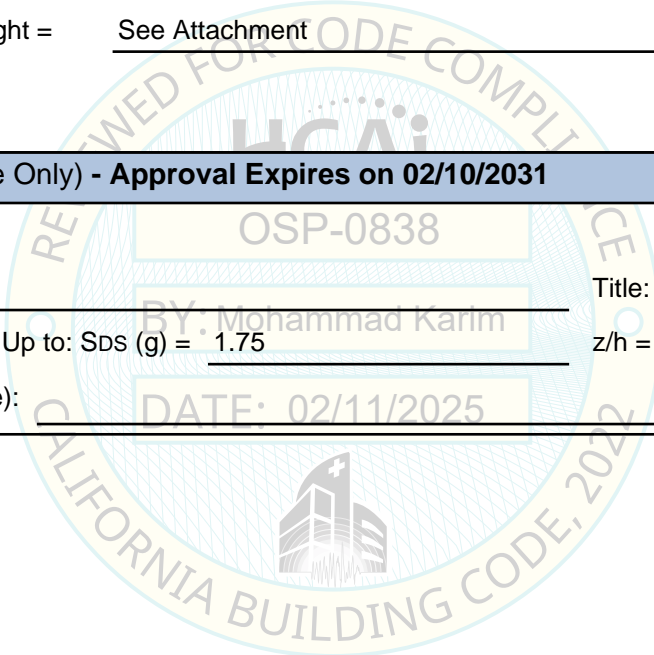


**JOHNSON CONTROLS**  
**YVWH - Screw Chiller and Heat Pump**

**TABLE 1**

Model Number	Dimensions (in)			Max. Wt. (lb)	Description / Notes	Basis
	Depth	Width	Height			
<b>YVWH - Screw Chiller and Heat Pump</b>						
YVWH450PC66A22WAX	86.0	144.0	98.0	23,350		<b>UUT 1</b>
<b>Mounting:</b> Base Mounted Spring and Neoprene Vibration Isolated				<b>Seismic Levels:</b>	$S_{DS} = 1.75g$ for $z/h = 1$ $S_{DS} = 2.50g$ for $z/h = 0$	$I_p = 1.5$

**Product Construction:** Welded carbon steel vessels. NEMA 1 carbon steel electrical panels. Copper tubes.

**Options/Subcomponents:** Since only one unit was tested, variations are not allowed. The following option selections are required: 460V/60Hz, 150psi, 19mm insulation (evaporator & condenser), grooved nozzle connection, 2-pass, compact water boxes, no hinges, no condenser epoxy coating, no isolation valve.

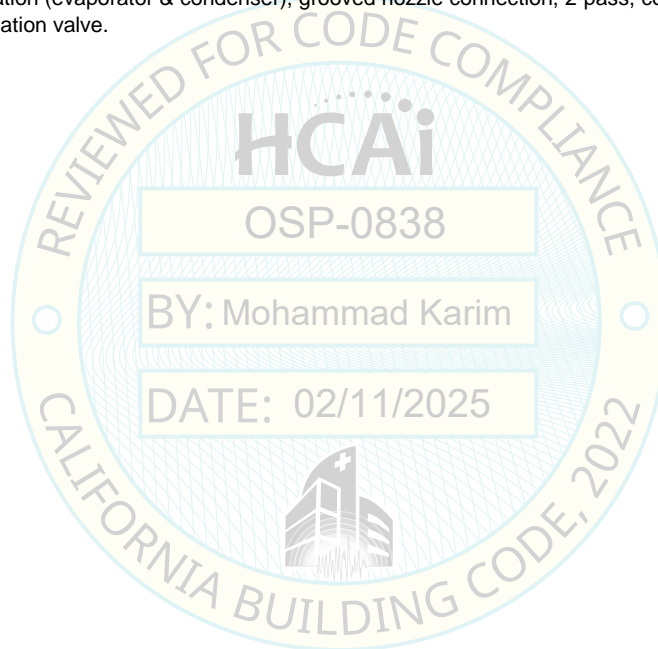


**JOHNSON CONTROLS**  
**YVWH - Screw Chiller and Heat Pump**

**TABLE 2. SUBCOMPONENTS**

Model Number	Dimensions (in)			Max. Wt. (lb)	Description / Notes	Basis
	Depth	Width	Height			
<b>Type: Evaporator - Mfr: Johnson Controls</b>						
Evaporator-YVWH450	144.0	36.6	90.0	6,486		UUT 1
<b>Type: Condenser - Mfr: Johnson Controls</b>						
Condenser-YVWH450	144.0	40.9	48.9	8,077		UUT 1
<b>Type: Compressor - Mfr: Johnson Controls</b>						
GT205s-BVUT46/50	61.0	27.0	23.5	2,403		UUT 1
GT233s-BVUY46/50	73.0	28.0	28.2	3,302		UUT 1
<b>Type: VSD - Mfr: Johnson Controls</b>						
YGV-0555BN-2-66AI	83.0	16.0	51.0	1,117		UUT 1
<b>Type: SmartView II Controller - Mfr: Johnson Controls</b>						
YVWH450ETL	22.0	10.0	24.5	84		UUT 1
<b>Mounting:</b> Mounted within unit.				<b>Seismic Levels:</b>	$S_{DS} = 1.75g$ for $z/h = 1$ $S_{DS} = 2.50g$ for $z/h = 0$	$I_p = 1.5$

**Construction/Options:** Model number uniquely identifies manufacturer, materials, and configuration of subcomponents.

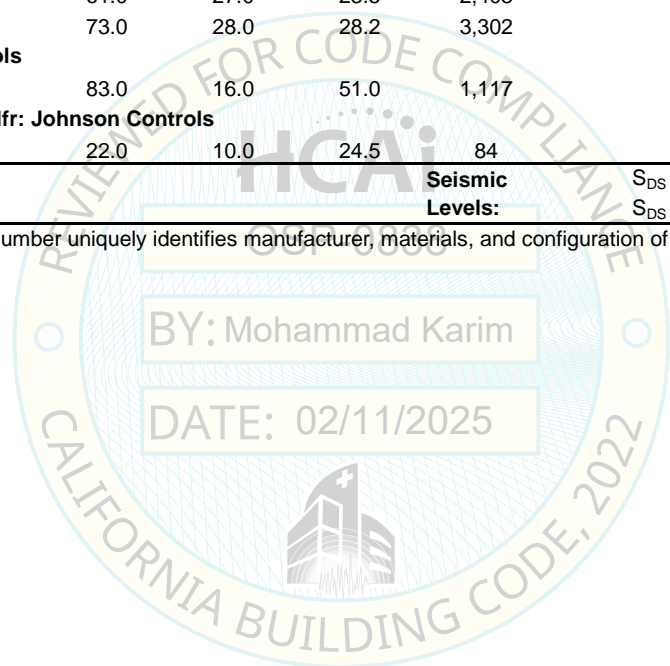

## UUT 1A - Pads

Manufacturer: Johnson Controls  
 Model number: YVWH450PC66A22WAX  
 Unit function: Screw Chiller and Heat Pump  
 Serial number: 50612K12742554

Dimensions (in)			Weight (lb)	Res. Freq. (Hz)		
Depth	Width	Height		F-B	S-S	V
86.0	144.0	98.0	23,350	8.1	6.0	28.5

Code & criteria: 2022 CBC, ICC-ES AC156

Test laboratory: US Army ERDC-CERL

Report: 24024TR1.0 (dated 2-7-25), tested on 12-9-24

S <sub>DS</sub> (g)	z/h	A <sub>FLX-H</sub> (g)	A <sub>RIG-H</sub> (g)	A <sub>FLX-V</sub> (g)	A <sub>RIG-V</sub> (g)
1.75	1.00	2.80	2.10	1.68	0.68
2.50	0.00				

Importance Factor, I<sub>P</sub> = 1.5: Unit was full of operating content during the shake table test. Unit maintained structural integrity and remained functional per manufacturer requirement after shake table test.



- Mounting:** Base mounted neoprene vibration isolated. UUT was mounted on (4) Mason neoprene pad assemblies (P/N 028-12849-000) with a total of (8) 1-1/4-in Grade 8 bolts (2 per pad). Pad assembly consists of: 15x8x3/8-in A36 plate on 14x7x3/4-in 60 duro neoprene pad, bolt goes through steel sleeve that sits inside neoprene sleeve, bolt head rests on structural washer and 4-in OD x 1/4-in thick washer which sits on 1/4-in neoprene washer.
- Construction:** Welded carbon steel vessels. NEMA 1 carbon steel electrical panels. Copper tubes. The following options were selected for the test unit: 460V/60Hz, 150psi, 19mm insulation (evaporator & condenser), grooved nozzle connection, 2-pass, compact water boxes, no hinges, no condenser epoxy coating, no isolation valve.
- Subcomponents:** Johnson Controls - Evaporator (Evaporator-YVWH450), Johnson Controls - Condenser (Condenser-YVWH450), Johnson Controls - Compressor (GT205s-BVUT46/50, GT233s-BVUY46/50), Johnson Controls - VSD (YGV-0555BN-2-66AI), Johnson Controls - SmartView II Controller (YVWH450ETL).
- Testing notes:** UUT 1A and UUT 1B are the same physical unit with different mounting. Testing at non-accredited laboratory meets the requirements of PIN 58 Item #16.



## UUT 1B - Springs

Manufacturer: Johnson Controls  
 Model number: YVWH450PC66A22WAX  
 Unit function: Screw Chiller and Heat Pump  
 Serial number: 50612K12742554



Dimensions (in)			Weight (lb)	Res. Freq. (Hz)		
Depth	Width	Height		F-B	S-S	V
86.0	144.0	98.0	23,350	2.4	3.0	6.1

Code & criteria: 2022 CBC, ICC-ES AC156

Test laboratory: US Army ERDC-CERL

Report: 24024TR1.0 (dated 2-7-25), tested on 12-10-24

S <sub>DS</sub> (g)	z/h	A <sub>FLX-H</sub> (g)	A <sub>RIG-H</sub> (g)	A <sub>FLX-V</sub> (g)	A <sub>RIG-V</sub> (g)
1.75	1.00	2.80	2.10	1.68	0.68
2.50	0.00				

Importance Factor, I<sub>P</sub> = 1.5: Unit was full of operating content during the shake table test. Unit maintained structural integrity and remained functional per manufacturer requirement after shake table test.

**Mounting:** Base mounted spring vibration isolated. UUT was mounted on (4) Mason spring isolators (SLFADA600-2-111) with a total of (16) 1-in Grade 5 bolts (4 per isolator). Each spring isolator was bolted to the test fixture with (8) 1-in Grade 8 bolts (36 total).

**Construction:** Welded carbon steel vessels. NEMA 1 carbon steel electrical panels. Copper tubes.

The following options were selected for the test unit: 460V/60Hz, 150psi, 19mm insulation (evaporator & condenser), grooved nozzle connection, 2-pass, compact water boxes, no hinges, no condenser epoxy coating, no isolation valve.

**Subcomponents:** Johnson Controls - Evaporator (Evaporator-YVWH450), Johnson Controls - Condenser (Condenser-YVWH450), Johnson Controls - Compressor (GT205s-BVUT46/50, GT233s-BVUY46/50), Johnson Controls - VSD (YGV-0555BN-2-66AI), Johnson Controls - SmartView II Controller (YVWH450ETL).

**Testing notes:** UUT 1A and UUT 1B are the same physical unit with different mounting.  
 Testing at non-accredited laboratory meets the requirements of PIN 58 Item #16.