UCSF Medical Center
Facility No. 12476

5/19/2025

See page 2

BLD-01016 - Central Utilities Plant - Bldg 05

BLD-06994 Pump House - Bldg 08

BLD-06928 Oxygen Yard - Bldg 07

BLD-01013 - Long Hospital - Bldg 02

BLD-01015 - Magnetic Resonance Imaging Building - Bldg 04

BLD-06771 Helen Diller Hospital - Bldg 06

BLD-01014 - Emergency Entrance Structure - Bldg 03

BLD-01012 - Moffitt Hospital - Bldg 01

BLD-07135 Electrical Building - Bldg 09

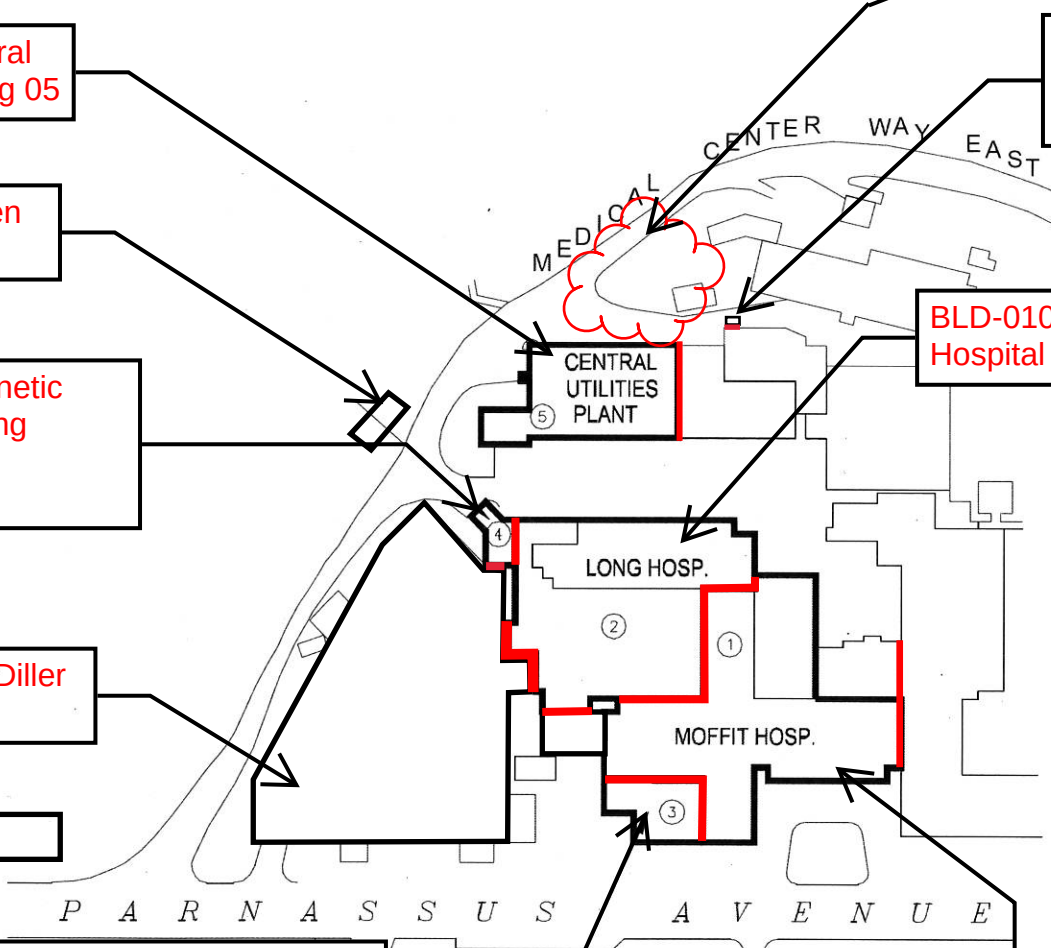

0 50' 100' 200'

N

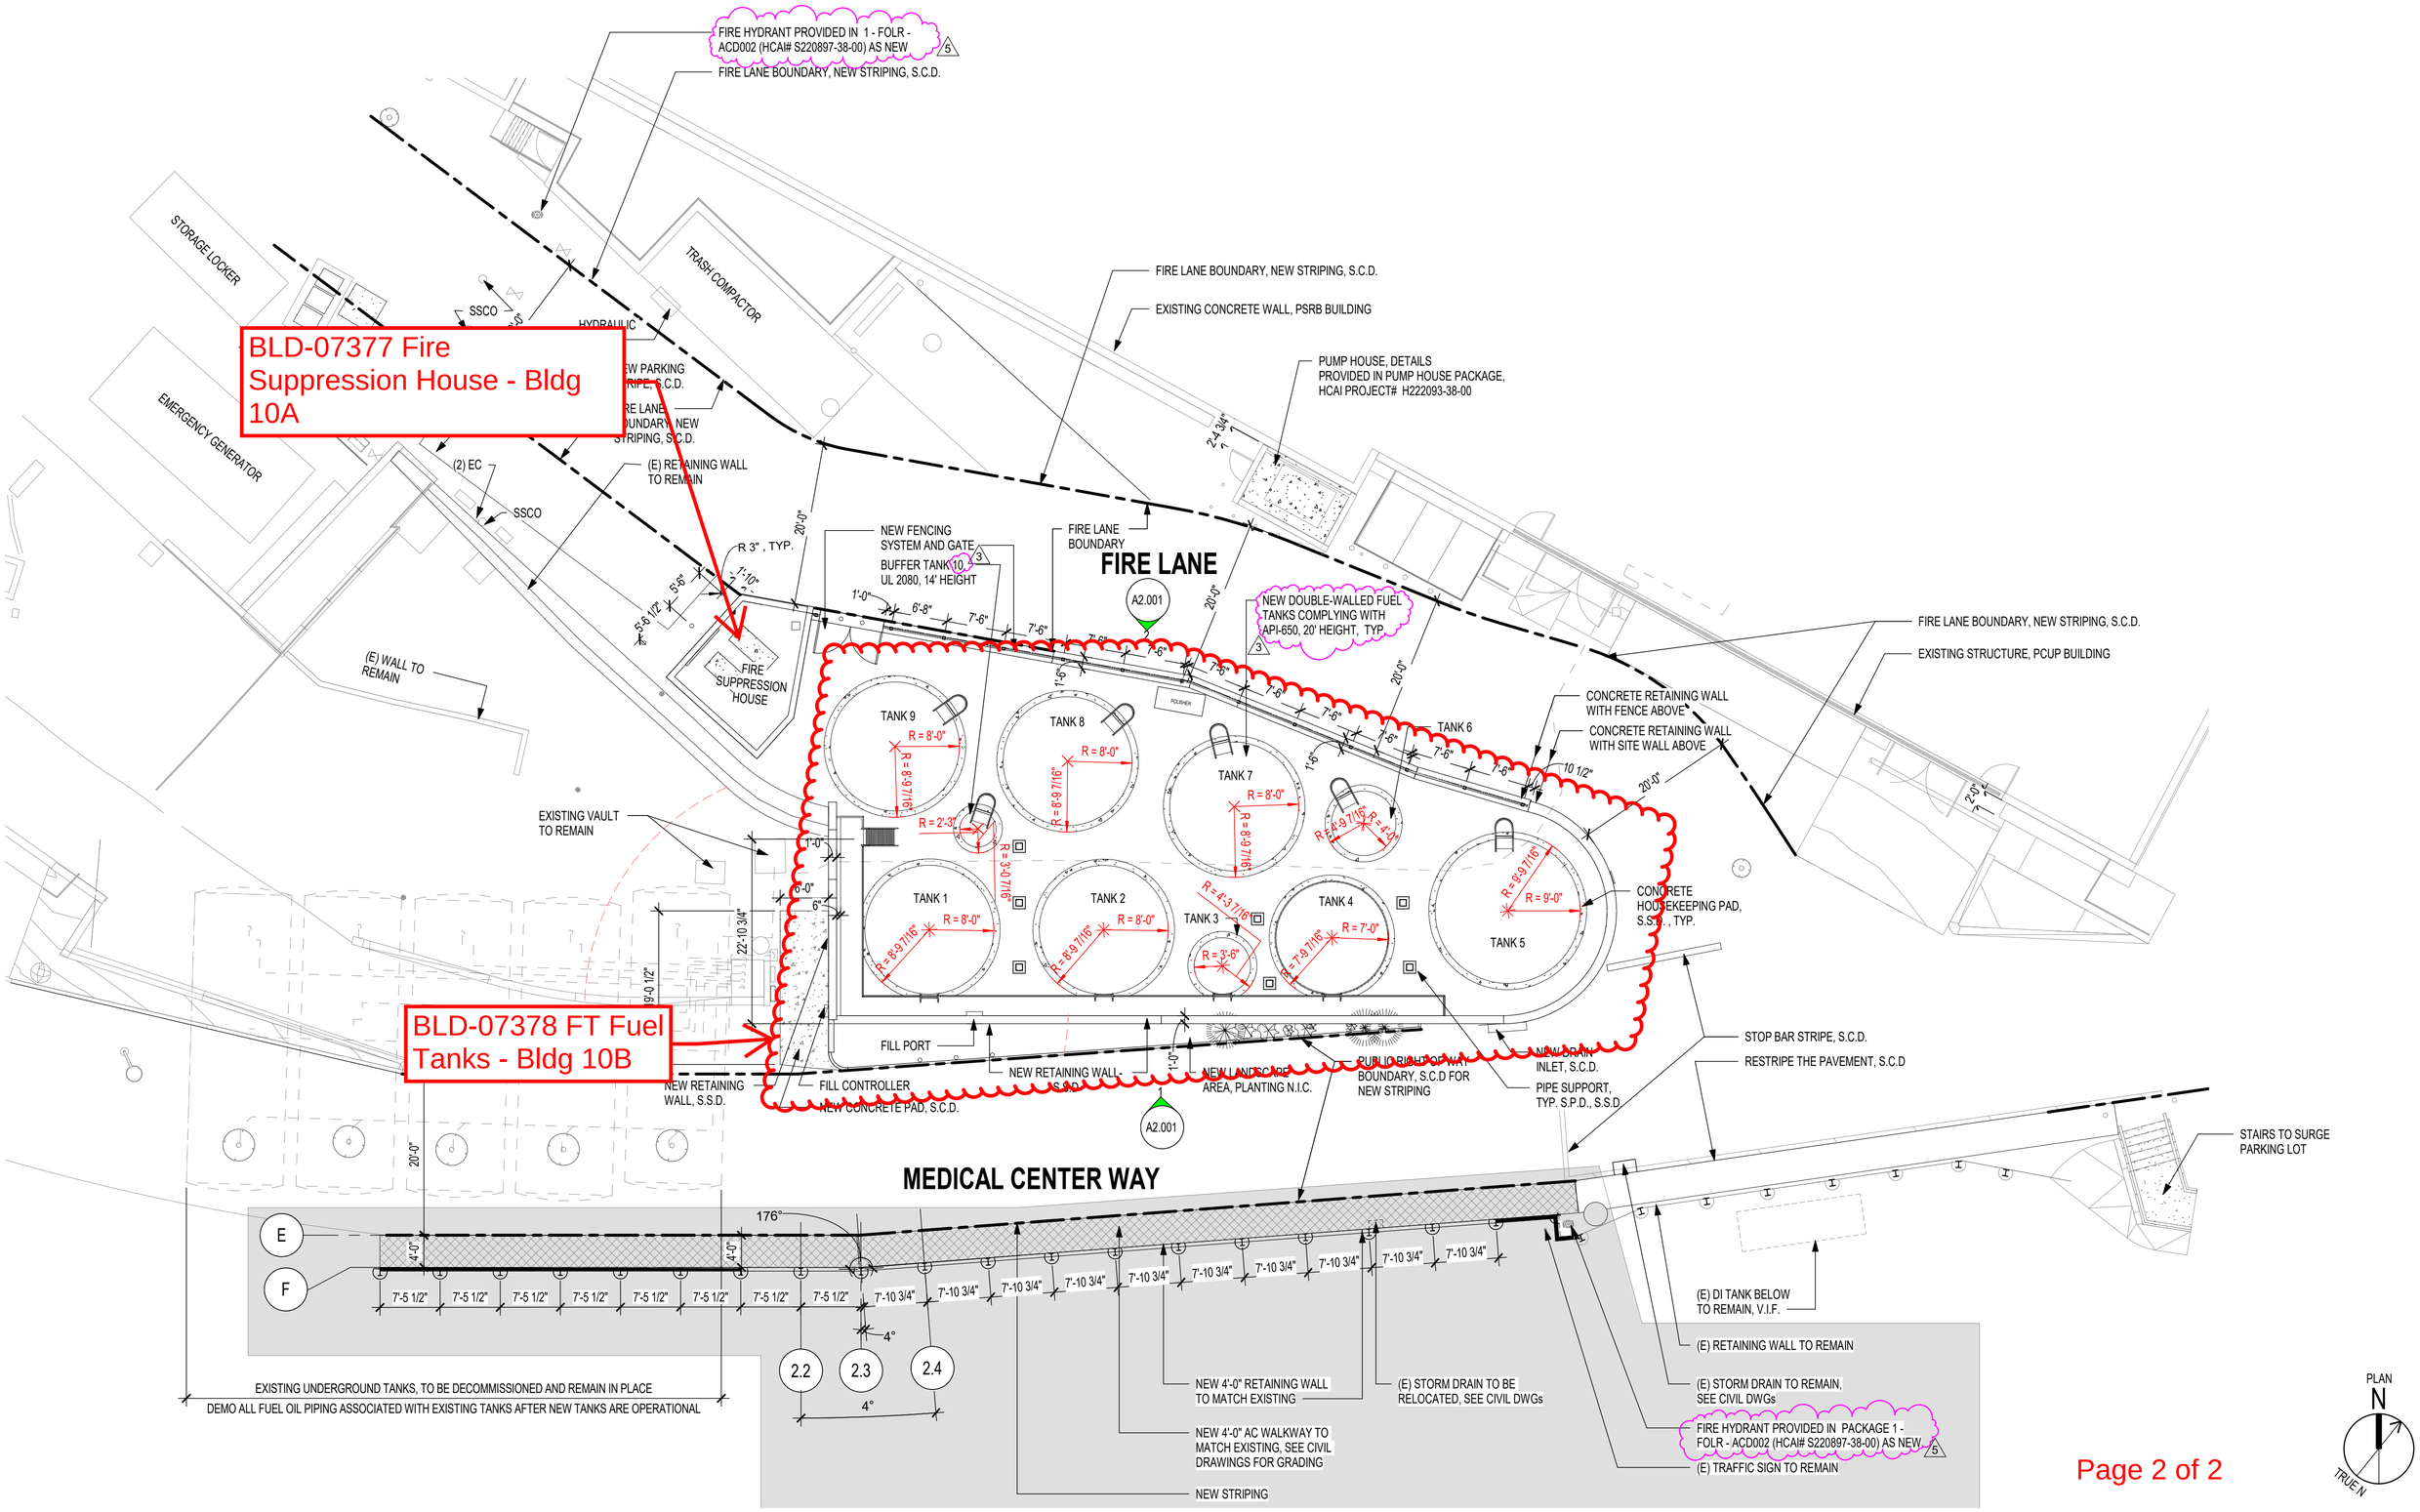
FIRE HYDRANT PROVIDED IN 1 - FOLR - ACD002 (HCAI# S220897-38-00) AS NEW
FIRE LANE BOUNDARY, NEW STRIPING, S.C.D.
STORAGE LOCKER
TRASH COMPACTOR
EMERGENCY GENERATOR
BLD-07377 Fire Suppression House - Bldg 10A
SSCO
HYDRAULIC
(2) EC
(E) RETAINING WALL TO REMAIN
(E) WALL TO REMAIN
FIRE SUPPRESSION HOUSE
FIRE LANE BOUNDARY, NEW STRIPING, S.C.D.
EXISTING CONCRETE WALL, PSRB BUILDING
PUMP HOUSE, DETAILS PROVIDED IN PUMP HOUSE PACKAGE, HCAI PROJECT# H222093-38-00
NEW FENCING SYSTEM AND GATE
BUFFER TANK 10, UL 2080, 14' HEIGHT
FIRE LANE BOUNDARY
FIRE LANE
A2.001
NEW DOUBLE-WALLED FUEL TANKS COMPLYING WITH API-650, 20' HEIGHT, TYP.
FIRE LANE BOUNDARY, NEW STRIPING, S.C.D.
EXISTING STRUCTURE, PCUP BUILDING
CONCRETE RETAINING WALL WITH FENCE ABOVE
CONCRETE RETAINING WALL WITH SITE WALL ABOVE
TANK 9
TANK 8
TANK 7
TANK 6
TANK 1
TANK 2
TANK 3
TANK 4
TANK 5
EXISTING VAULT TO REMAIN
BLD-07378 FT Fuel Tanks - Bldg 10B
FILL PORT
NEW RETAINING WALL, S.S.D.
FILL CONTROLLER
NEW CONCRETE PAD, S.C.D.
NEW RETAINING WALL - S.S.D.
NEW LANDSCAPE AREA, PLANTING N.I.C.
PUBLIC RIGHT OF WAY BOUNDARY, S.C.D FOR NEW STRIPING
NEW DRAIN INLET, S.C.D.
PIPE SUPPORT, TYP. S.P.D., S.S.D.
CONCRETE HOUSEKEEPING PAD, S.S.D., TYP.
STOP BAR STRIPE, S.C.D.
RESTRIPE THE PAVEMENT, S.C.D
STAIRS TO SURGE PARKING LOT
MEDICAL CENTER WAY
(E) DI TANK BELOW TO REMAIN, V.I.F.
(E) RETAINING WALL TO REMAIN
(E) STORM DRAIN TO REMAIN, SEE CIVIL DWGs
FIRE HYDRANT PROVIDED IN PACKAGE 1 - FOLR - ACD002 (HCAI# S220897-38-00) AS NEW
(E) TRAFFIC SIGN TO REMAIN
NEW 4'-0" RETAINING WALL TO MATCH EXISTING
(E) STORM DRAIN TO BE RELOCATED, SEE CIVIL DWGs
NEW 4'-0" AC WALKWAY TO MATCH EXISTING, SEE CIVIL DRAWINGS FOR GRADING
NEW STRIPING
EXISTING UNDERGROUND TANKS, TO BE DECOMMISSIONED AND REMAIN IN PLACE
DEMO ALL FUEL OIL PIPING ASSOCIATED WITH EXISTING TANKS AFTER NEW TANKS ARE OPERATIONAL
PLAN
N
TRUE N