


- Hazardous areas

2 hour rated walls
- FE

Fire Extinguisher
- ox

Oxygen Storage

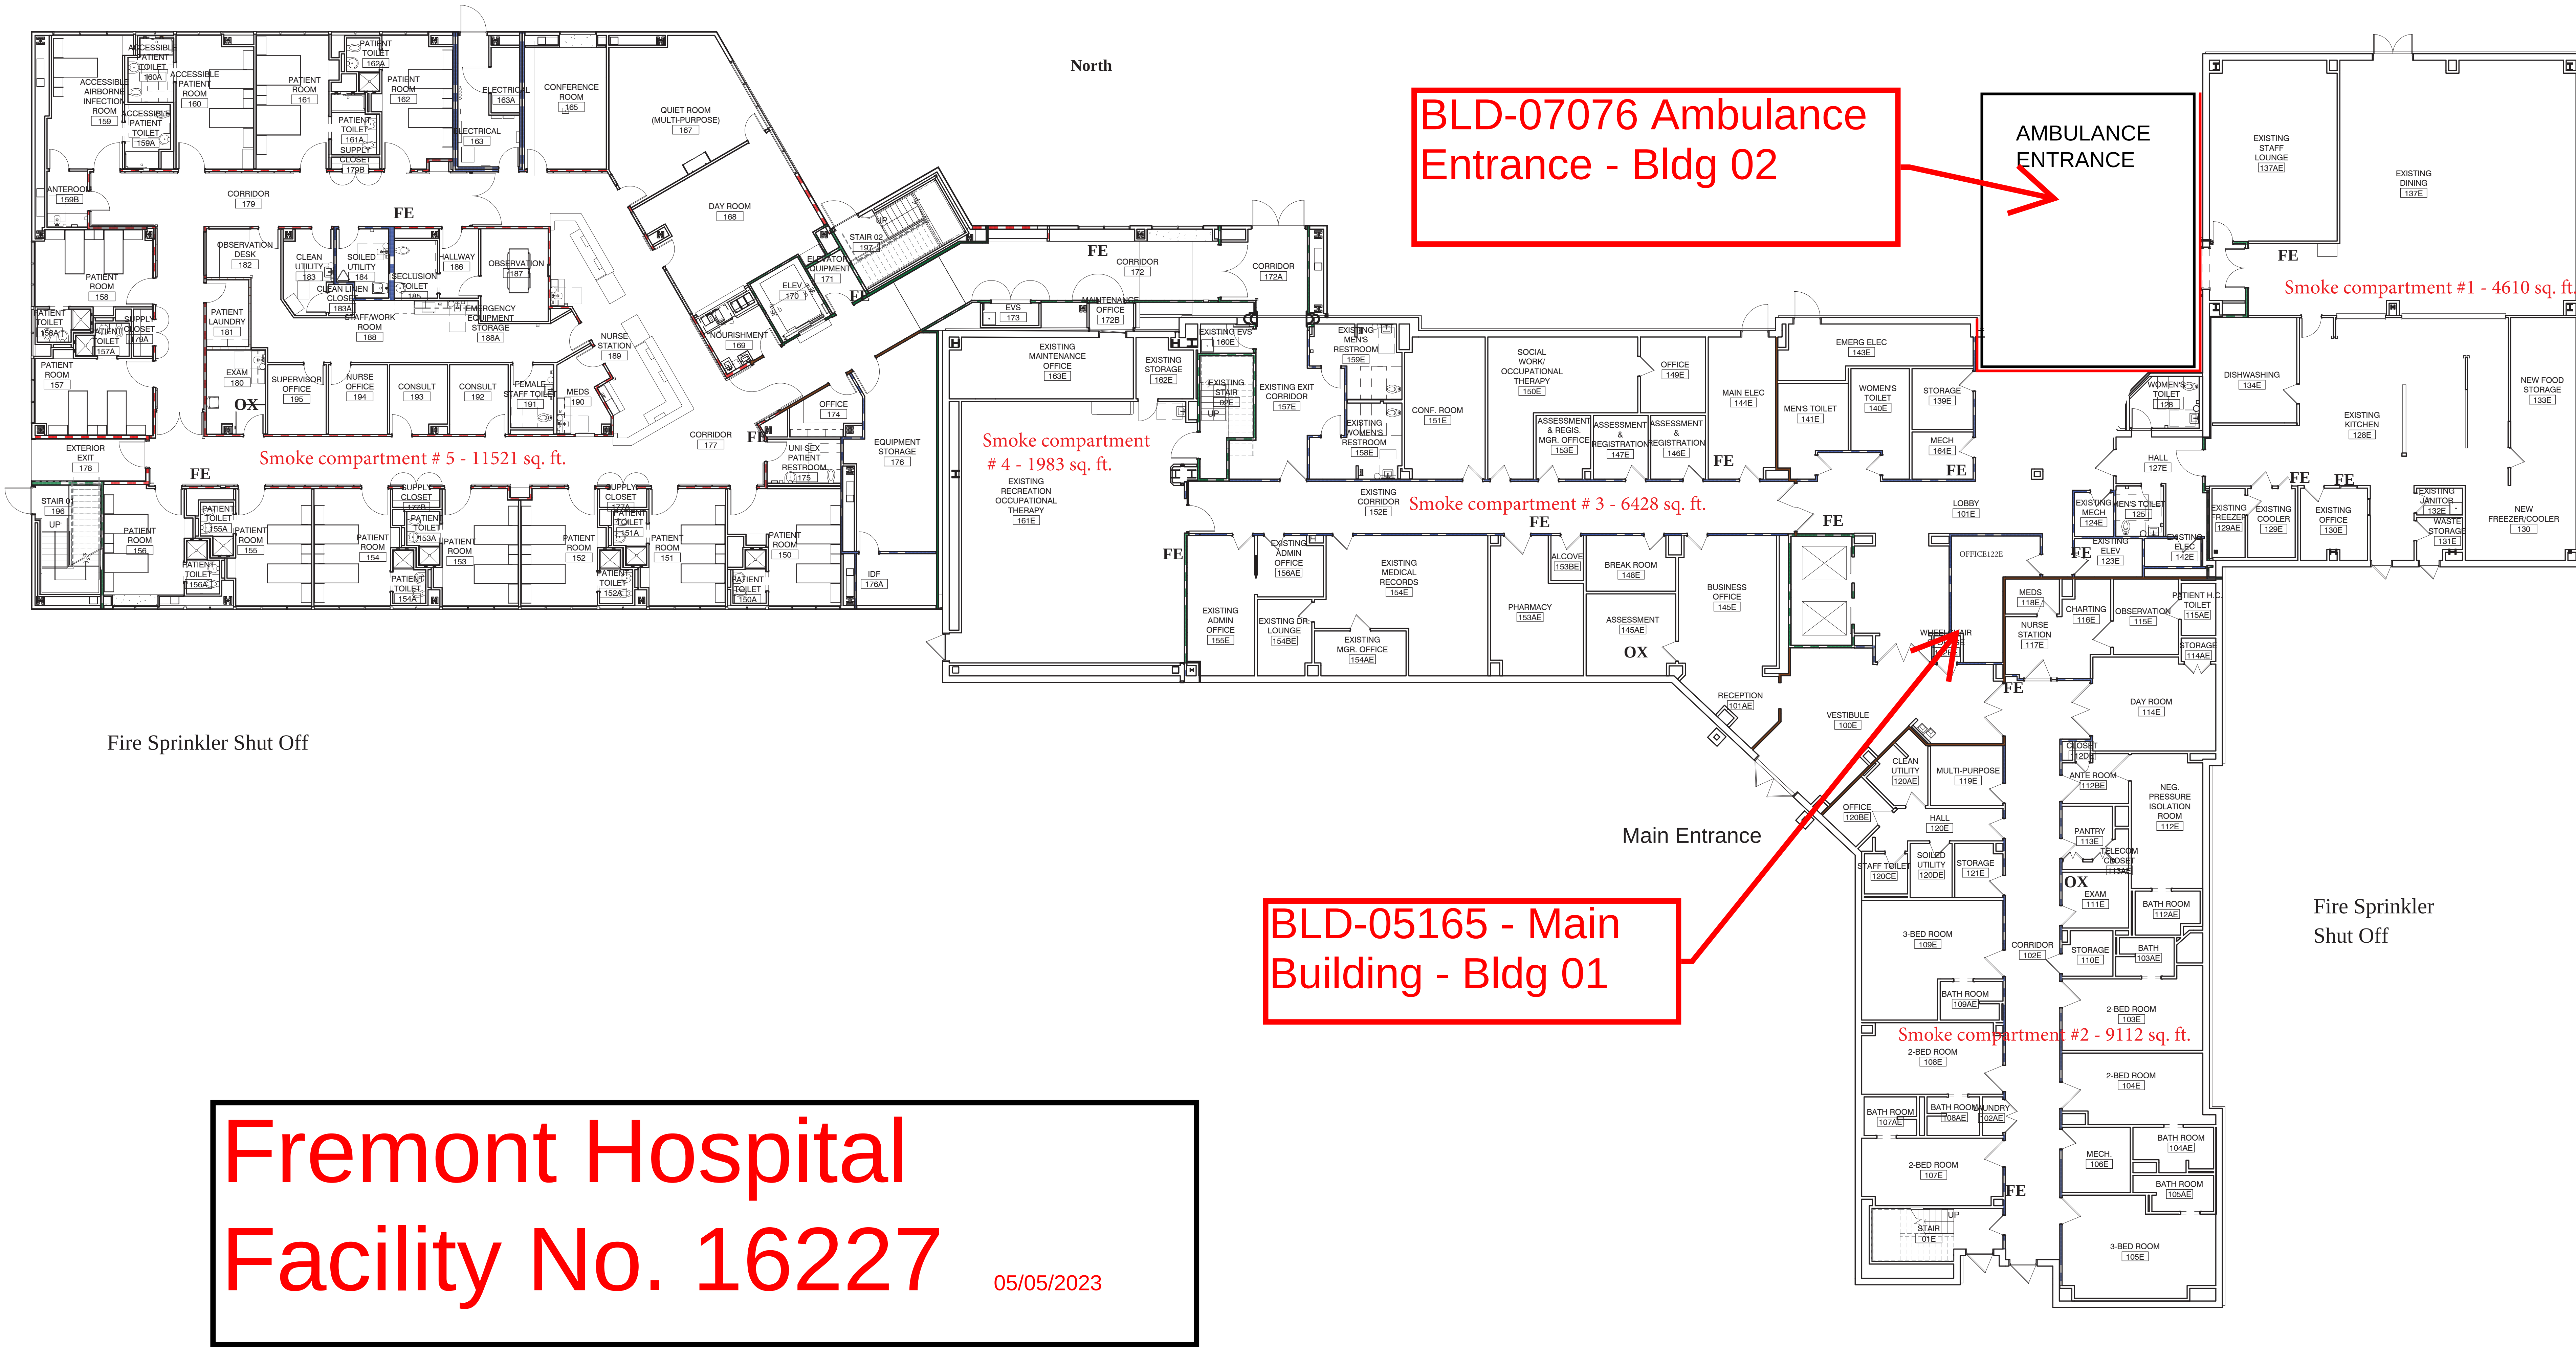

Fremont Hospital
Facility No. 16227

05/05/2023