


ELECTRIC PANEL

FIRE SPRINKLER SHUTOFF

N

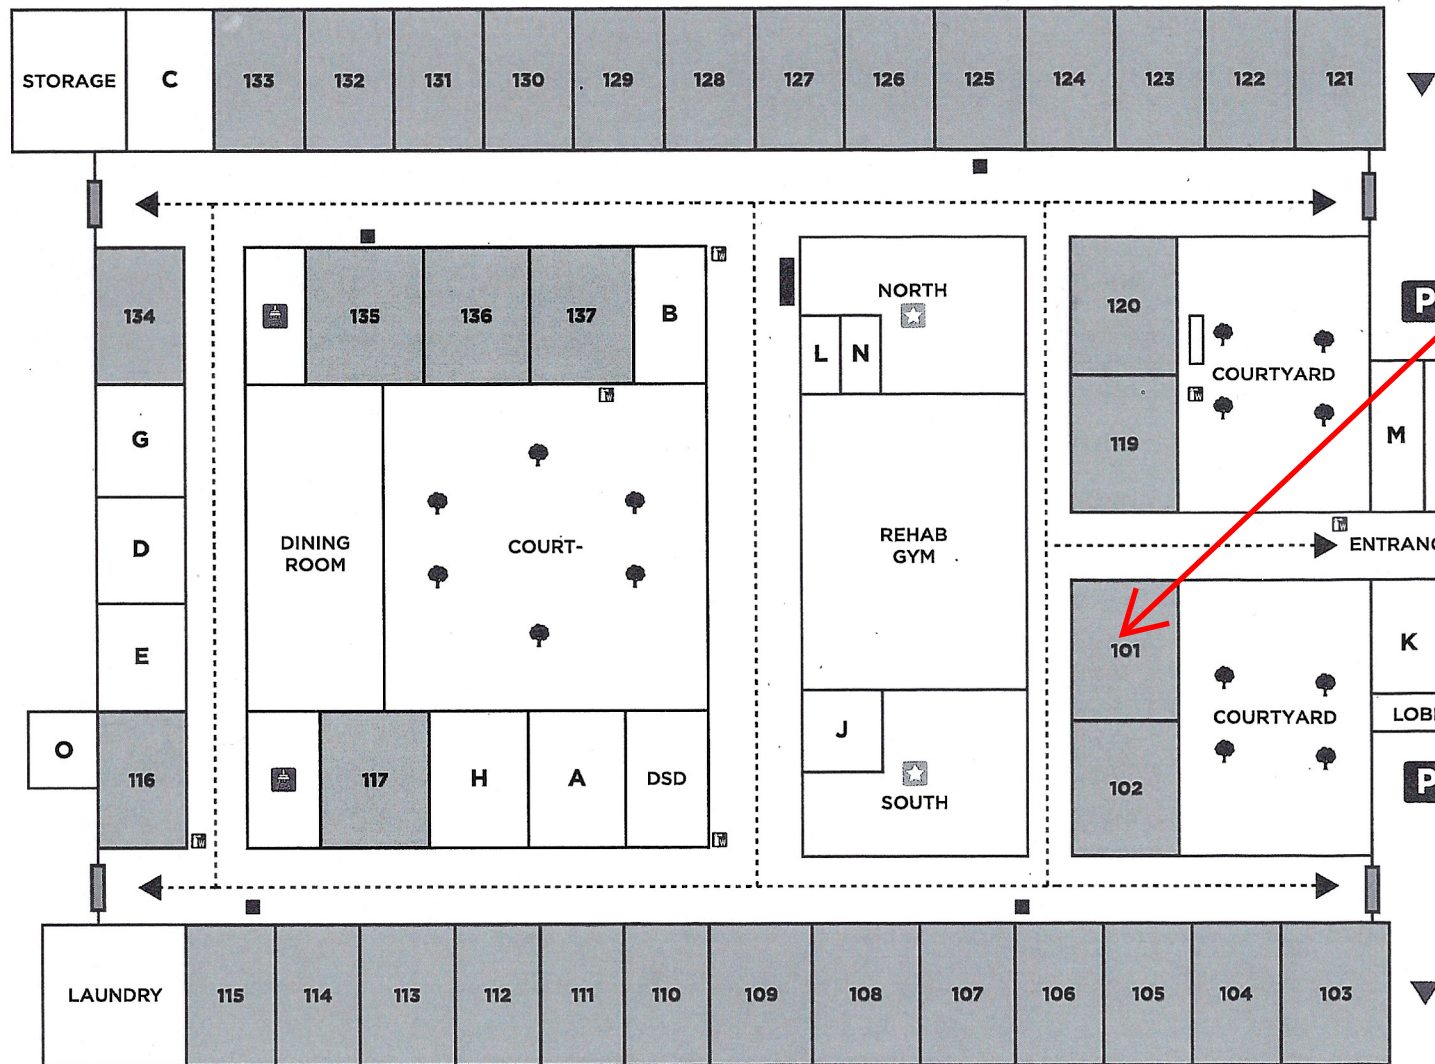

BLD-04130 - Main Building -  
Bldg 01

CITRUS AVENUE

Citrus Nursing Center  
Facility No. 20653      4/12/2024