

EMERGENCY WATER SHED  
 STORAGE MAINTENANCE SHED  
 GATE

WATER H. 200 GALS.  
 LAUNDRY RM  
 BOILER ELECT. PANEL  
 STORAGE  
 ANSUL SYSTEM  
 KITCHEN  
 SHUT OFF  
 EXIT


INSP. TEST VALVE

EXIT

**BLD-04331 - Main Building - Bldg 01**

- ▲ FIRE ALARMS (6)
- ⊙ EXTINGUISHER (18)
- FIRE DOORS (4)
- B CIRCUIT BREAKERS (5)


- GAS MAIN SHUT OFF VALVE
- ▨ ELECT. BREAK MAIN PANEL

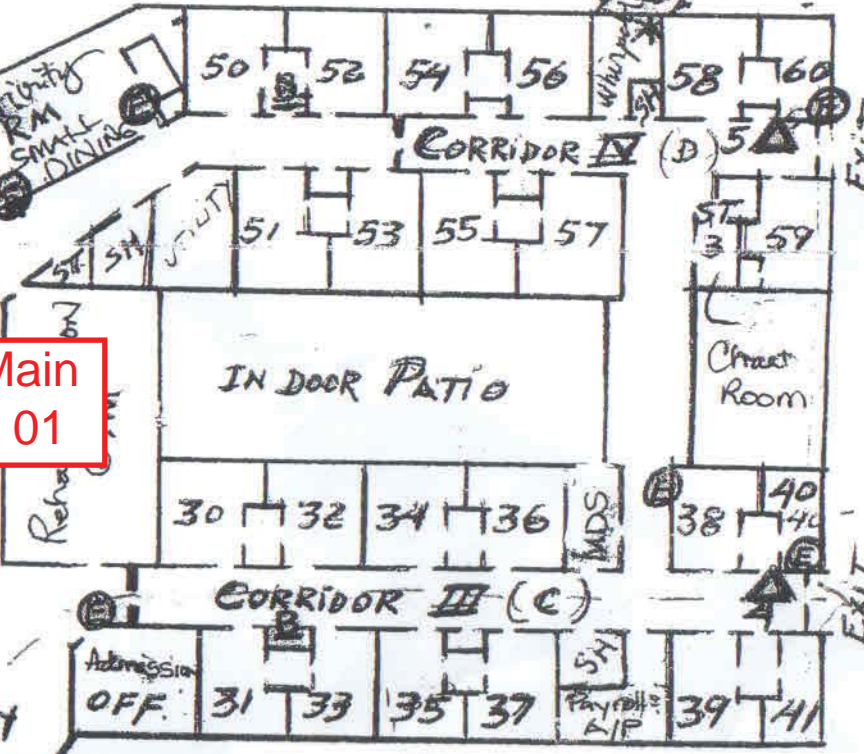

**HAYWARD HEALTHCARE & WELLNESS CENTER**  
 Facility No. 21261

06/14/17

**ROUTES**  
 FID 21261

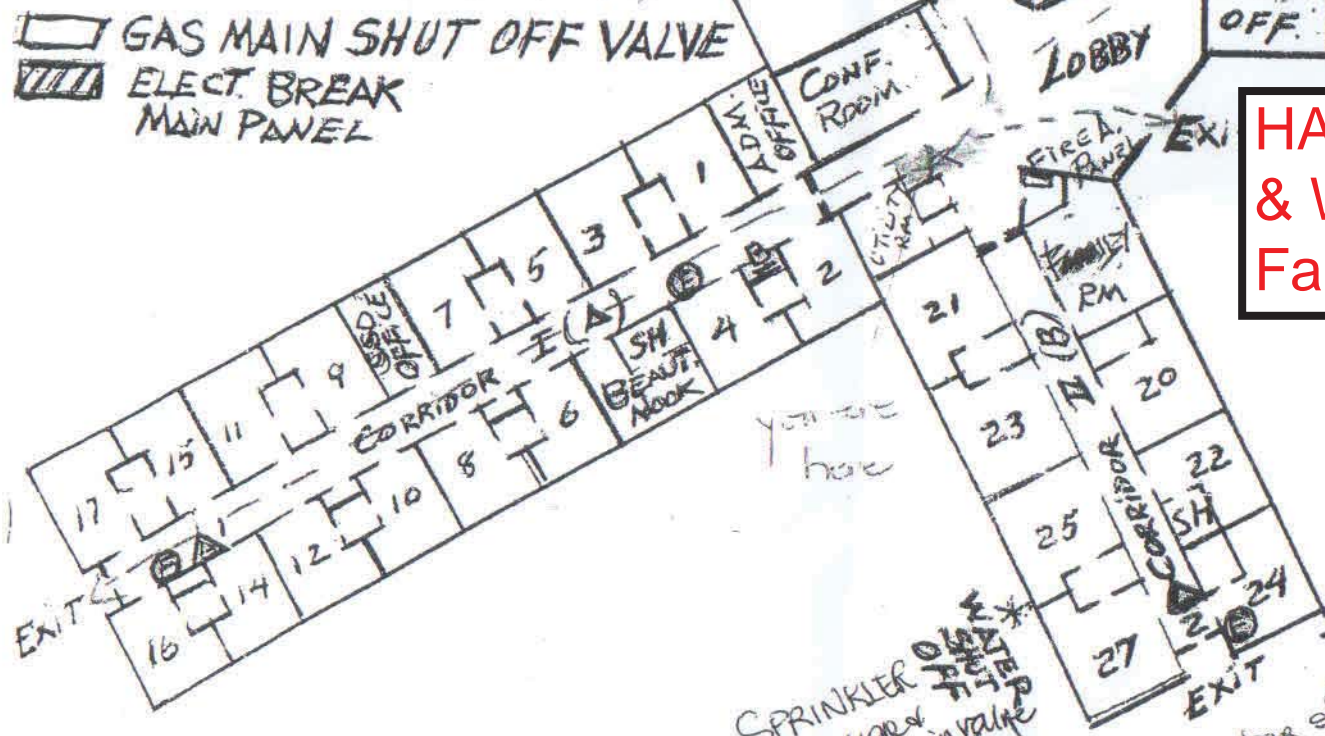

SPRINKLER  
 change rain valve

Water shut off  
 paint } city of Hayward