


EVACUATION PLAN

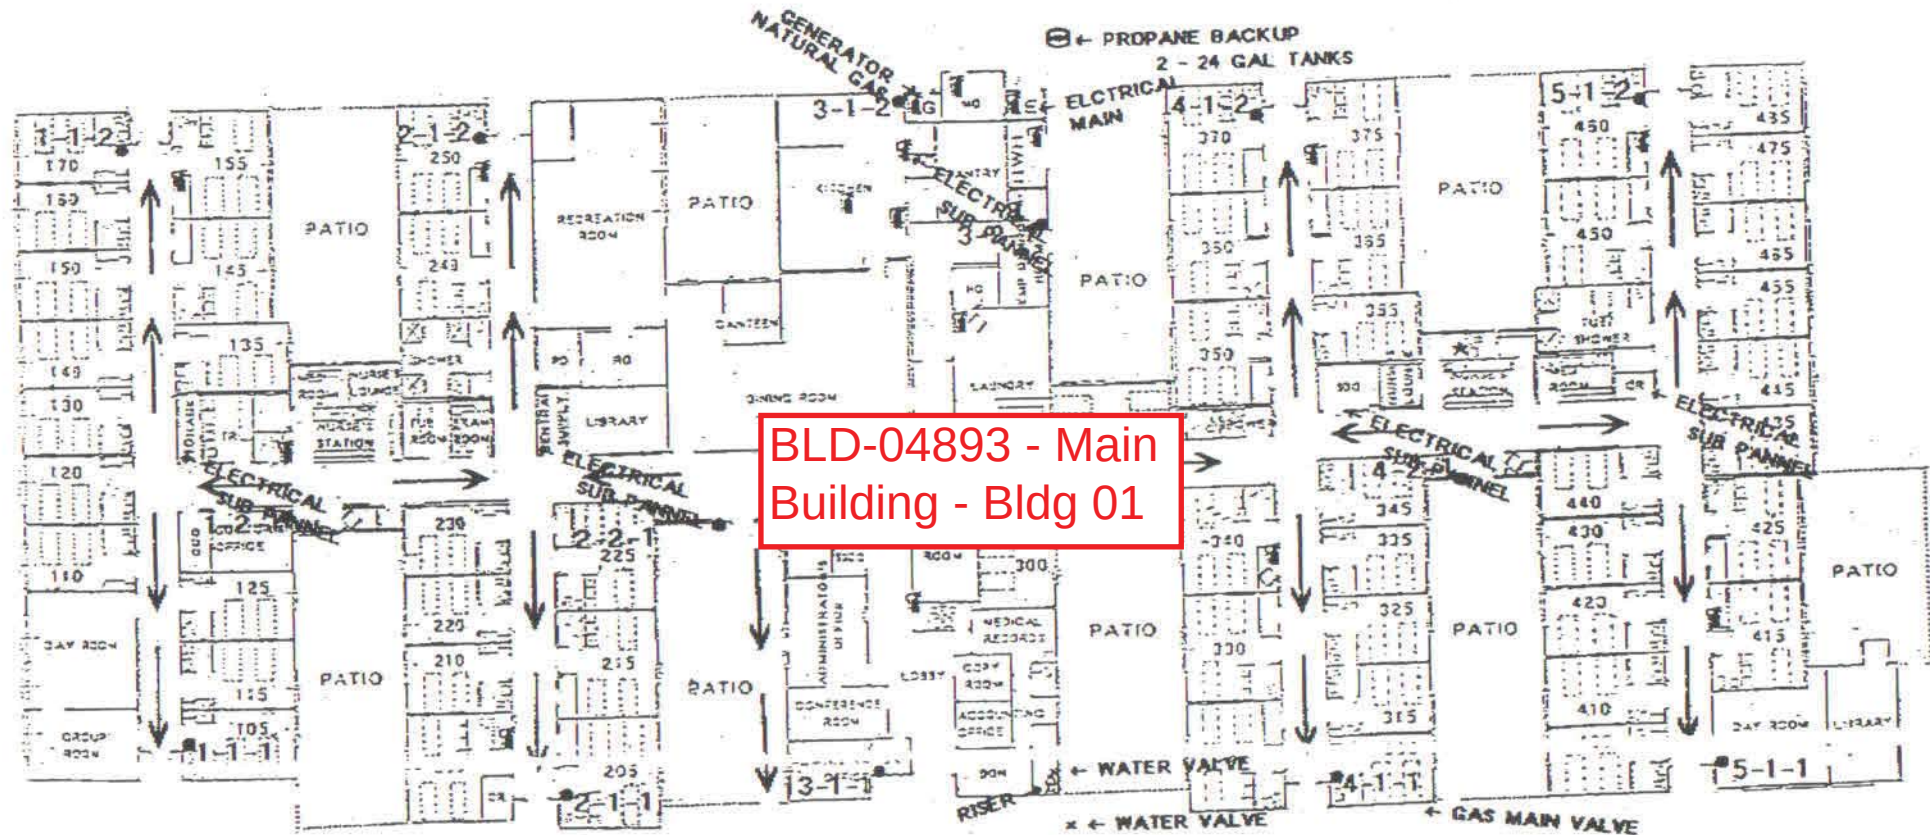

- EVACUATION ROUTE
- ☒ FIRE EXTINGUISHER
- FIRE ALARM PULL STATION
- ★ FIRE ALARM PANEL
- ⬆ RISER/SPRINKLER TEST VALVE
- ◇ SPILL CONTROL EQUIPMENT

EMERGENCY PHONE NUMBER **911**

SMOKE DETECTOR ACTIVATED 2-1-4
SPRINKLER SYSTEM ACTIVATED 7-2-4

**Crestwood Manor - Fremont
Facility No. 23038**

06/15/17