


● WATER SHUTOFF ● GAS SHUTOFF ● FIRE SPRINKLER SYSTEM SHUTOFF ▲ FIRE DEPARTMENT CONNECTION ■ FIRE SPRINKLER SYSTEM POST INDICATOR VALVE ◆ FIRE SPRINKLER SYSTEM INSPECTOR TEST VALVE

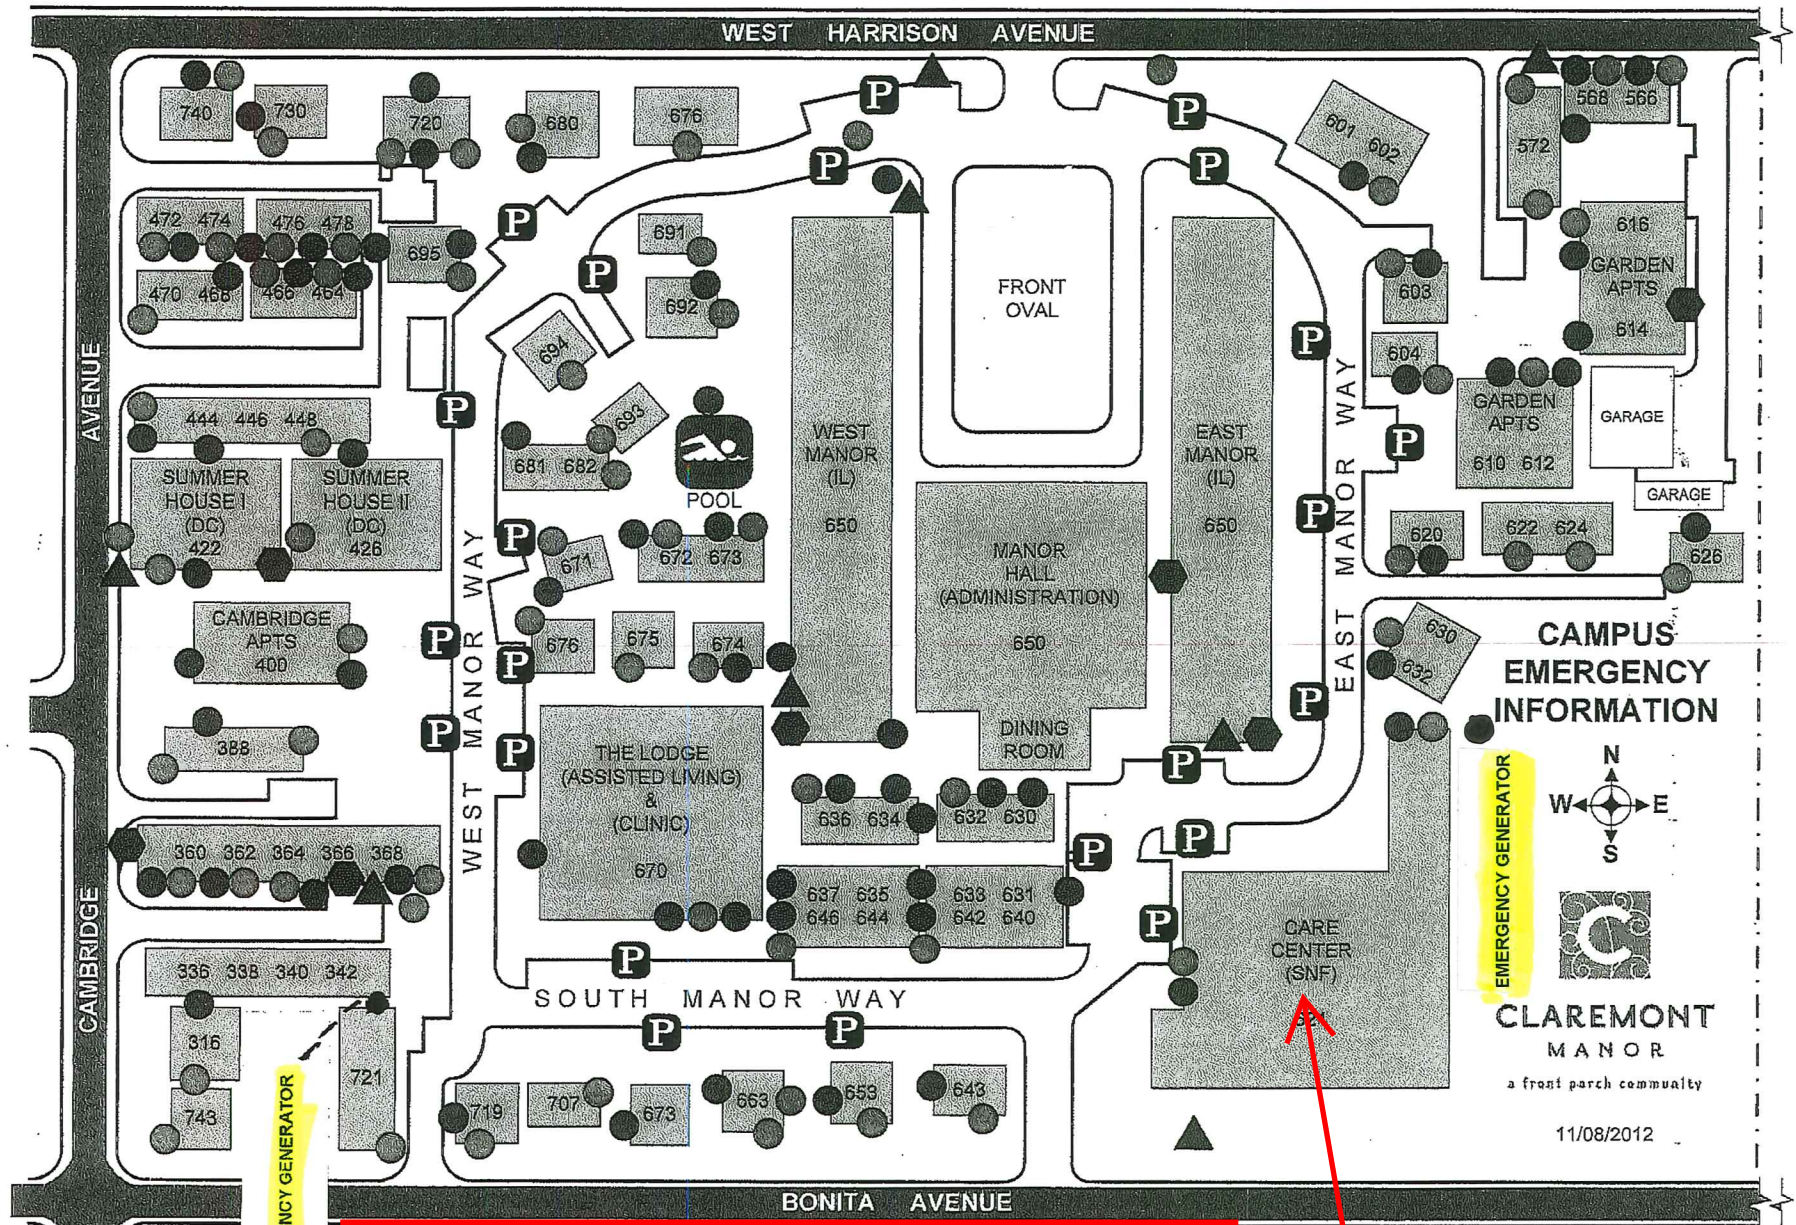

CAMPUS EMERGENCY INFORMATION
 N
 W — — E
 S

CLAREMONT MANOR
 a front porch community
 11/08/2012

Claremont Manor Care Center
Facility No. 27708 7/16/2025

BLD-05613 Main Building - Bldg 01