


UUT-2

UNIT UNDER TEST (UUT)
SUMMARY SHEET



Mounting Details: Rigid wall mounted with 3 - M8 Grade 8.8 bolts

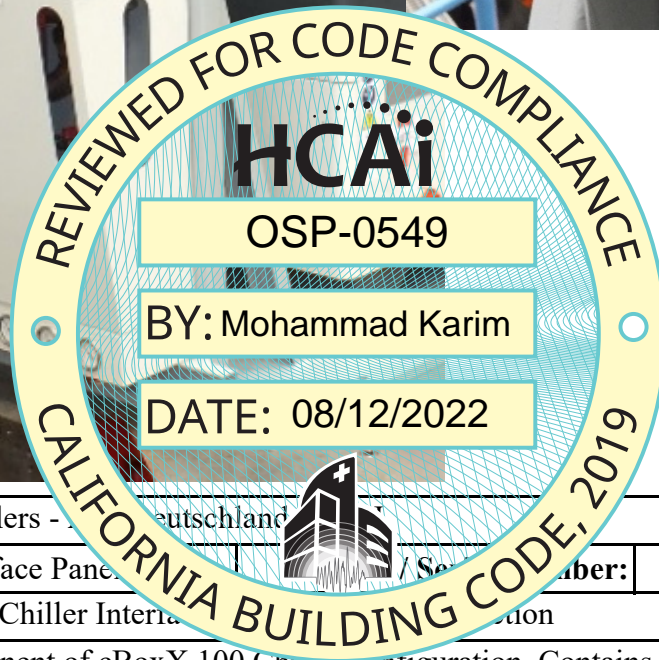

Manufacturer: KKT Chillers - Deutschland	
Component: Chiller Interface Panel / Separator	Number: 909000.0107 / Z910701
UUT Function: Serves as Chiller Interface Panel	
UUT Description: Component of cBoxX 100 Chiller configuration. Contains pressure gauges, manual shut off valve, flow meter, and thermometer.	
Test Location: IABG mbH, Germany	Test Date: September 2017

UUT PROPERTIES

Weight (lb)	Dimensions (inches)			Natural Frequency (Hz)		
	Width	Depth	Height	FB	SS	V
171	13.6"	25.4"	52.2"	15.4	16.4	32.8

SEISMIC TEST PARAMETERS

Building Code / Test Criteria	S _{DS} (g)	z / h	I _p	A _{FLX-H} (g)	A _{RIG-H} (g)	A _{FLX-V} (g)	A _{RIG-V} (g)
CBC 2019 / ICC-ES AC156	2.00	1.0	1.5	3.20	2.40		
	2.50	0.0	1.5			1.67	0.67

Note: ¹⁾ The unit was full of contents during testing and remained functional before and after the ICC-ES AC156 test. ²⁾ The unit maintained structural integrity during and after the ICC-ES AC156 Test.