

ATTACHMENT 2: UNIT UNDER TEST SUMMARIES

SPECIAL SEISMIC CERTIFICATION

UUT 12

DOCUMENT NO.: 20043CR2.1

MANUFACTURER:	TOSHIBA INTERNATIONAL CORPORATION
MODEL NUMBER:	440A800MFS3CPXXX-S
UNIT FUNCTION:	AUXILIARY CABINET
SERIAL NUMBER:	15032502SU

DIMENSIONS (in)			WEIGHT (lb)	RES. FREQ. (Hz)		
DEPTH	WIDTH	HEIGHT		F-B	S-S	V
37.2	32.1	73.6	517	N/A	N/A	N/A

CODE & CRITERIA:	2022 CBC	ICC-ES AC156
-----------------------------	----------	--------------

TEST LABORATORY:	ENVIRONMENTAL TESTING LABORATORY
-------------------------	----------------------------------

REPORT & DATE:	SQ37-1502-01, Rev. 3	April 3, 2015
---------------------------	----------------------	---------------


S _{DS} (g)	z/h	A _{FLX-H} (g)	A _{RIG-H} (g)	A _{FLX-V} (g)	A _{RIG-V} (g)
2.0	1	3.20	2.40	1.68	0.68
2.5	0				

IMPORTANCE FACTOR, I_p = 1.5
 Unit was full of operating content during the shake table test. Unit maintained structural integrity and remained functional per manufacturer requirement after shake table test.

MOUNTING: Rigid floor and wall mounted. Unit base is mounted using (4) 1/2" Grade 8 bolts. Unit top is mounted with the seismic wall mount bracket using (2) 3/8" ASTM A574 socket head bolts.

CONSTRUCTION: Painted carbon steel enclosure and framing.

SUBCOMPONENTS: Subcomponents are uniquely identified by the model number.

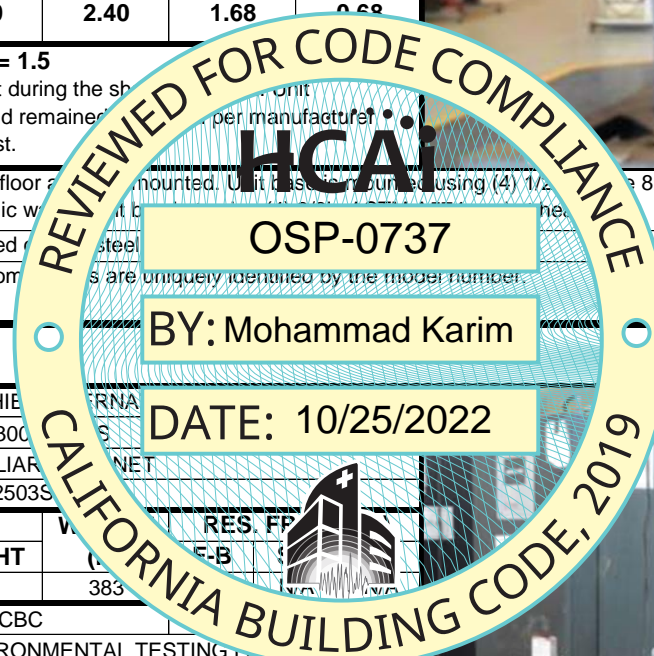

UUT 13

MANUFACTURER:	TOSHIBA INTERNATIONAL CORPORATION
MODEL NUMBER:	440A300MFS3CPXXX-S
UNIT FUNCTION:	AUXILIARY CABINET
SERIAL NUMBER:	15032503SU

DIMENSIONS (in)			WEIGHT (lb)	RES. FREQ. (Hz)		
DEPTH	WIDTH	HEIGHT		F-B	S-S	V
37.4	20.1	65.1	383	N/A	N/A	N/A

CODE & CRITERIA:	2022 CBC	ICC-ES AC156
-----------------------------	----------	--------------

TEST LABORATORY:	ENVIRONMENTAL TESTING LABORATORY
-------------------------	----------------------------------

REPORT & DATE:	SQ37-1502-01, Rev. 3	April 3, 2015
---------------------------	----------------------	---------------

S _{DS} (g)	z/h	A _{FLX-H} (g)	A _{RIG-H} (g)	A _{FLX-V} (g)	A _{RIG-V} (g)
2.0	1	3.20	2.40	1.68	0.68
2.5	0				

IMPORTANCE FACTOR, I_p = 1.5
 Unit was full of operating content during the shake table test. Unit maintained structural integrity and remained functional per manufacturer requirement after shake table test.

MOUNTING: Rigid floor and wall mounted. Unit base is mounted using (4) 1/2" Grade 8 bolts. Unit top is mounted with the seismic wall mount bracket using (2) 3/8" ASTM A574 socket head bolts.

CONSTRUCTION: Painted carbon steel enclosure and framing.

SUBCOMPONENTS: Subcomponents are uniquely identified by the model number.

